

NEPOOL Participants Committee Report

May 2024



Vamsi Chadalavada

EXECUTIVE VICE PRESIDENT AND CHIEF OPERATING OFFICER



Table of Contents

• Highlights	Page	3
• System Operations	Page	14
• Market Operations	Page	26
– Supply and Demand Volumes	Page	27
– Market Pricing	Page	38
• Back-Up Detail	Page	48
– Demand Response	Page	49
– New Generation	Page	51
– Forward Capacity Market	Page	58
– Net Commitment Period Compensation (NCPC)	Page	66
– ISO Billings	Page	73
– Regional System Plan (RSP)	Page	75
– Operable Capacity Analysis –Spring 2024 Analysis	Page	102
– Operable Capacity Analysis –Summer 2024 Analysis	Page	107
– Operable Capacity Analysis – Appendix	Page	112





Regular Operations Report - Highlights



Highlights: April 2024

Data is through April 24th

- **Peak Hour** on April 3
 - 15,657 MW system peak (Revenue Quality Metered); hour ending 7:00 pm
- **Average Pricing**
 - Day Ahead (DA) Hub Locational Marginal Price (LMP): \$25.93/MWh
 - Real Time (RT) Hub LMP: \$25.27/MWh
 - Natural Gas: \$1.56/Mmbtu (MA Natural Gas Avg)
- **Energy Market** value \$197.2M down from \$275.6M in April 2023
 - Ancillary Markets* value \$5.6M down from \$6.3M in April 2023
 - Average DA cleared physical energy** during the peak hours as percent of forecasted load was 97.8% during April, up from 96.9% during March
 - Updated March Energy Market value: \$255.7M
- **Net Commitment Period Compensation (NCPC)** total \$1.2M
 - First Contingency \$1.2M
 - Dispatch Lost Opportunity Cost (DLOC) - \$208K; Rapid Response Pricing (RRP) Opportunity Cost - \$160K; Posturing - \$0K; Generator Performance Auditing (GPA) - \$0K
 - \$162K paid to resources at external locations, up \$144K from March
 - \$0K charged to Day Ahead Load Obligation (DALO) at external locations, \$162K to RT Deviations
 - 2nd Contingency, Distribution and Voltage were zero.
- **Forward Capacity Market (FCM)** market value \$86.4M
 - FCM peak for 2024 is currently 17,993 MWh (preliminary); hour ending 6:00 P.M. on Wednesday, January 17

*Ancillaries = Reserves, Regulation, NCPC, less Marginal Loss Revenue Fund

**DA cleared physical energy is the sum of Generation and Net Imports cleared in the DA Energy Market

Underlying natural gas data furnished by:



ISO-NE PUBLIC



April 8th Solar Eclipse

Vamsi Chadalavada

EXECUTIVE VICE PRESIDENT & CHIEF OPERATING OFFICER




Eclipse Highlights

- ISO's preparations were effective in maintaining reliable and efficient operations throughout the event
 - Simulation of the event in ISO's training simulator enhanced the readiness of the on-shift operating team
 - Increased regulation requirements facilitated reliable balancing of supply and demand during periods of higher uncertainty
 - Restoration of the 312 line (Berkshire to Northfield) for the day of the eclipse maximized transfer capability between New England and New York
- As expected, the solar eclipse led to a steep and significant decrease in energy production from solar resources, but the event caused no disruptions to the power system or the markets



Solar Output Approached Record Levels Ahead of the Eclipse

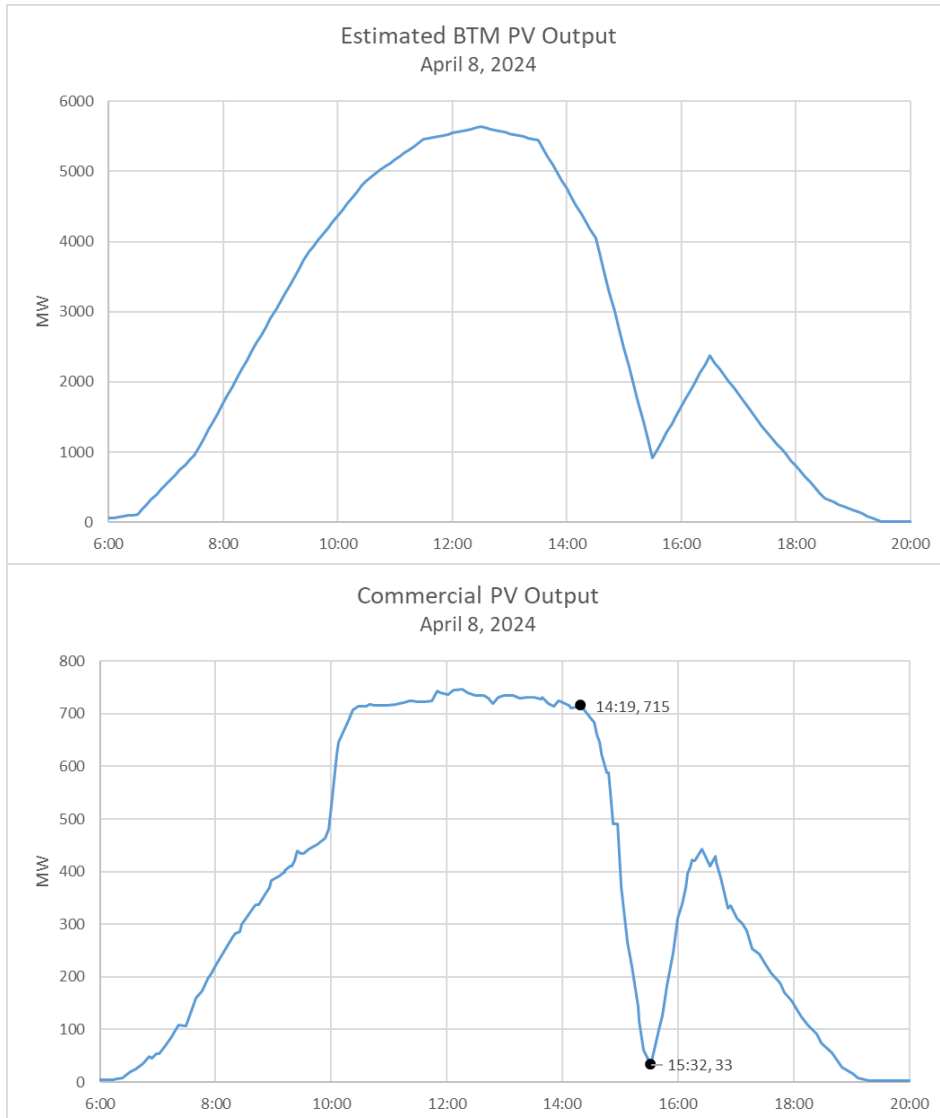


- At its peak on April 8, behind-the-meter* (BTM) PV output reached a near-record high of ~5,650 MW while commercial PV output reached a record high of ~730 MW
 - Prior to April 8, the all-time peak BTM PV output was ~5,850 MW; this has since been surpassed with ~6,100 MW of BTM PV output on April 25, 2024
- Reductions in output during the eclipse are estimated to be ~3,300 MW and ~700 MW from BTM PV and commercial PV, respectively

*BTM PV output data is estimated


Load Increased ~4,000 MW During the Eclipse

- The observed load increase of ~4,000 MW over a 60-minute period during the eclipse is the largest observed 60-min ramp on record in New England
 - Typical maximum observed 60-minute load ramps range between 2,000 – 2,200 MW

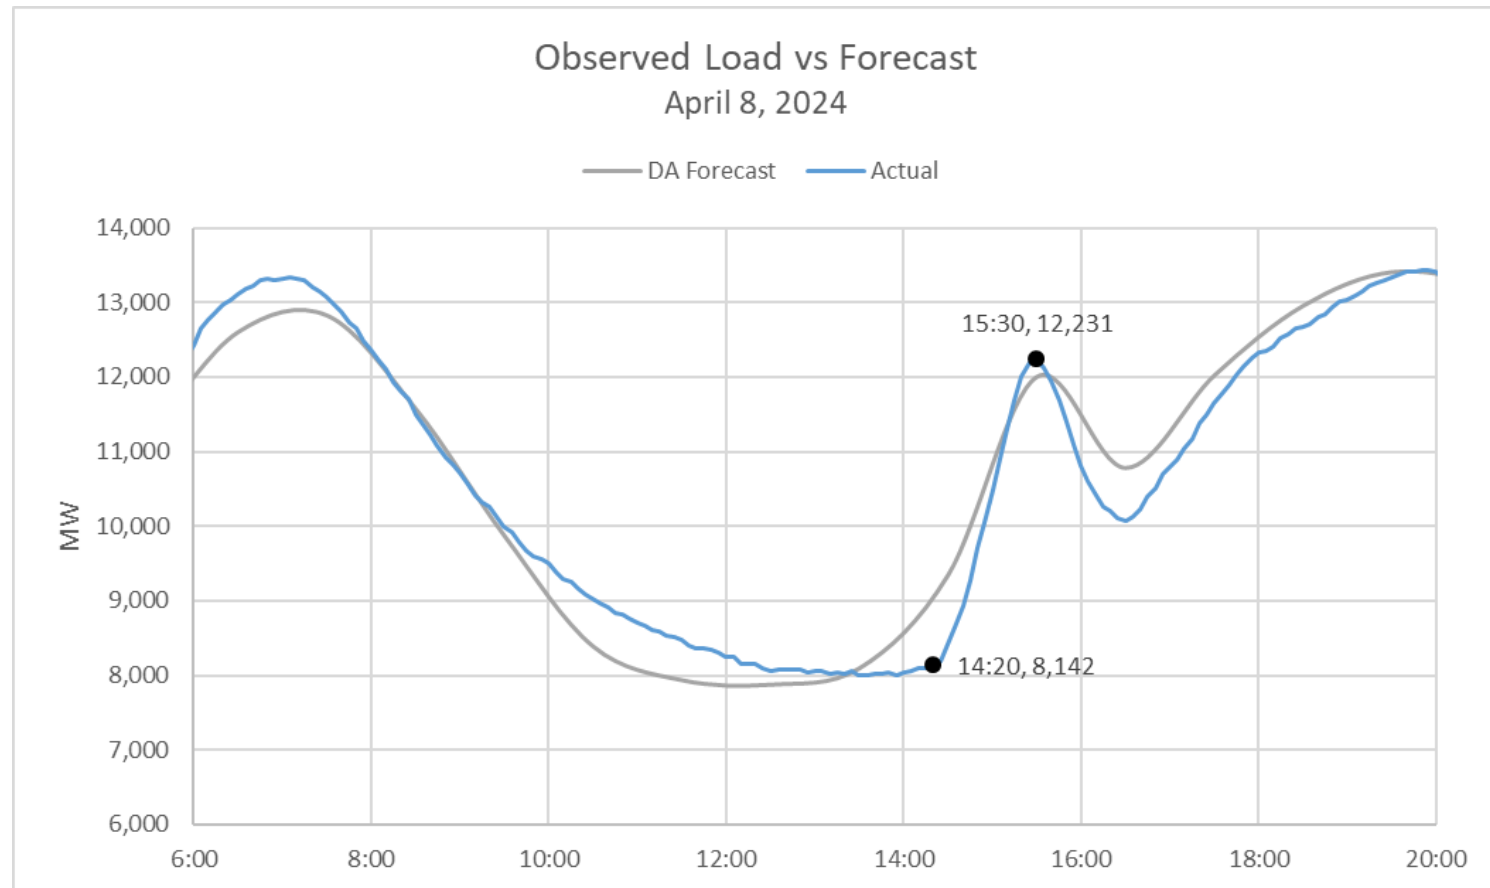


As Solar Output Ramped Down, Energy From Imports, Natural Gas, and Hydro Ramped Up


- Imports into New England increased by ~1,200 MW during the peak of the eclipse

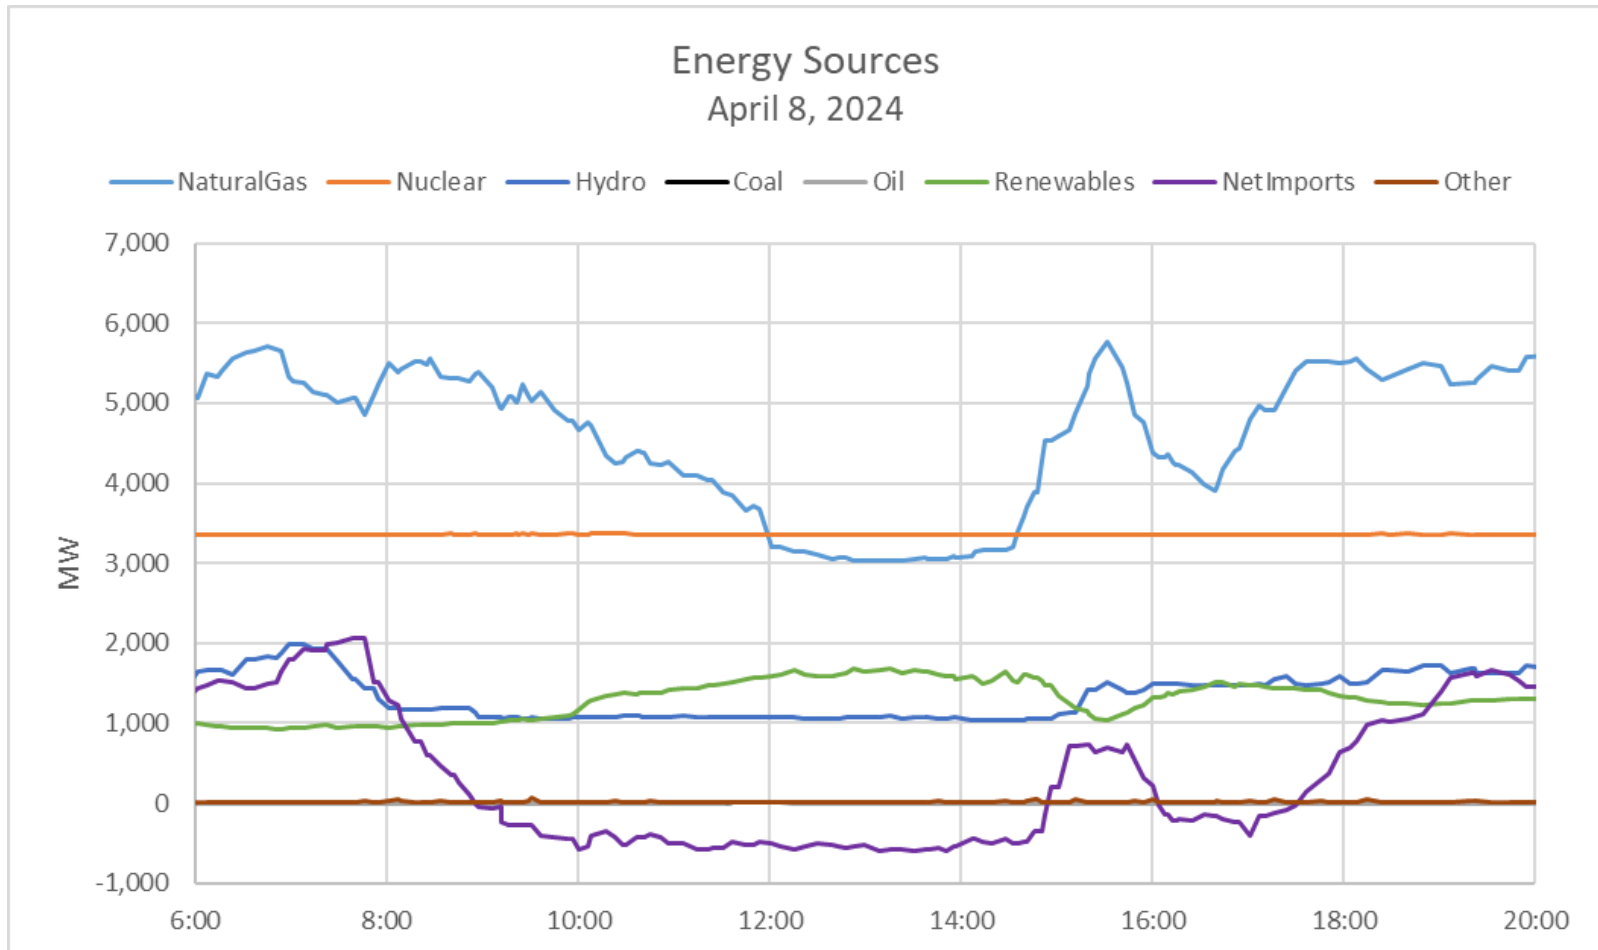

Wind Output Increased During the Eclipse and Into the Evening Hours

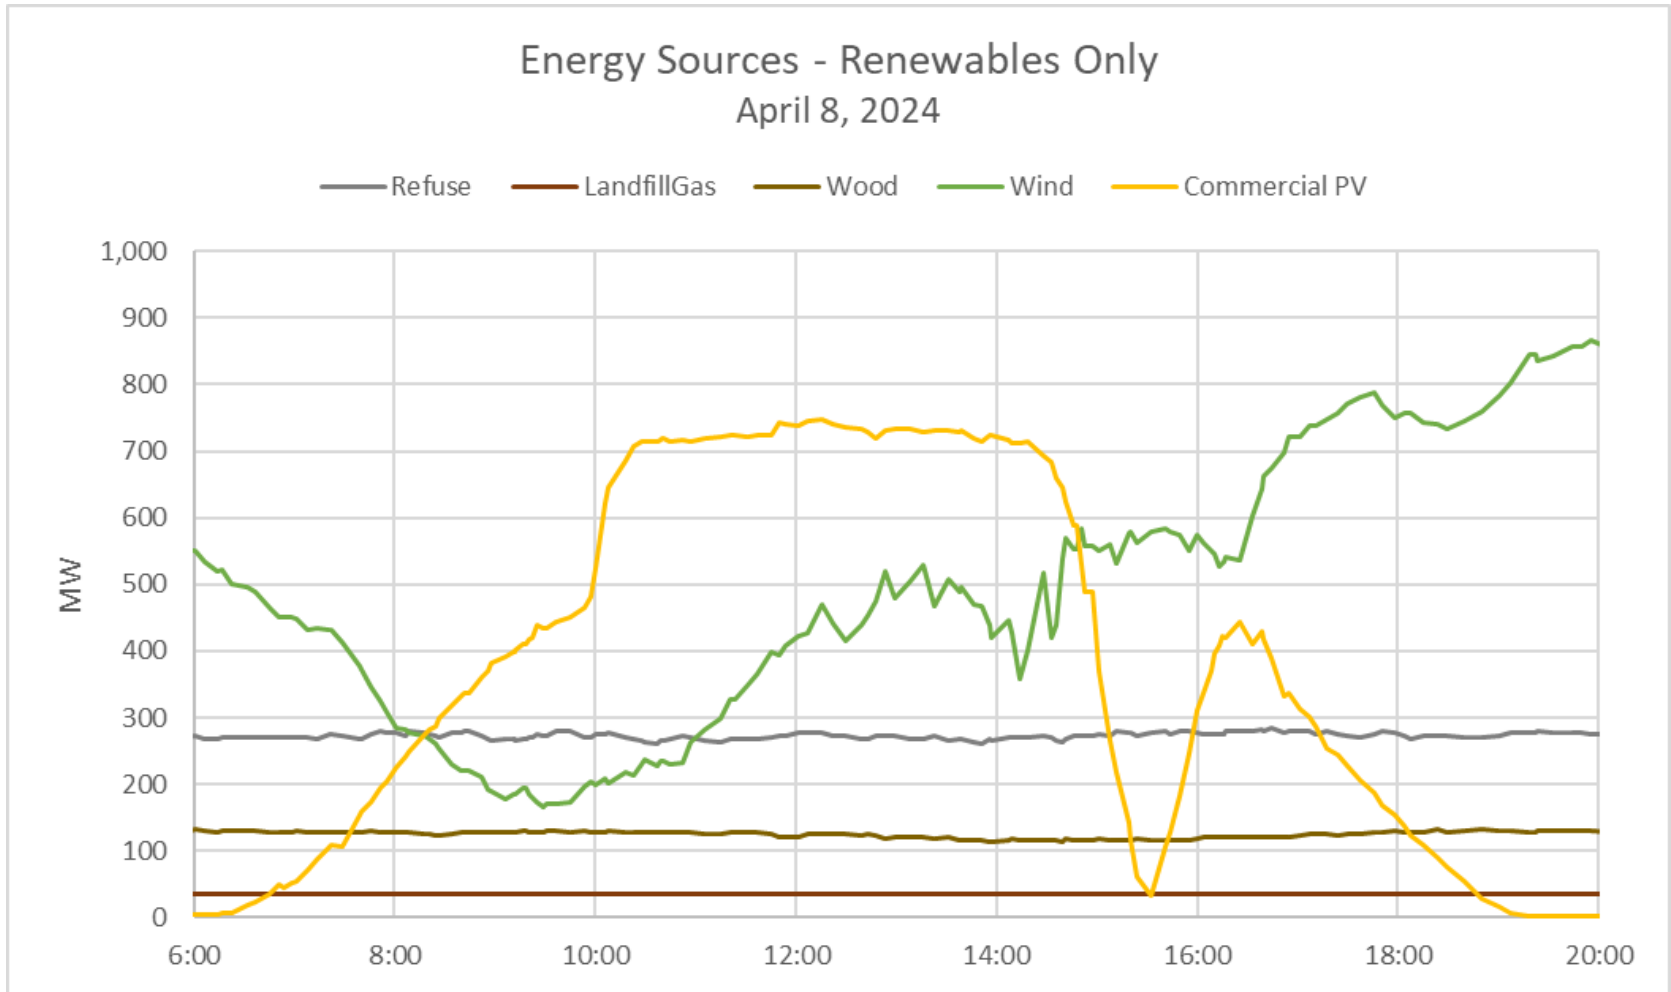

System LMPs Increased During the Periods of the Highest Load Ramps

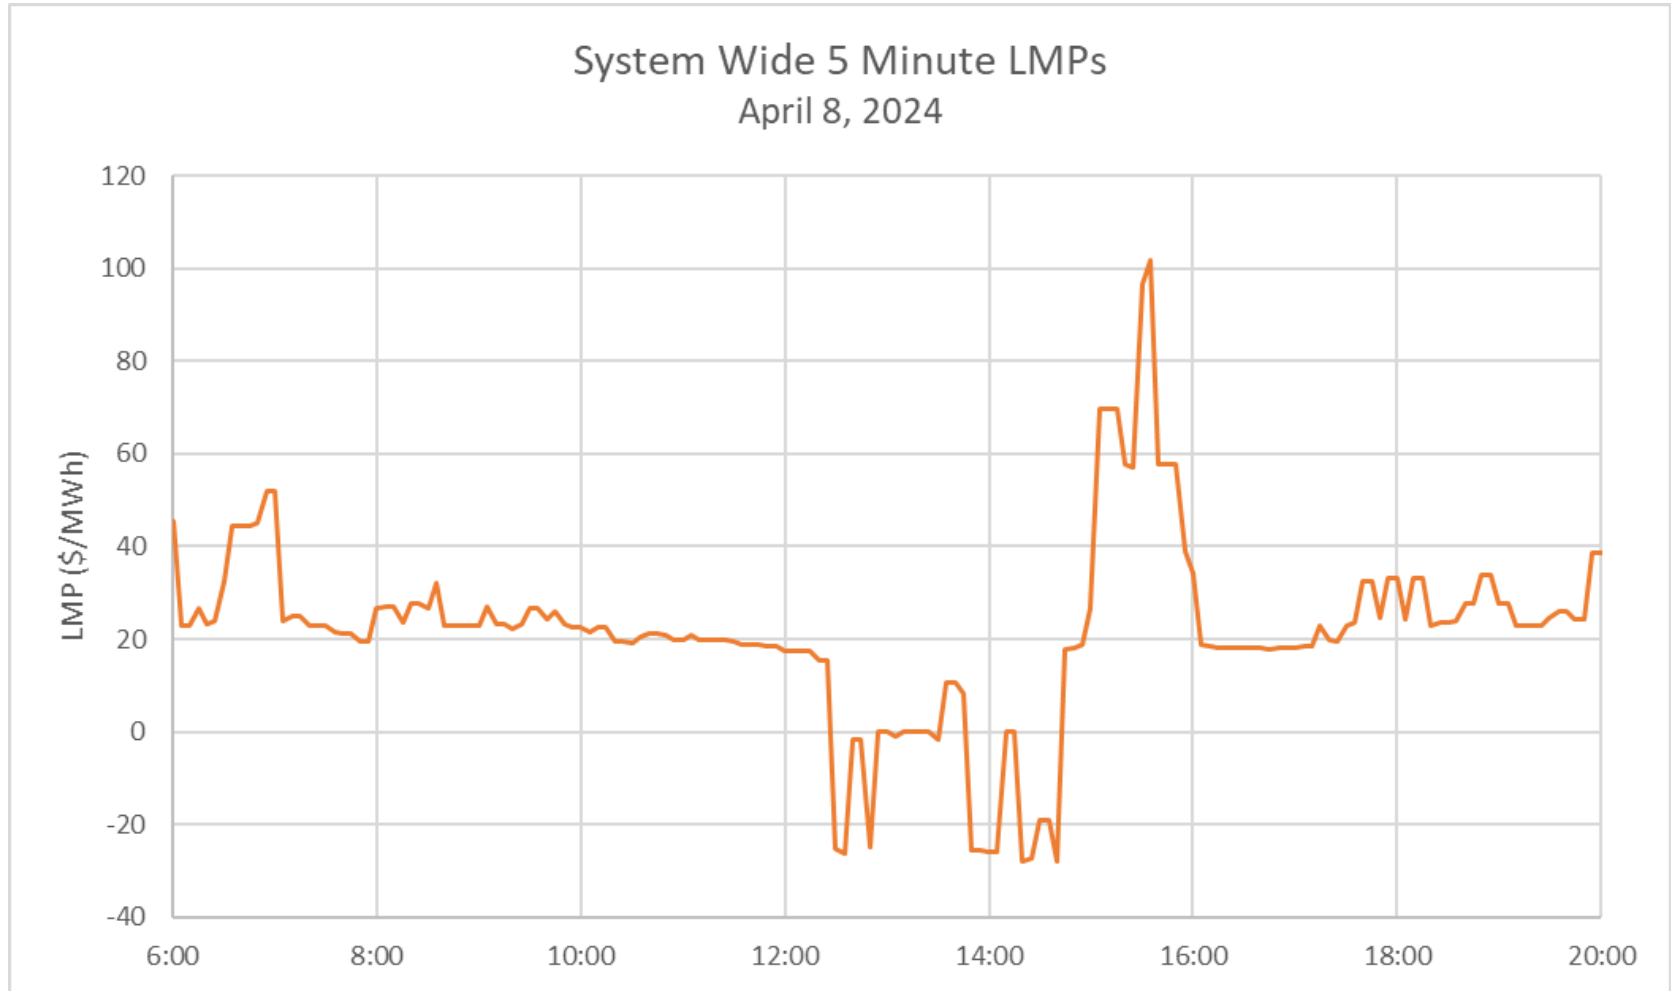

Forward Capacity Market (FCM) Highlights

- CCP 15 (2024-2025)
 - The ISO held the third annual reconfiguration auction (ARA3) over March 1-5, 2024, and posted the results on April 3, 2024
- CCP 16 (2025-2026)
 - The ISO will hold the second annual reconfiguration auction (ARA2) over August 1-5, 2024, and will post the results no later than September 3, 2024
- CCP 17 (2026-2027)
 - The ISO will hold the first annual reconfiguration auction (ARA1) over June 3-5, 2024, and will post the results no later than July 5, 2024
 - ICR and related values for the ARAs to be conducted in 2024 were filed with FERC on November 30, 2023, and FERC issued an order accepting the results effective January 29, 2024

CCP – Capacity Commitment Period

FCM Highlights, cont.

- CCP 18 (2027-2028)
 - The ISO filed the auction results with FERC on February 21, 2024, and the filing is pending
 - Comments were due April 8, 2024, and ISO requested an effective date of June 20, 2024
- CCP 19 (2028-2029)
 - The ISO filed market rule changes to delay FCA 19 for one year with FERC on November 3, 2023; FERC issued an order accepting the delay to FCA 19 on January 2, 2024
 - The ISO filed market rule changes to delay FCA 19 for two additional years with FERC on April 5, 2024, and the filing is still pending
 - The ISO will hold an interim reconfiguration auction (RA) qualification process resulting from the FCA 19 delay in 2024
 - The Show of Interest submission window for the 2024 interim RA qualification process opened on April 17, 2024, and closed on April 30, 2024

SYSTEM OPERATIONS



System Operations

<u>Weather Patterns</u>	Boston	Temperature: Above Normal (0.1°F) Max: 73°F, Min: 34°F Precipitation: 2.87" – Below Normal Normal: 3.40" Snow: 0.10"	Hartford	Temperature: Above Normal (1.9°F) Max: 77°F, Min: 31°F Precipitation: 4.16" - Above Normal Normal: 3.61" Snow: 0.60"
-------------------------	--------	--	----------	--

<u>Peak Load:</u>	15,465 MW	April 3, 2024	19:00 (ending)
-------------------	-----------	---------------	----------------

Emergency Procedure Events (OP-4, M/LCC 2, Minimum Generation Emergency)

Procedure	Declared	Cancelled	Note
M/LCC 2	04/08/2024 12:00	04/08/2024 21:00	Eclipse



System Operations


NPCC Simultaneous Activation of Reserve Events

Date	Area	MW Lost
04/10/2024	IESO	880
04/18/2024	IESO	900



2024 System Operations - Load Forecast Accuracy cont.


Dashboard Indicator 

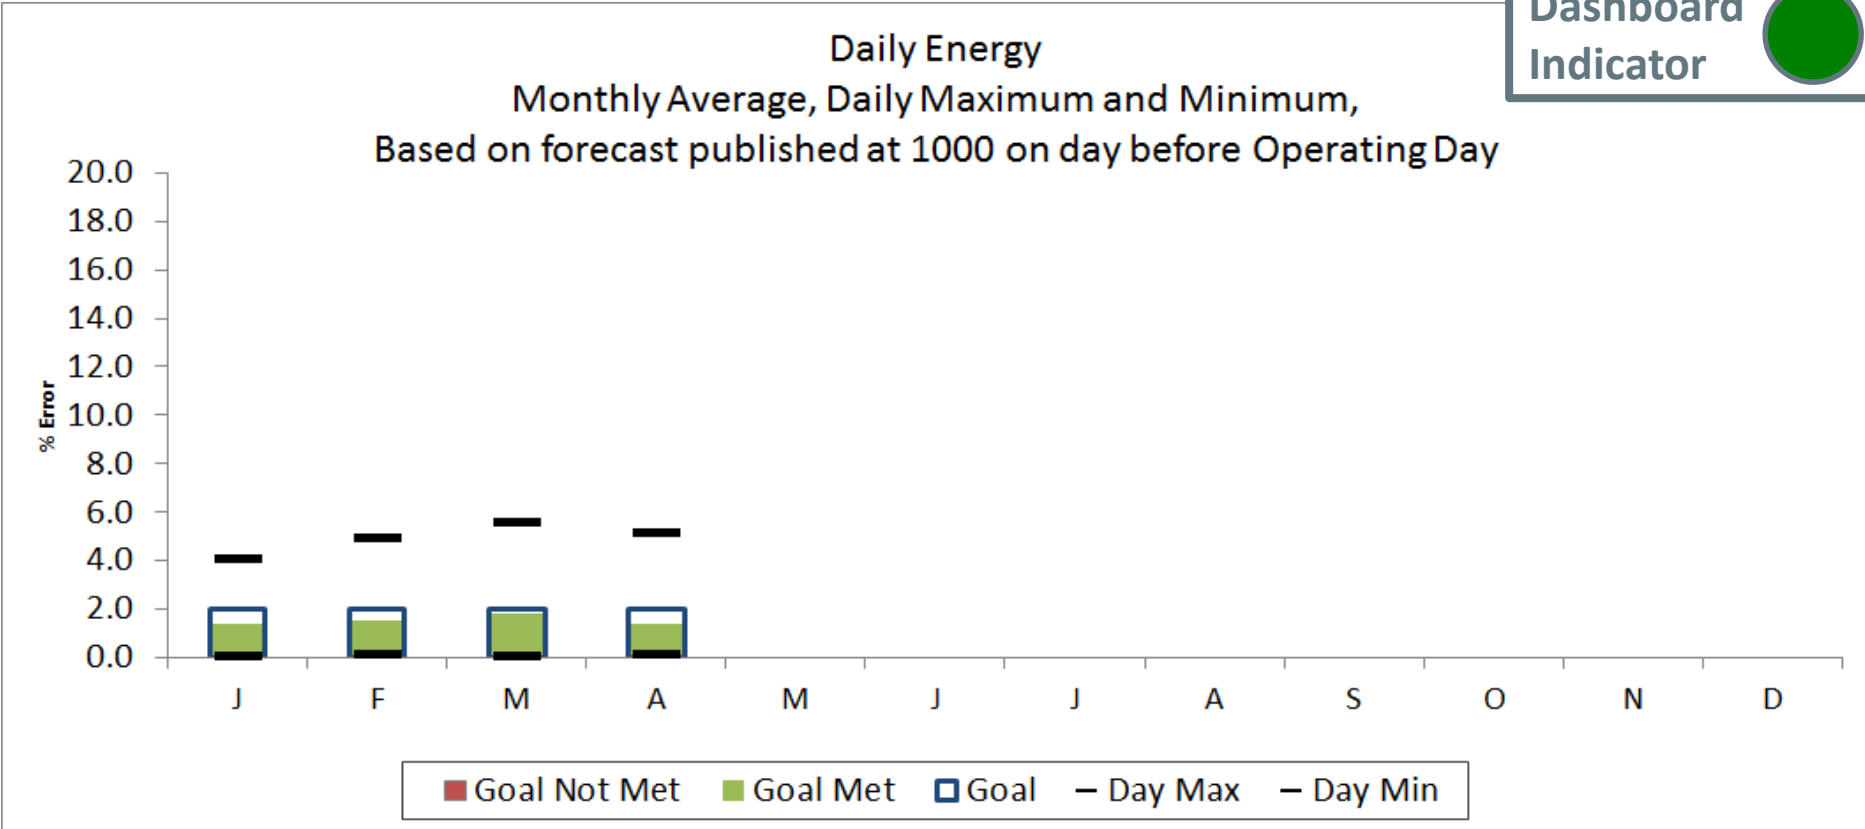

Month	J	F	M	A	M	J	J	A	S	O	N	D	
Day Max	4.02	4.89	5.56	5.09									5.56
Day Min	0.00	0.12	0.02	0.09									0.00
MAPE	1.38	1.54	1.82	1.42									1.54
Goal	2.00	2.00	2.00	2.00									


2024 System Operations - Load Forecast Accuracy cont.

Dashboard Indicator 

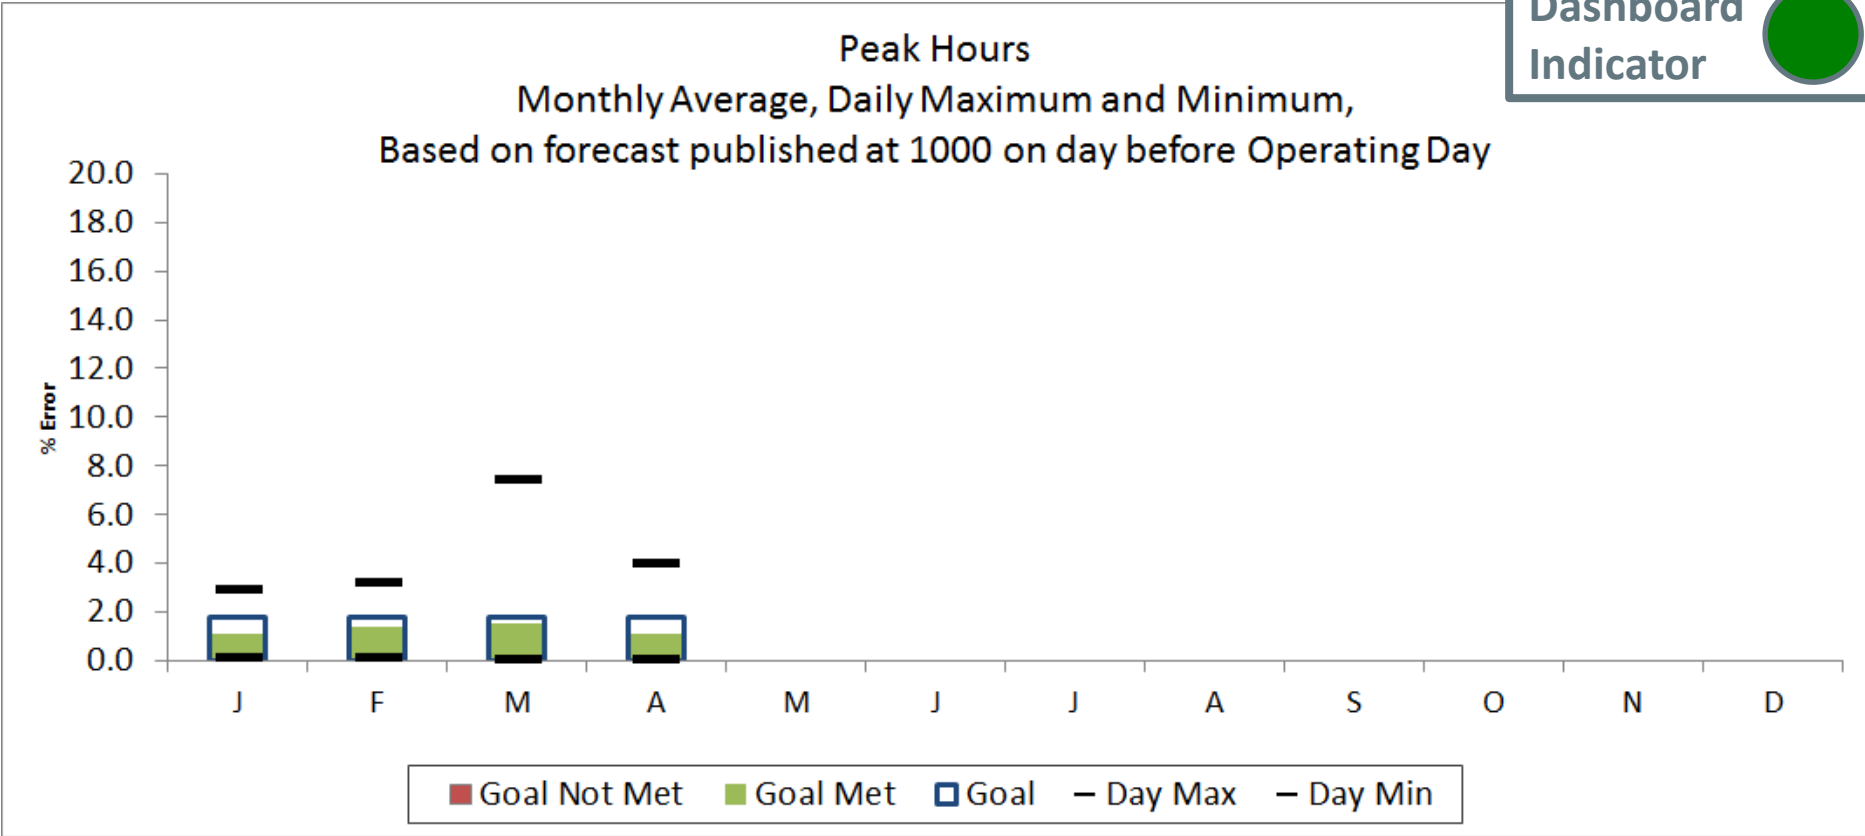


Month	J	F	M	A	M	J	J	A	S	O	N	D	
Day Max	2.90	3.17	7.45	3.99									7.45
Day Min	0.08	0.10	0.02	0.03									0.02
MAPE	1.10	1.39	1.54	1.11									1.28
Goal	1.80	1.80	1.80	1.80									

2024 System Operations - Load Forecast Accuracy

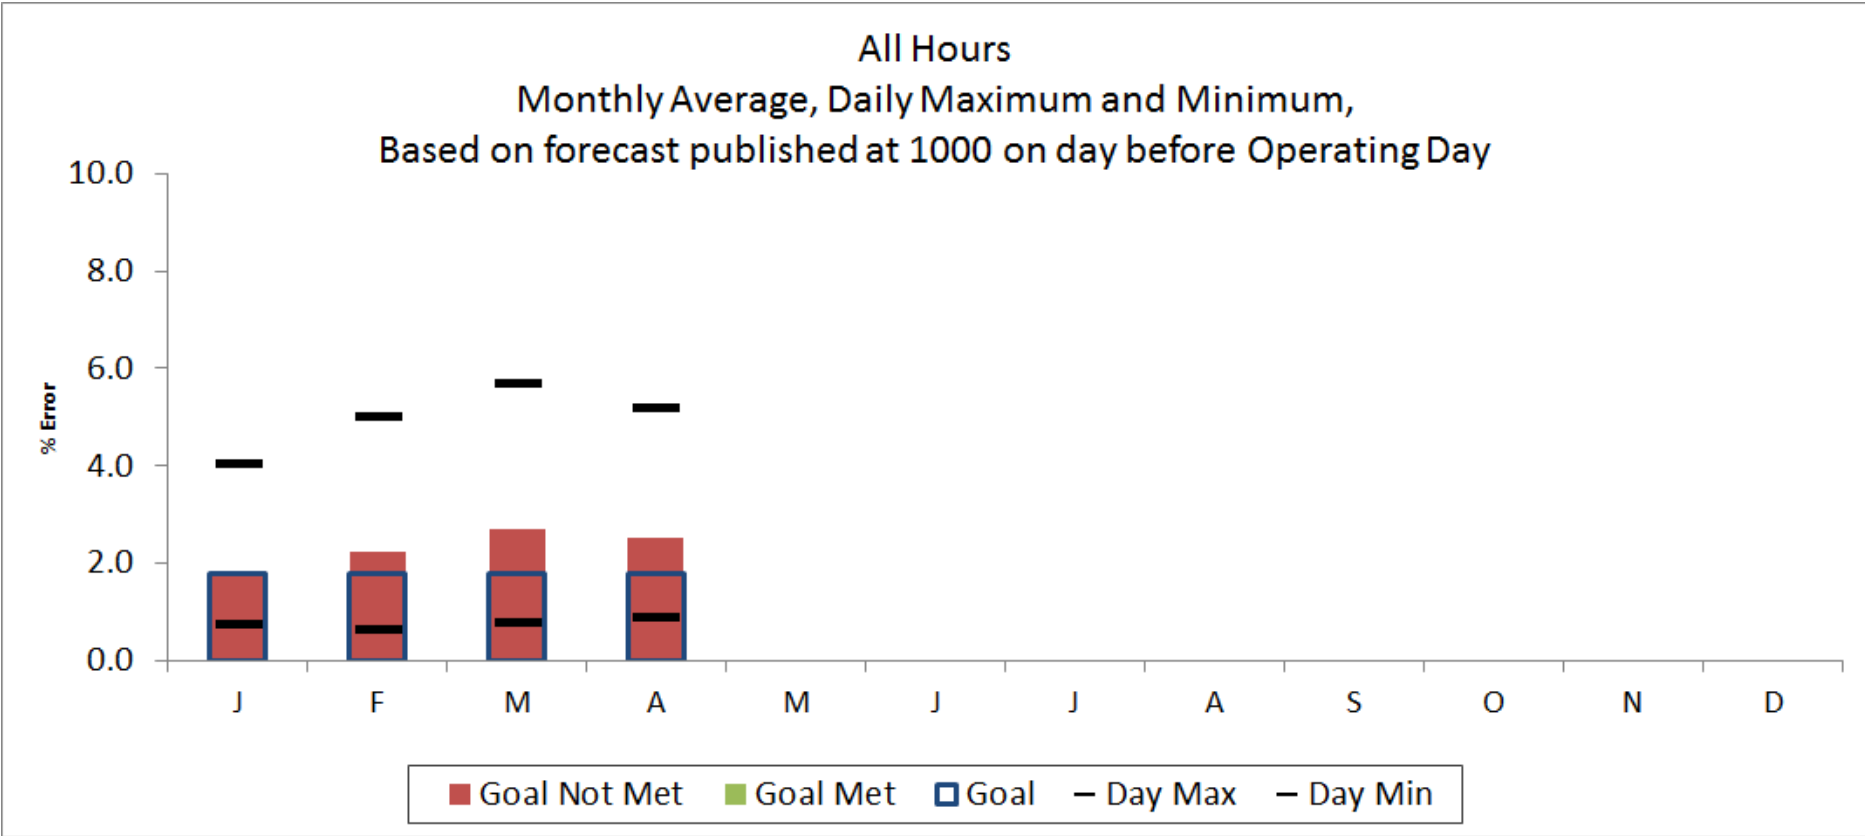


Month	J	F	M	A	M	J	J	A	S	O	N	D	
Day Max	4.03	5.00	5.67	5.18									5.67
Day Min	0.73	0.64	0.76	0.89									0.64
MAPE	1.83	2.24	2.72	2.53									2.33
Goal	1.80	1.80	1.80	1.80									

2024 System Operations - Load Forecast Accuracy cont.

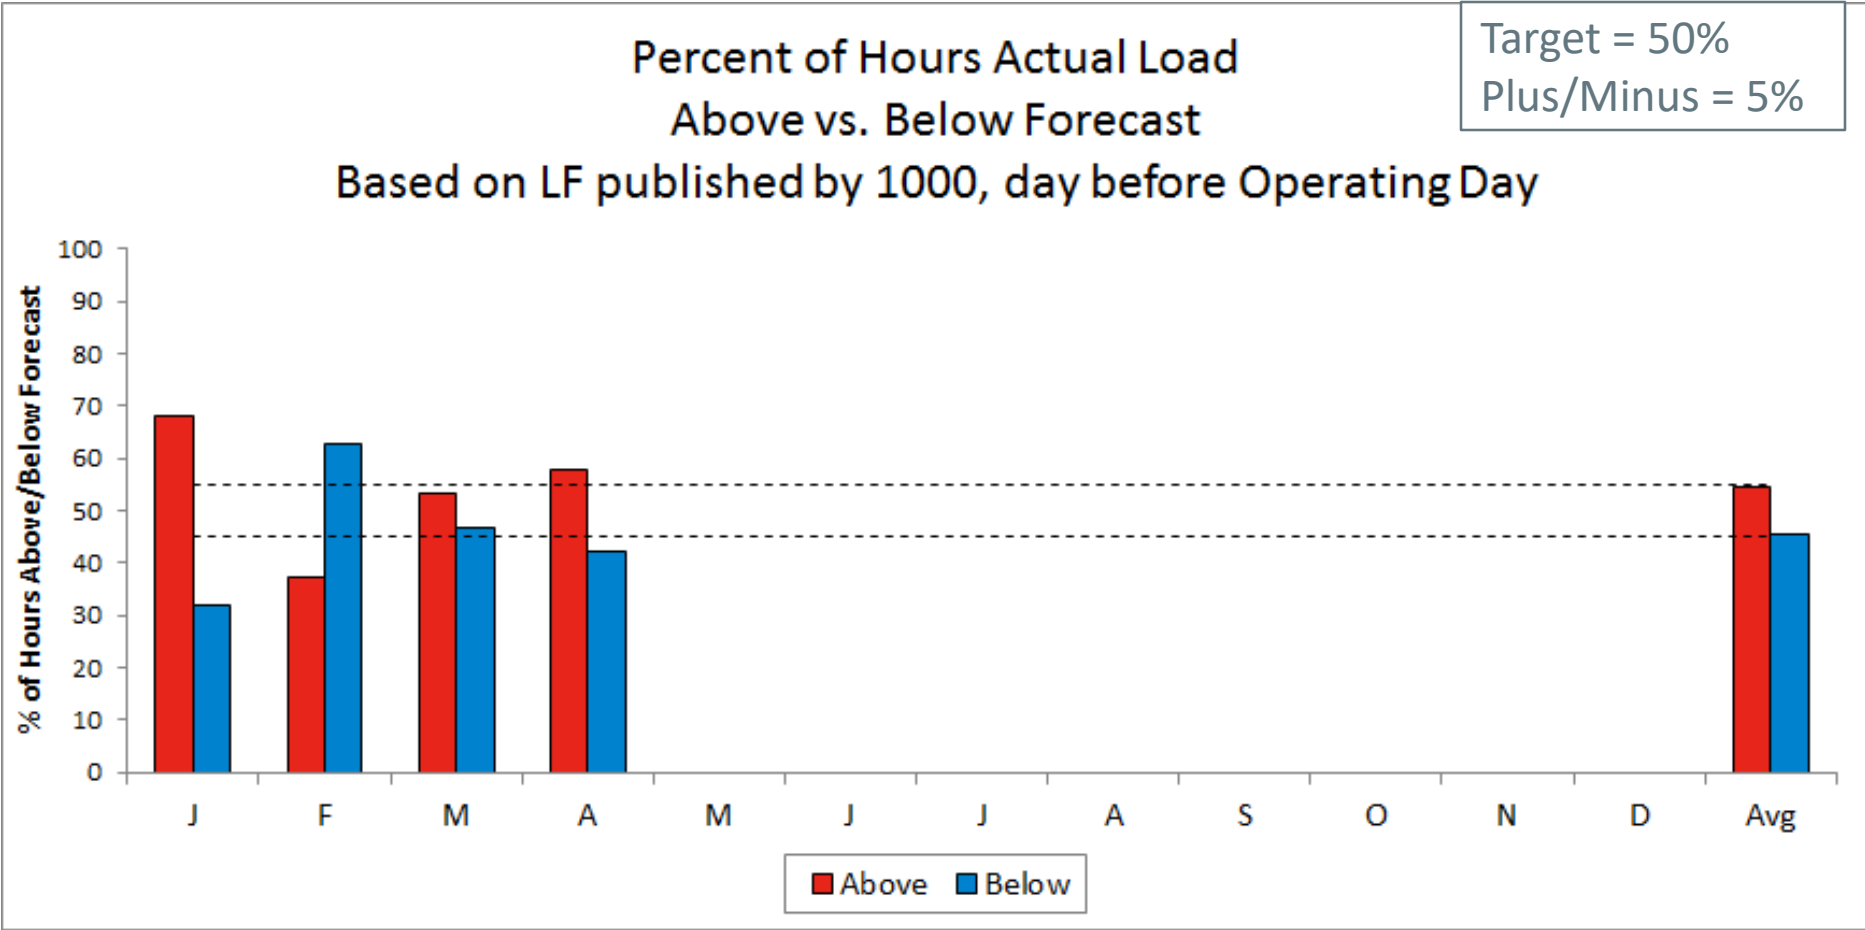


	J	F	M	A	M	J	J	A	S	O	N	D	Avg
Above %	67.9	37.4	53.3	57.9									54
Below %	32.1	62.6	46.7	42.1									46
Avg Above	260.5	155.2	254.6	233.1									261
Avg Below	-155.5	-292.3	-253.5	-223.3									-292
Avg All	132	-130	39	44									24

2024 System Operations - Load Forecast Accuracy cont.

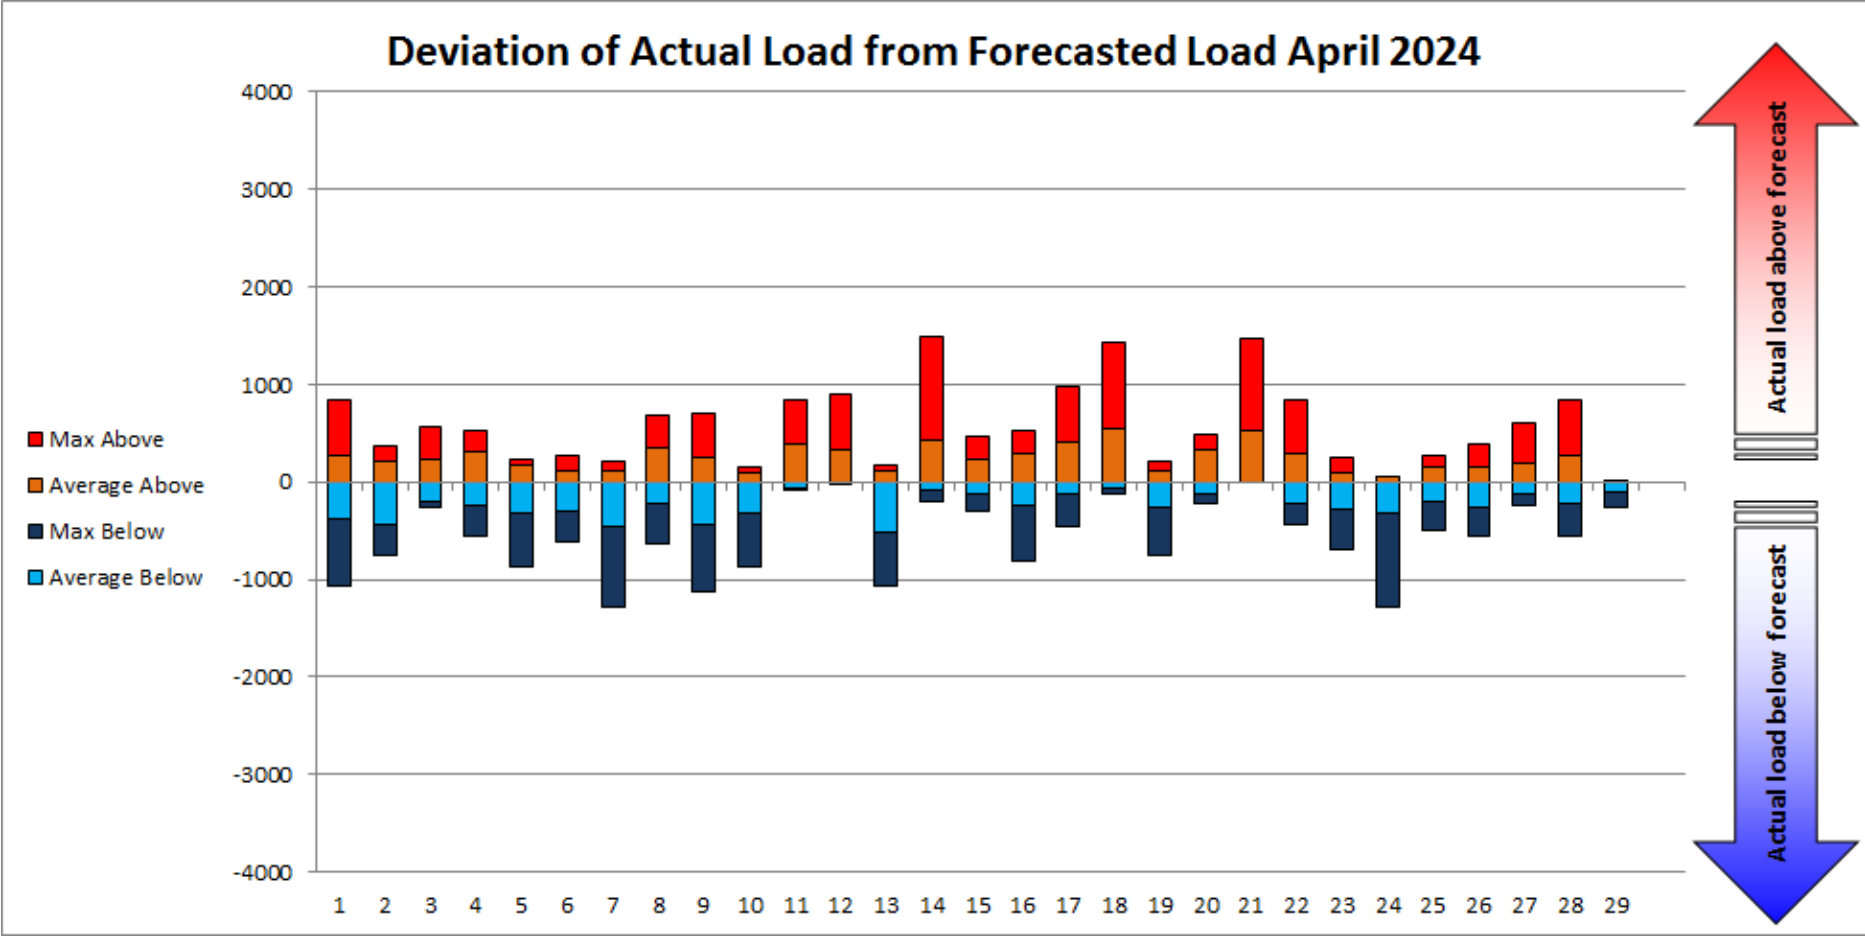


Wind Power Forecast Error Statistics: Medium and Long Term Forecasts MAE

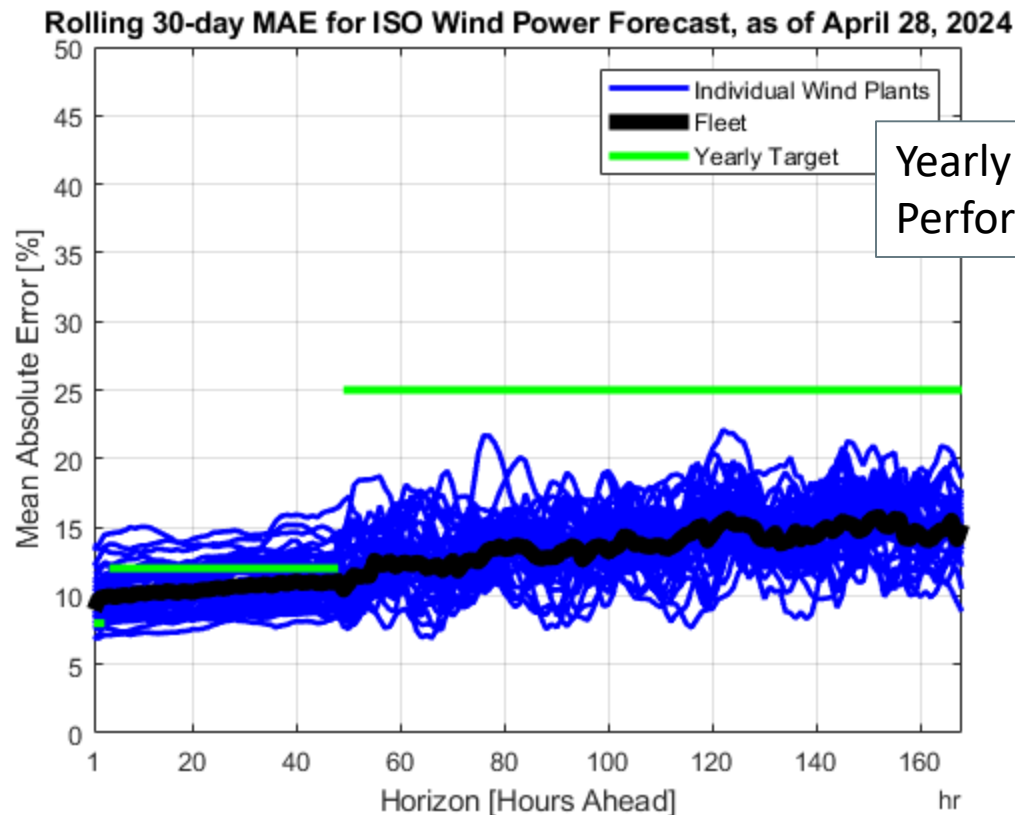

Ideally, MAE and Bias would be both equal to zero. As is typical, MAE increases with the forecast horizon. MAE and Bias for the fleet of wind power resources are less due to offsetting errors. Across all time frames, the ISO-NE/DNV forecast is very good compared to industry standards; and except for lookahead horizon hour 1, monthly MAE is within the yearly performance targets.

Wind Power Forecast Error Statistics: Medium and Long Term Forecasts Bias

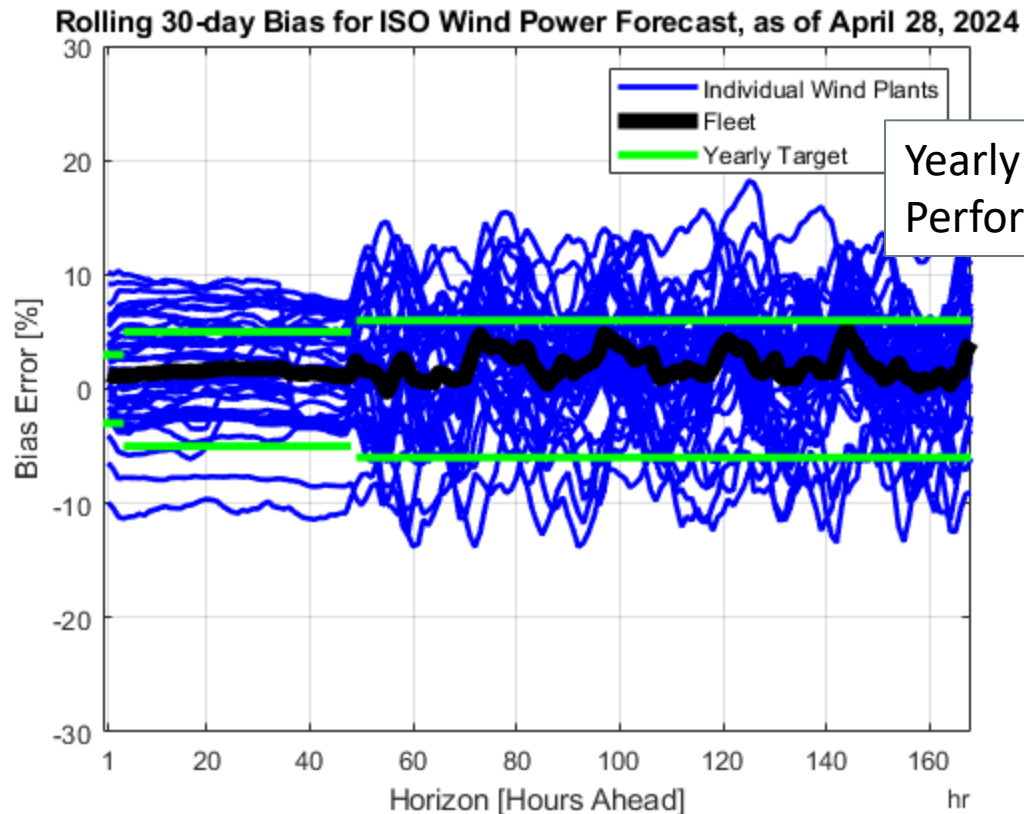


Dashboard Indicator

Yearly Fleet Performance targets

Ideally, MAE and Bias would be both equal to zero. Positive bias means less windpower was actually available compared to forecast. Negative bias means more windpower was actually available compared to forecast. Across all time frames, the ISO-NE/DNV forecast compares well with industry standards, and monthly Bias is within yearly performance targets.


Wind Power Forecast Error Statistics: Short Term Forecast MAE

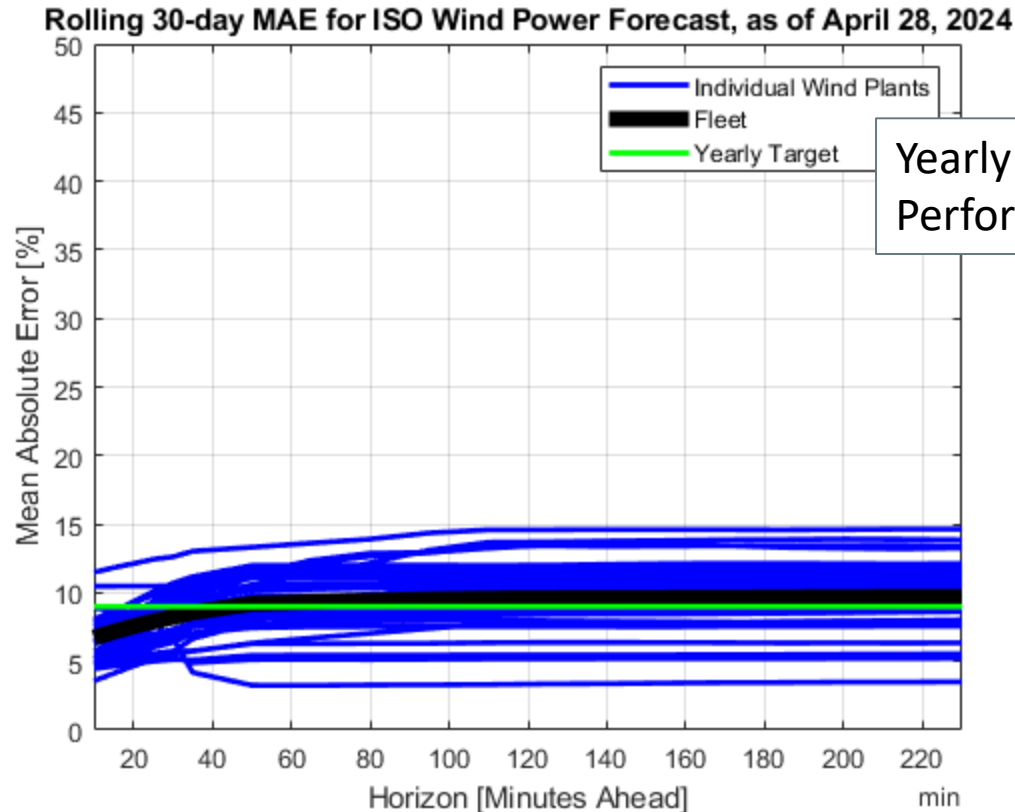

Dashboard Indicator 

Ideally, MAE and Bias would be both equal to zero. As is typical, MAE increases with the forecast horizon. MAE and Bias for the fleet of wind power resources are less due to offsetting errors. Across all time frames, the forecast compares well with industry standards. After the 45 minute lookahead horizon, monthly MAE is just outside of yearly performance targets.

Wind Power Forecast Error Statistics: Short Term Forecast Bias

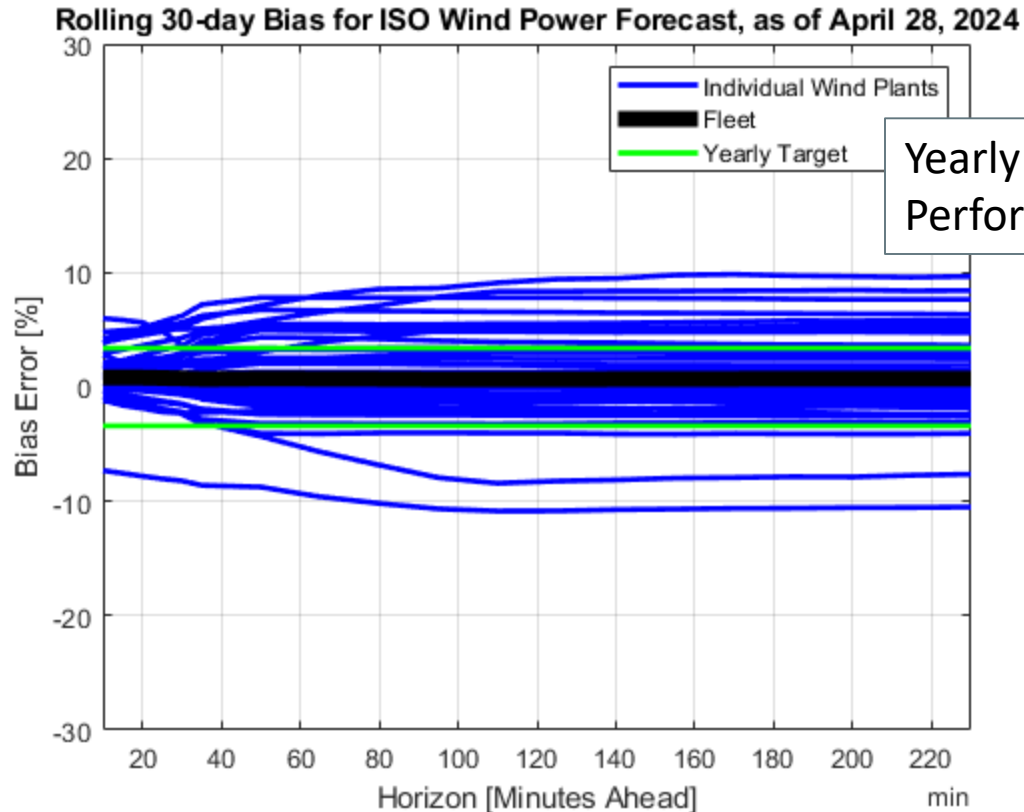

Dashboard Indicator 

Ideally, MAE and Bias would be both equal to zero. Positive bias means less windpower was actually available compared to forecast. Negative bias means more windpower was actually available compared to forecast. Across all time frames, the ISO-NE/DNV forecast compares well with industry standards, and monthly Bias is within yearly performance.


MARKET OPERATIONS

SUPPLY AND DEMAND VOLUMES




DA Cleared Native Load by Composition Compared to Native RT Load

Daily Average MW

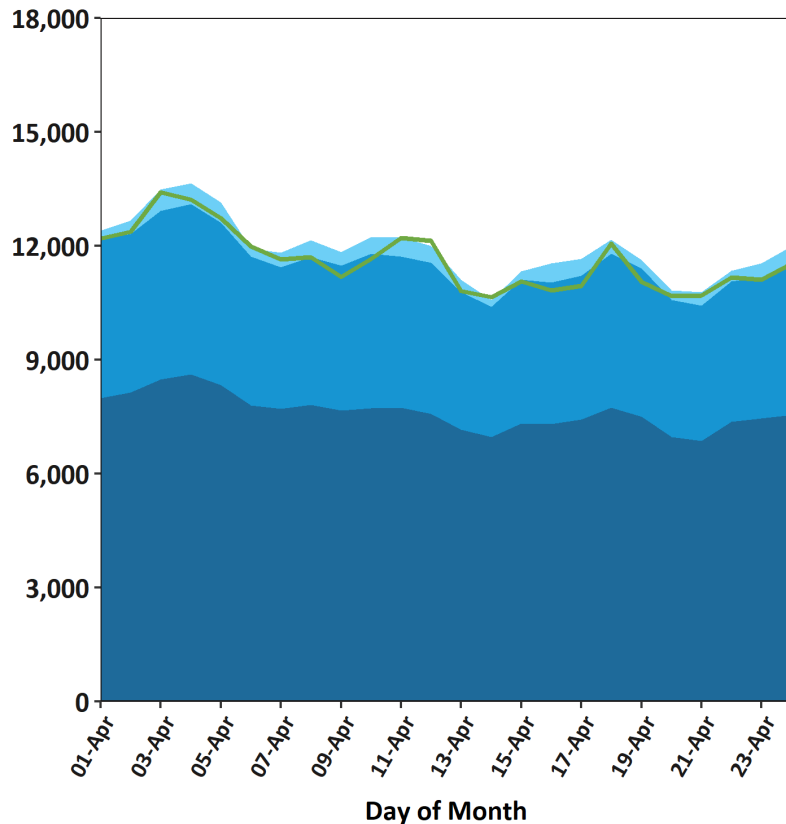

Monthly Average MW

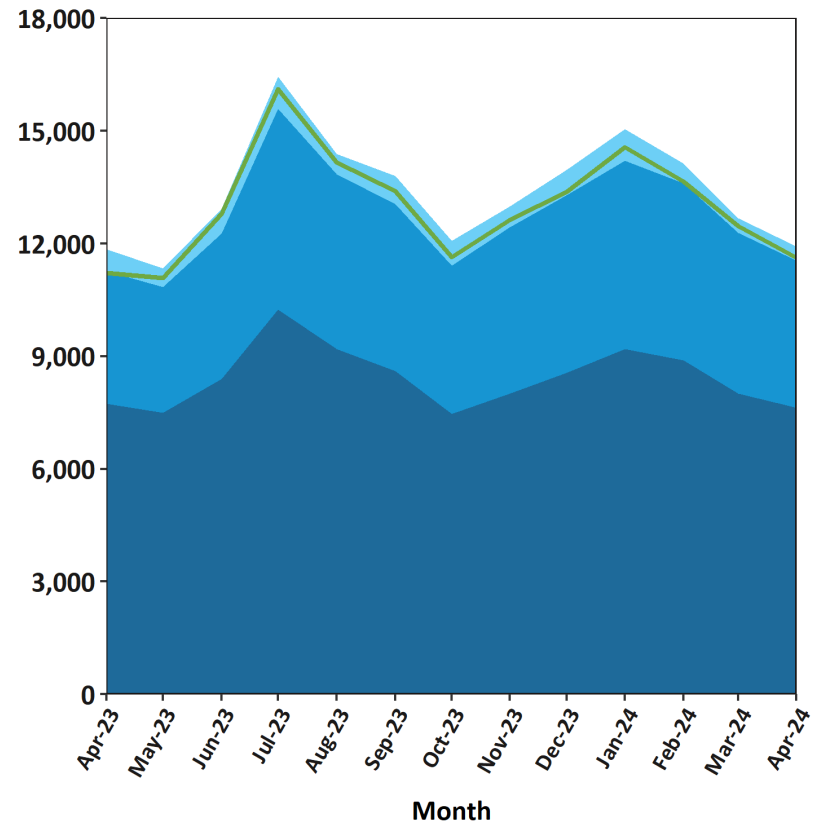


■ DA Fixed Price
 ■ DA Price Sensitive
 ■ Native DALO
 — Native RTLO

■ DA Fixed Price
 ■ DA Price Sensitive
 ■ Native DALO
 — Native RTLO


Native Day-Ahead Load Obligation (DALO) is the sum of all day-ahead cleared load, excluding modeled transmission losses and exports
 Native Real-Time Load Obligation (RTLO) is the sum of all real-time load, excluding exports

DA Volumes as % of Forecast in Peak Hour

Daily: This Month

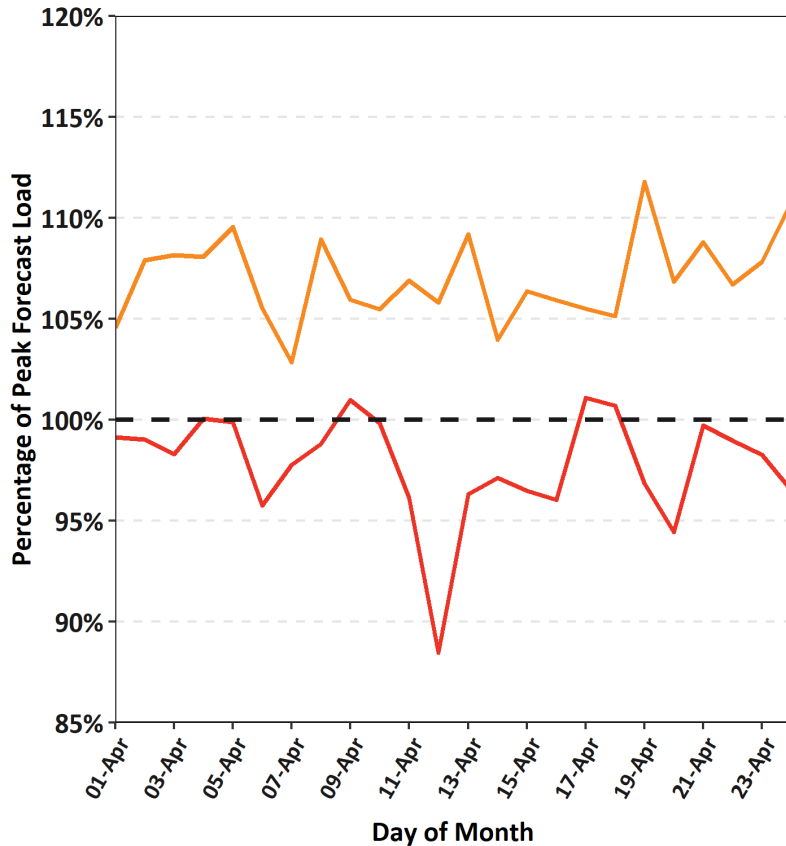

Monthly, Last 13 Months

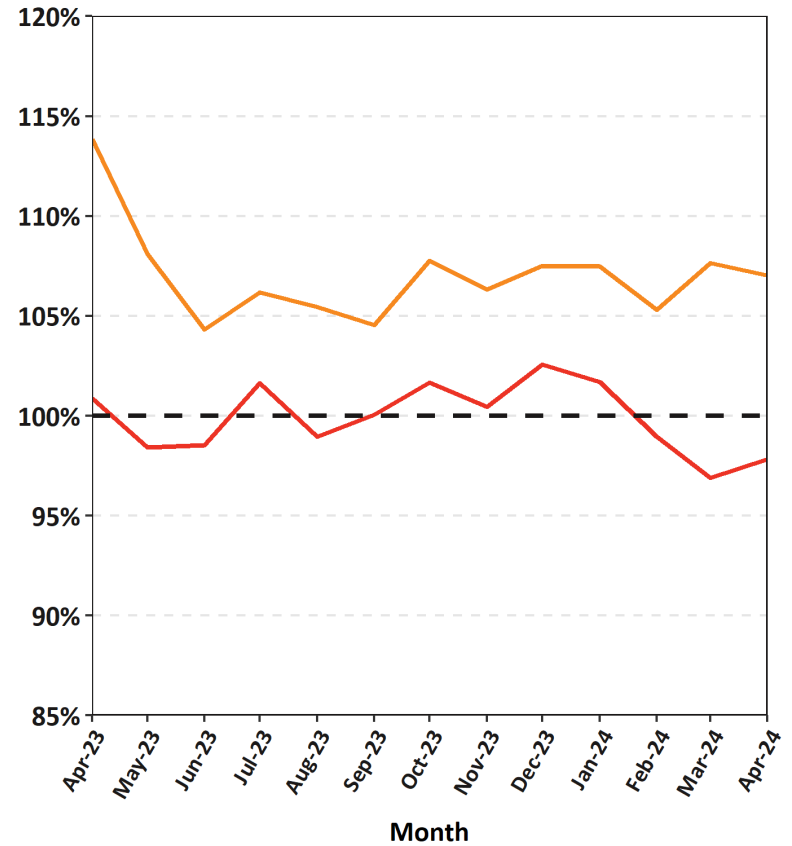



— DA Cleared Physical Energy — DALO — 100% Line

— DA Cleared Physical Energy — DALO — 100% Line



The number of system-level manual supplemental commitments for capacity required during the Reserve Adequacy Assessment (RAA) period during the month was: [none](#)

Resource Mix

Daily Average MW


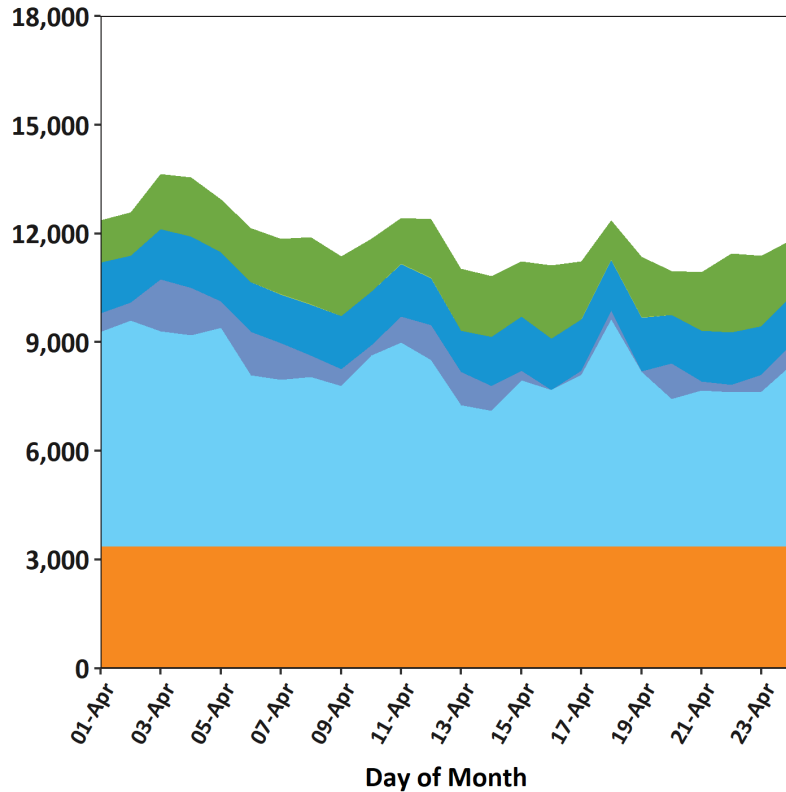


Monthly Average MW


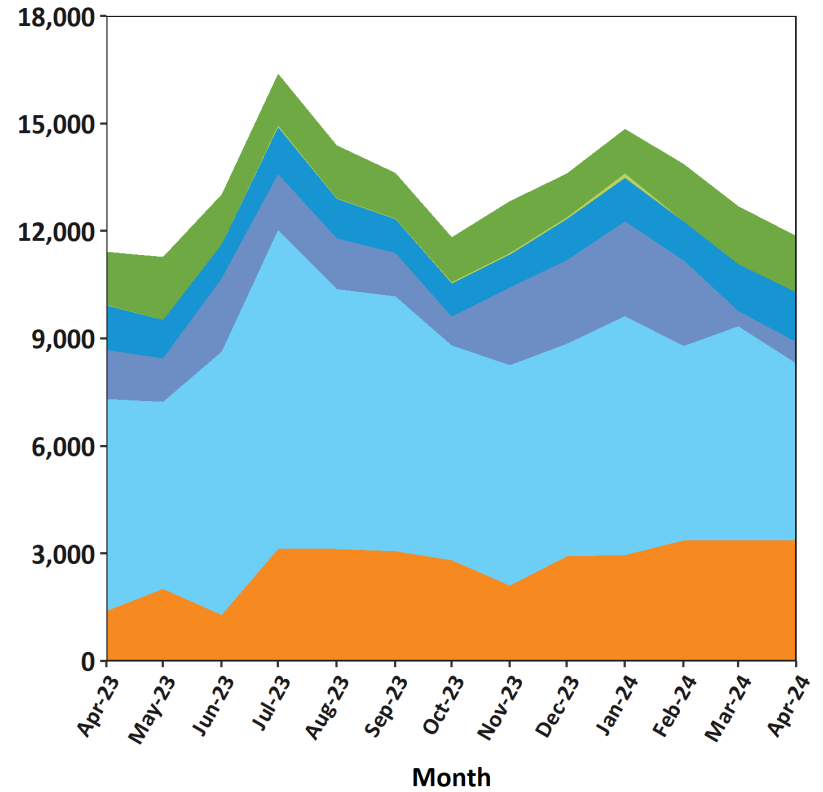


Renewable Generation by Fuel Type

Daily Average MW

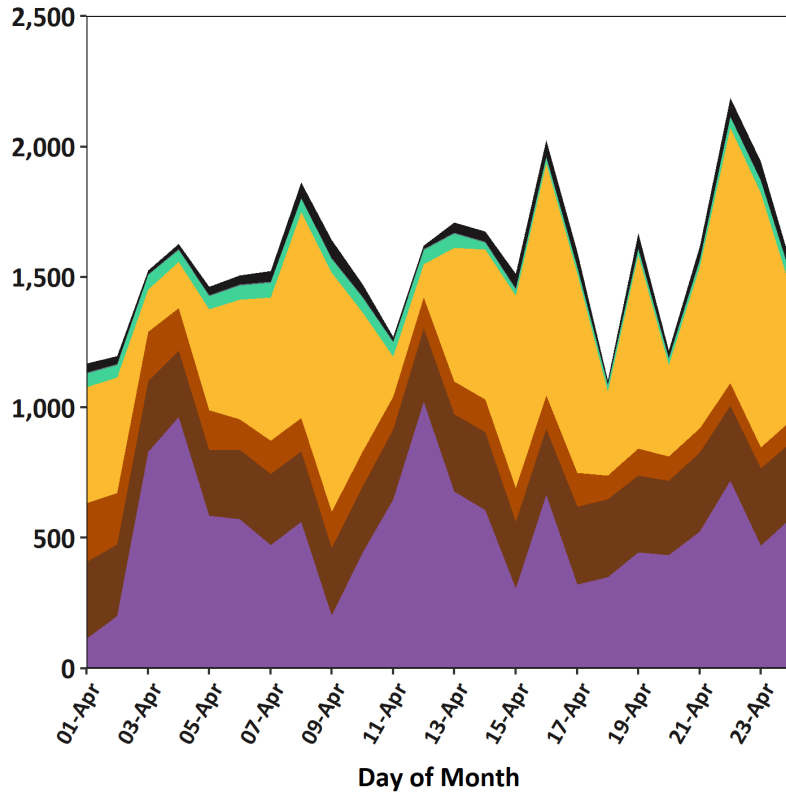

Monthly Average MW

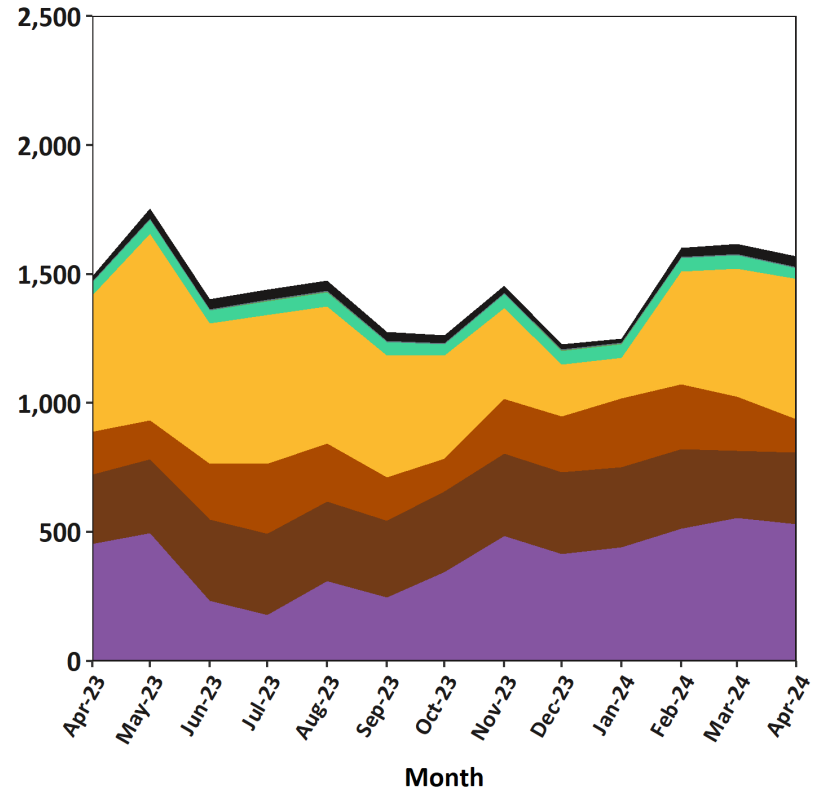


CSF = Continuous Storage Facilities (a.k.a. Batteries)




RT Net Interchange

Average Daily Net Interchange MW

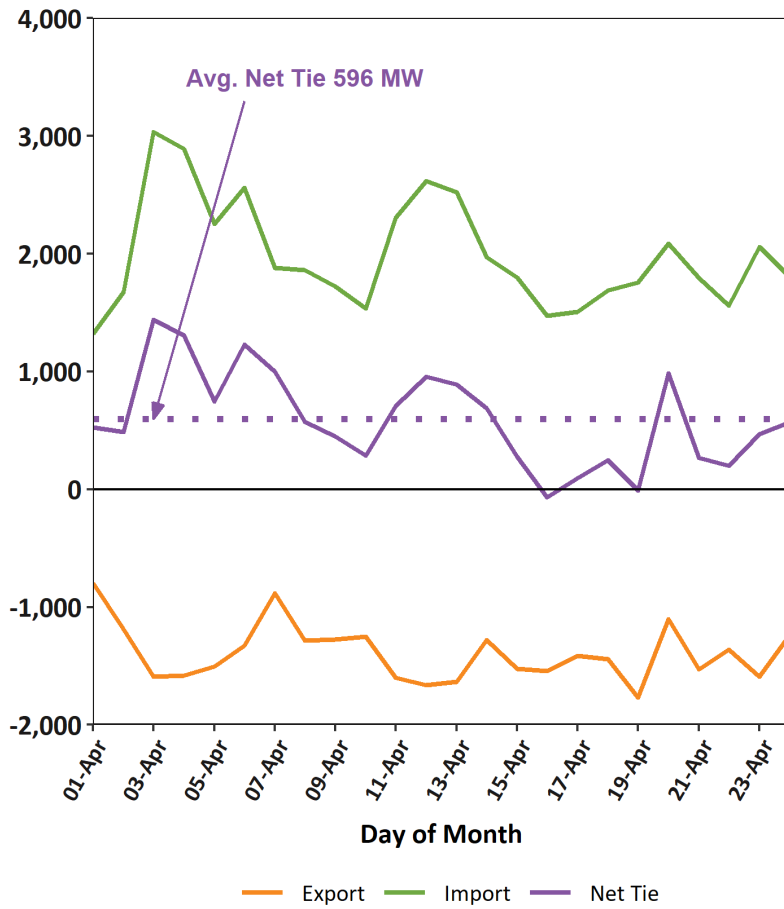


Average Monthly Net Interchange MW

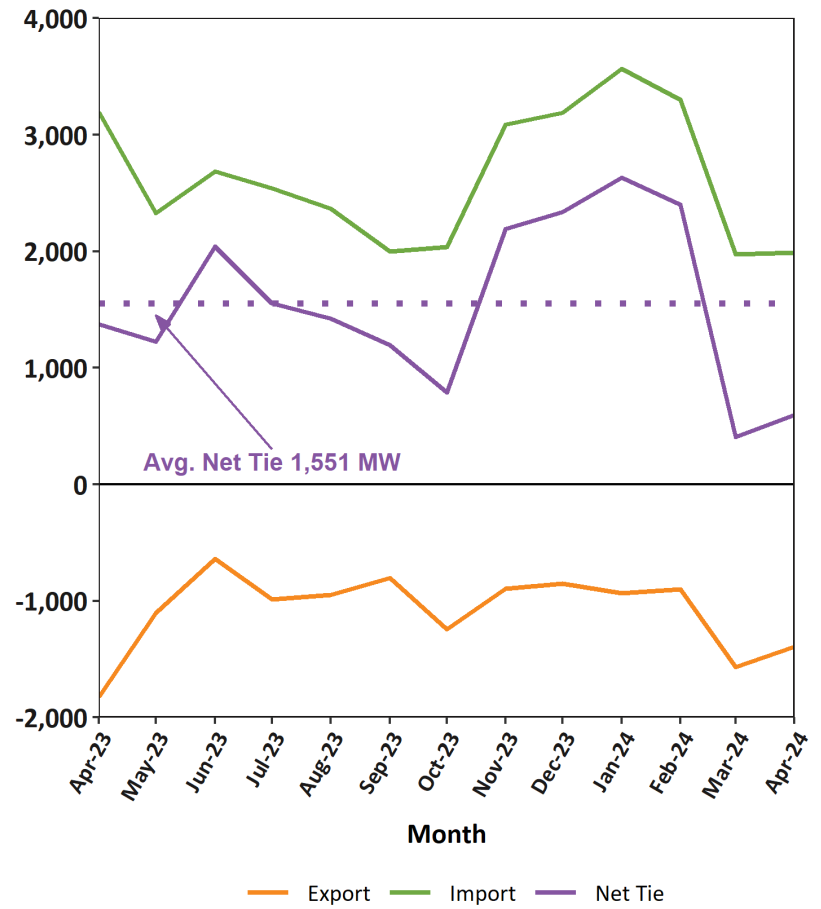

Net Interchange is the participant sum of daily imports minus the sum of daily exports; positive values are net imports


RQM System Peak Load MW by Month

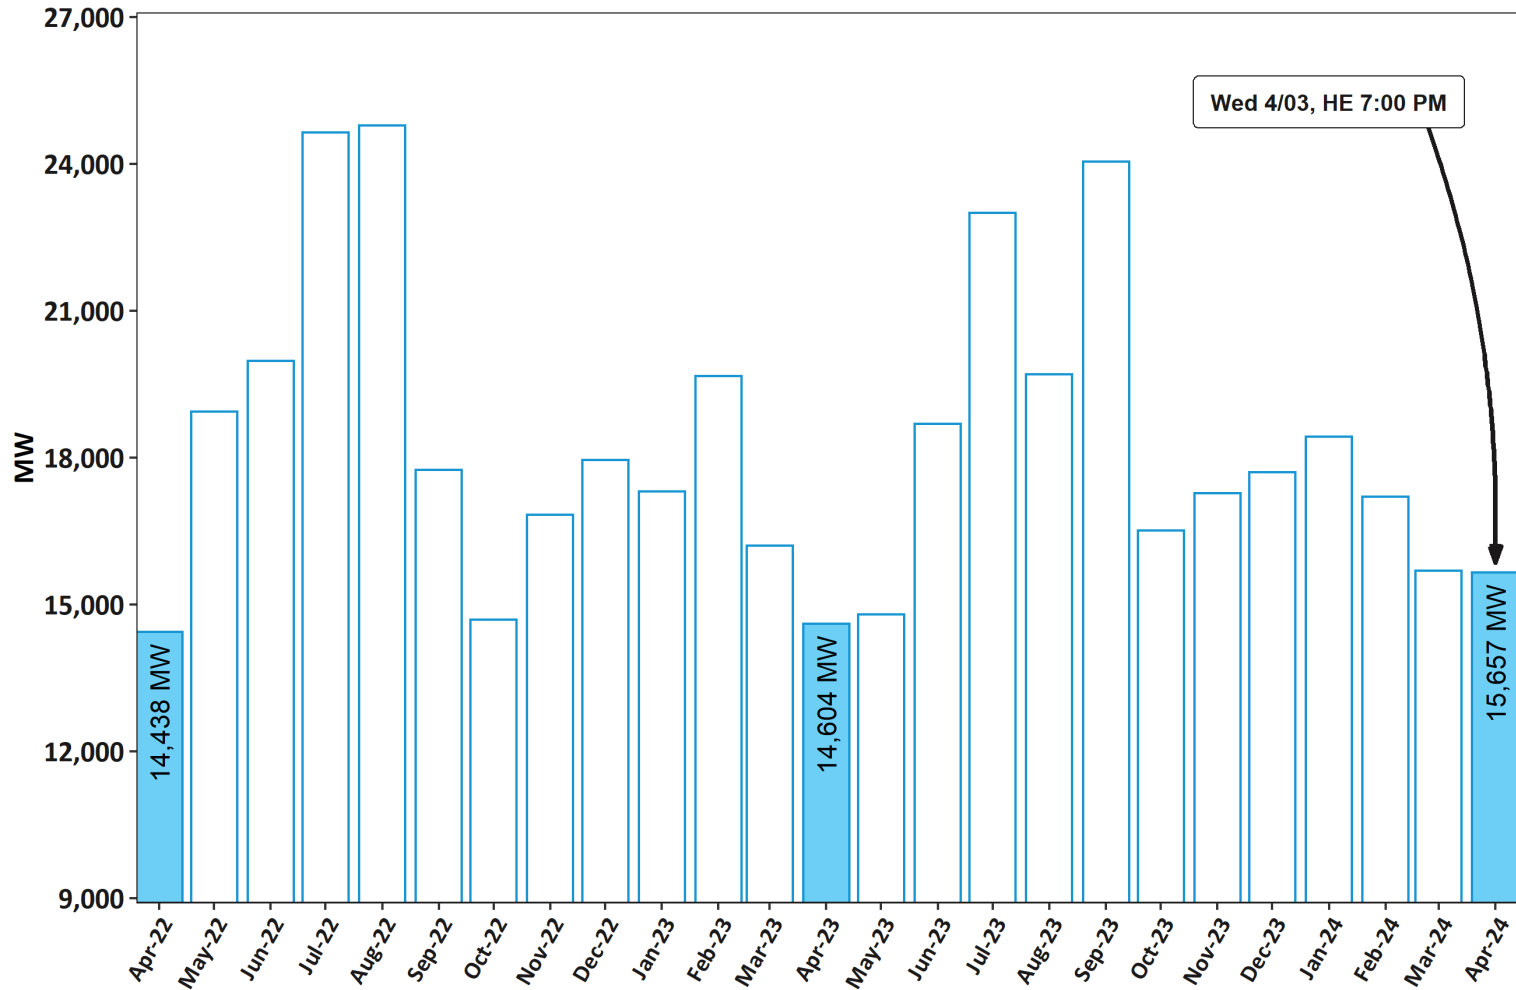


Shaded columns reflect current month and the same month the last 2 years

Monthly Recorded Net Energy for Load (NEL) and Weather Normalized NEL

Net Energy for Load (NEL)

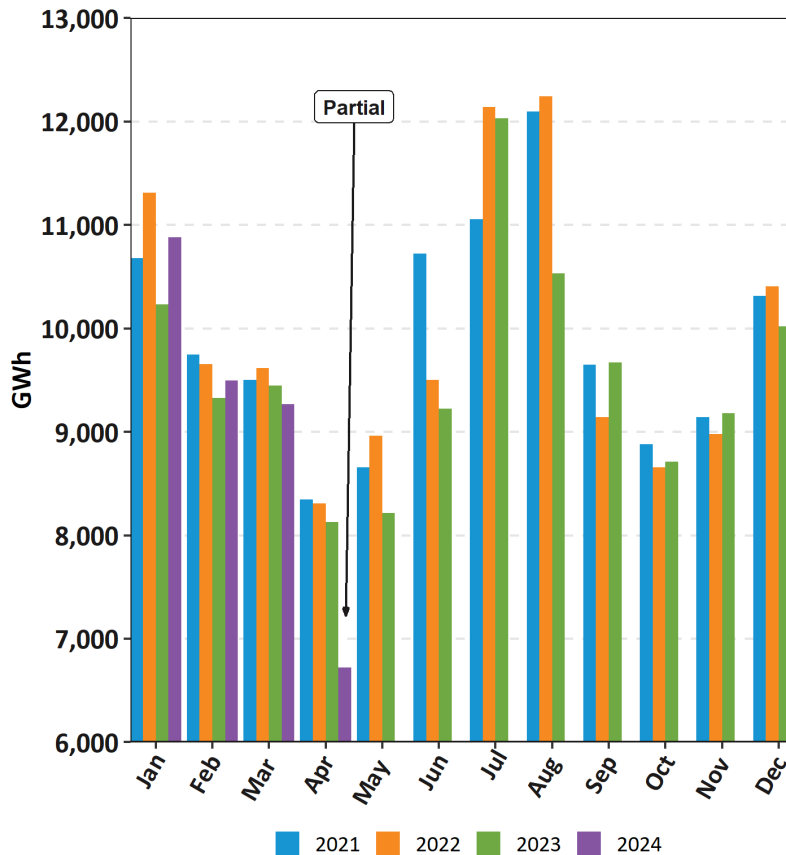


Weather Normalized NEL

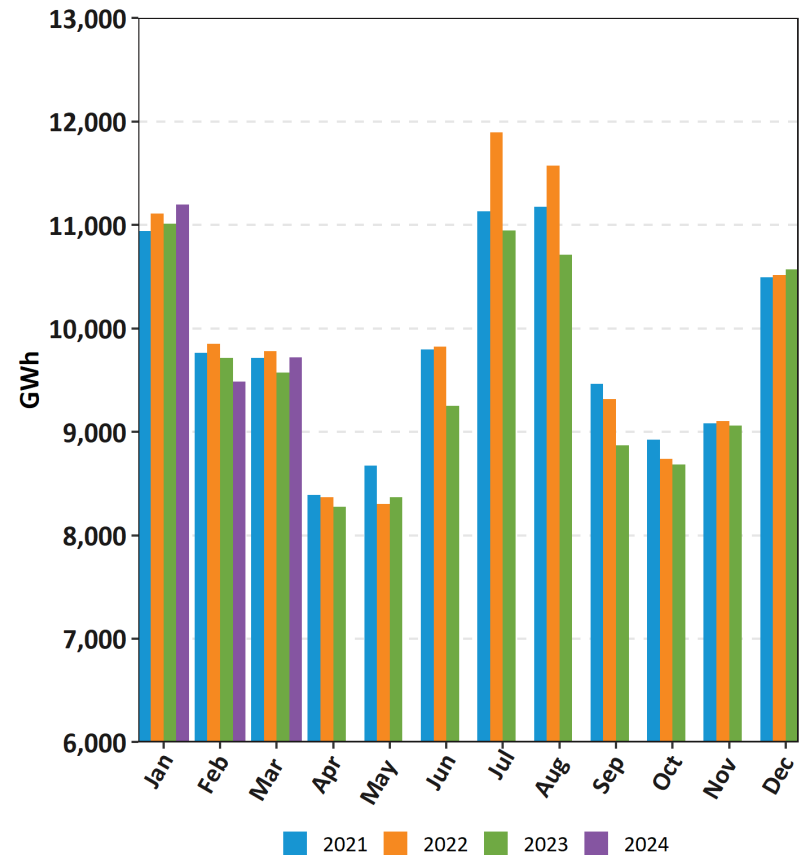


NEPOOL NEL is the total net revenue quality metered energy required to serve load and is analogous to 'RT system load.' NEL is calculated as: Generation + Demand Response Resource output - pumping load + net interchange where imports are positively signed. Current month's data may be preliminary. Weather normalized NEL is typically reported on a one-month lag.

DA Cleared Physical Energy Difference from RT System Load at Forecasted Peak Hour

Daily: This Month


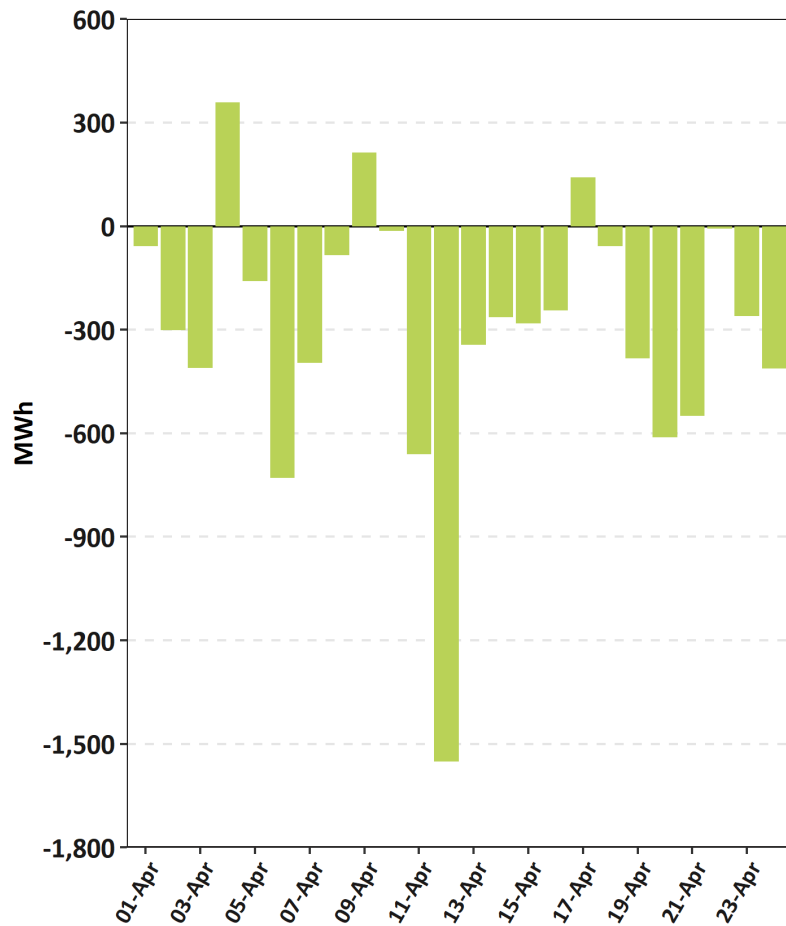


Monthly, Last 13 Months

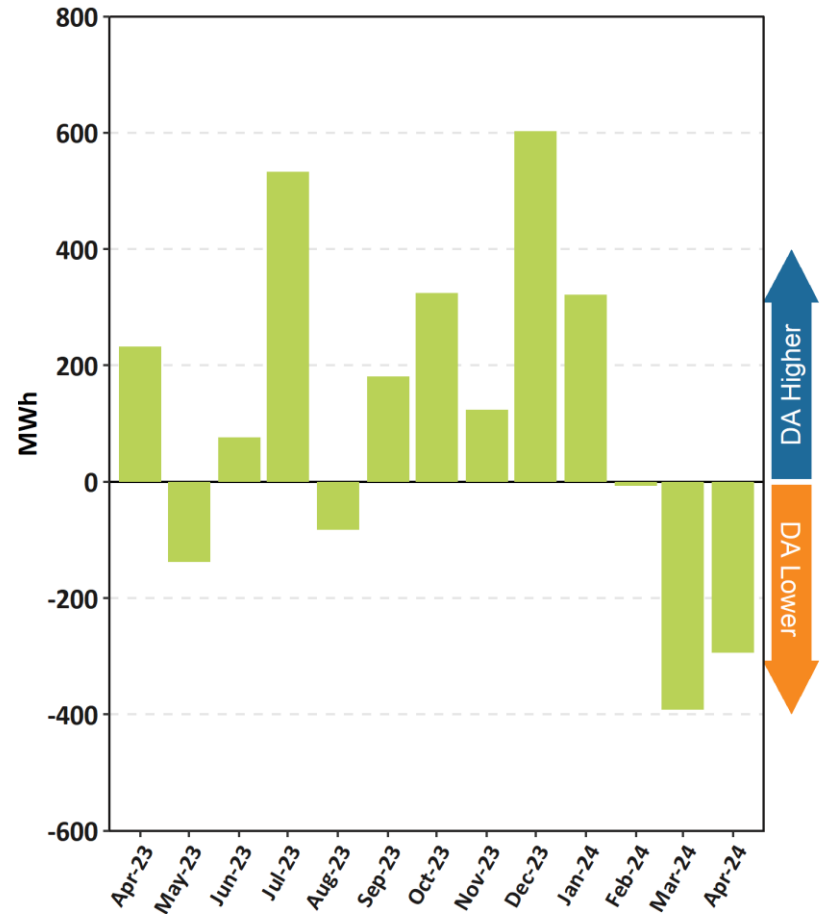

Negative values indicate DA Cleared Physical Energy value below its RT counterpart.

Capacity Surplus* Cleared in the DA Market Relative to Forecasted Peak-Hour Requirements

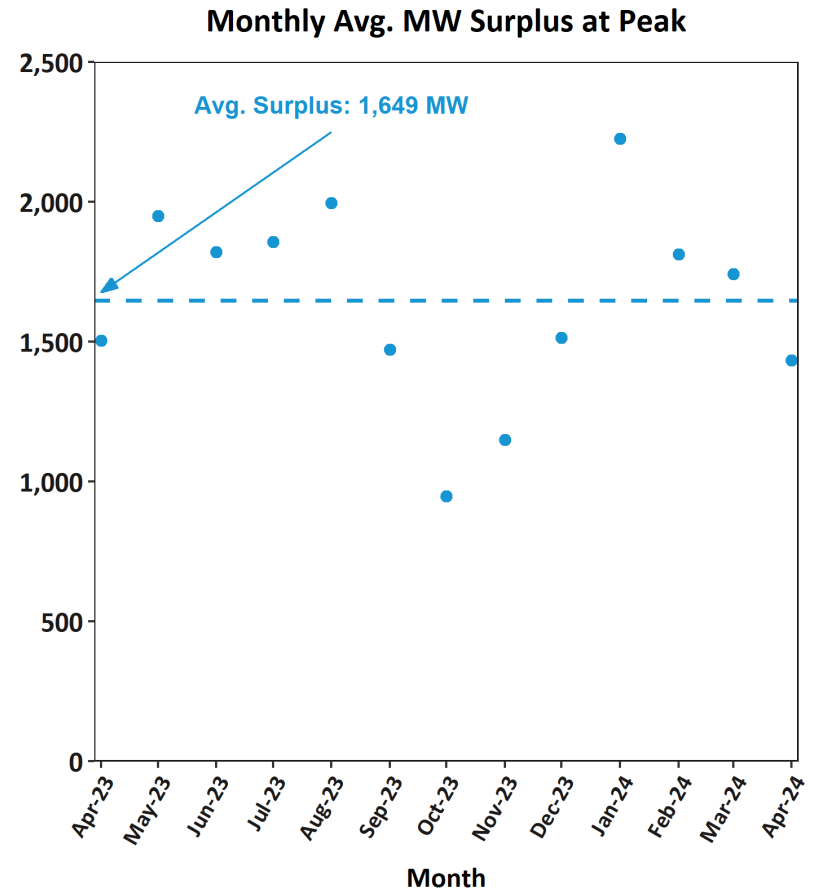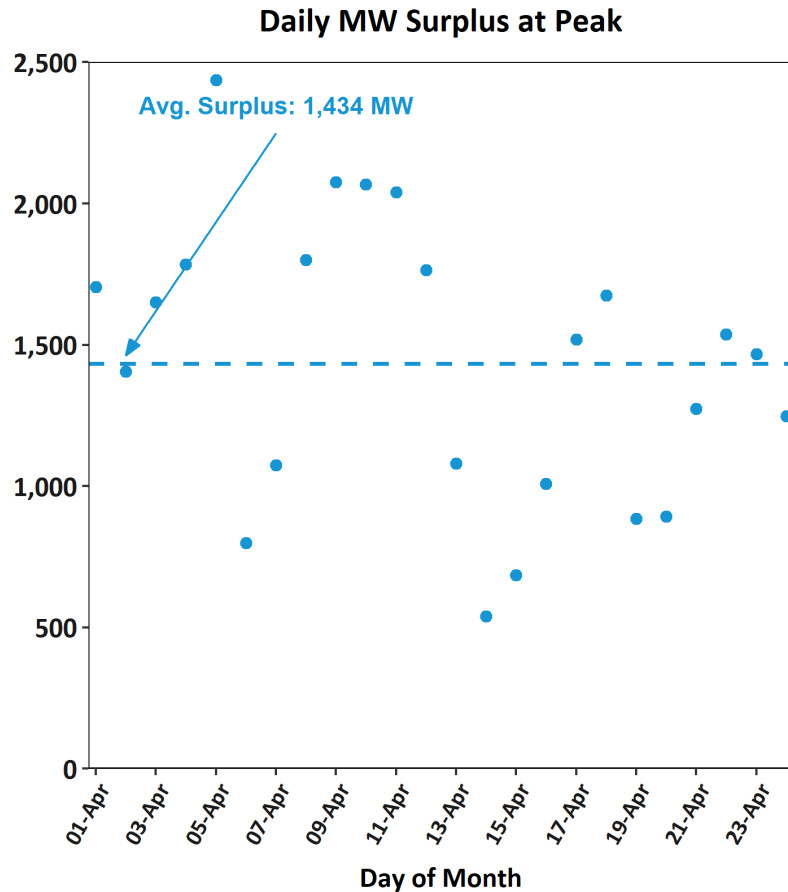


● Surplus at Fcst Peak — Average

● Surplus at Fcst Peak — Average

*DA capacity surplus includes DA offered ECO max above cleared amounts for cleared resources + offered reserves from available non-cleared resources + DA scheduled net interchange, reflected for the peak hour

RT Generation Output Offered as Must Run vs Dispatchable

Participant Must Run Supply as % of Total Generation

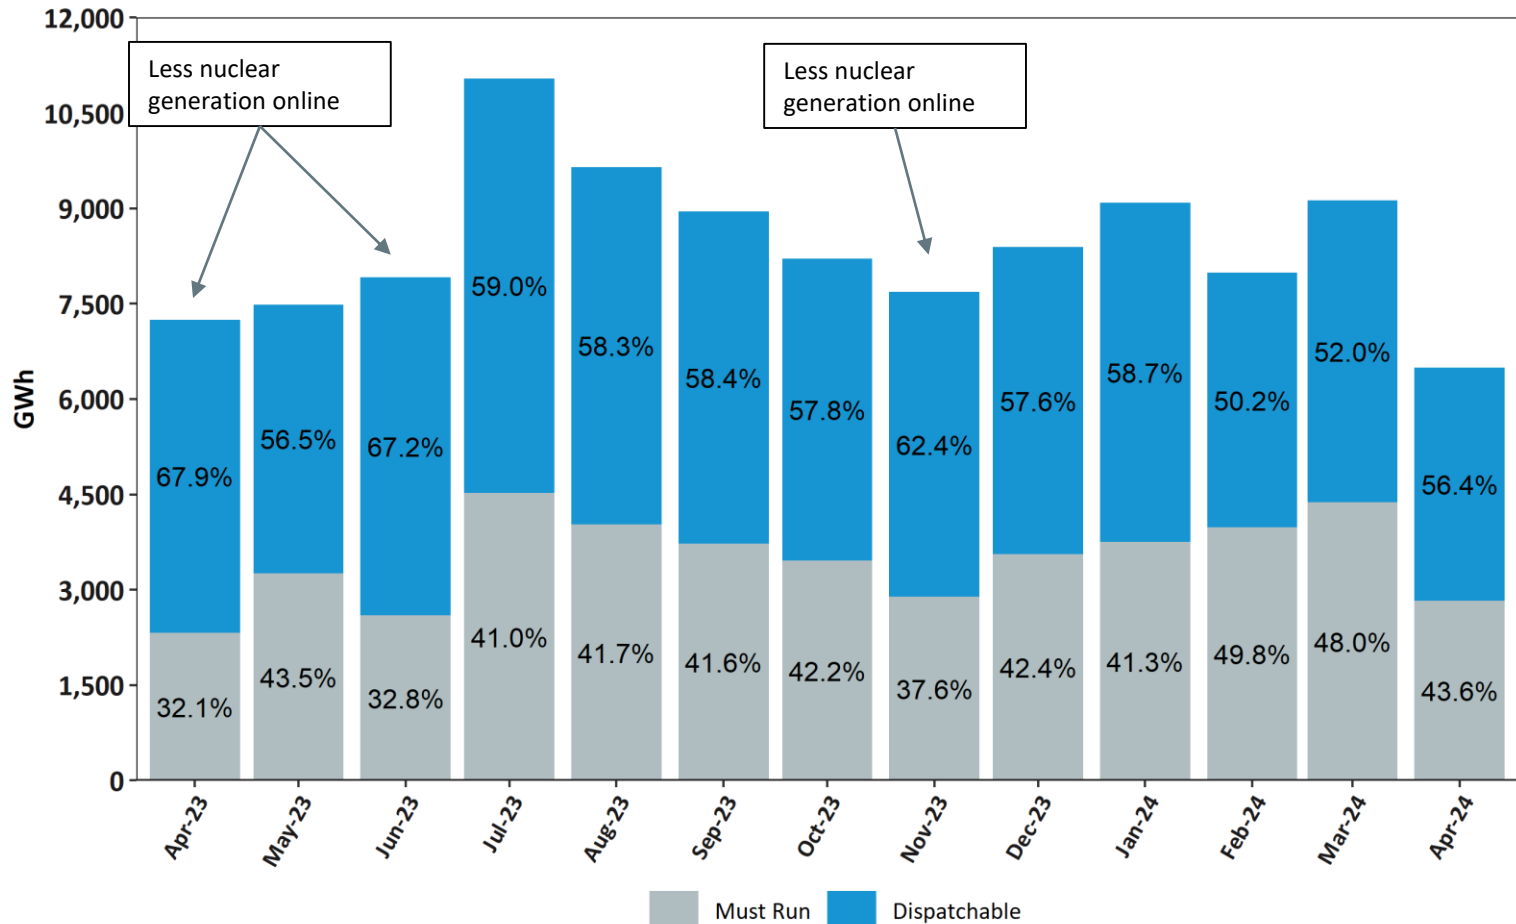

Includes generation and DRR. Must Run (non-dispatchable) category reflects full output of settlement-only generation (SOG) as well as must run offers from modeled units

MARKET PRICING


DA vs. RT LMPs (\$/MWh)

Arithmetic Average


Year 2023	Hub	ME	NH	VT	CT	RI	SEMA	WCMA	NEMA
Day-Ahead	\$85.59	\$84.20	\$85.77	\$84.48	\$84.07	\$85.39	\$86.05	\$85.69	\$86.12
Real-Time	\$84.89	\$83.06	\$85.05	\$83.64	\$83.80	\$84.69	\$85.35	\$84.97	\$85.40
RT Delta %	-0.82%	-1.35%	-0.84%	-0.99%	-0.32%	-0.82%	-0.81%	-0.84%	-0.84%
Year 2022	Hub	ME	NH	VT	CT	RI	SEMA	WCMA	NEMA
Day-Ahead	\$37.04	\$36.59	\$37.22	\$36.78	\$36.25	\$36.89	\$37.34	\$37.07	\$37.35
Real-Time	\$35.91	\$35.36	\$36.05	\$35.55	\$35.26	\$35.71	\$36.17	\$35.92	\$36.21
RT Delta %	-0.82%	-1.35%	-0.84%	-0.99%	-0.32%	-0.82%	-0.81%	-0.84%	-0.84%

April-23	Hub	ME	NH	VT	CT	RI	SEMA	WCMA	NEMA
Day-Ahead	\$28.79	\$28.42	\$28.81	\$28.18	\$28.52	\$28.53	\$28.85	\$28.83	\$28.96
Real-Time	\$27.25	\$26.60	\$27.23	\$26.61	\$27.04	\$26.99	\$27.30	\$27.27	\$27.43
RT Delta %	-5.35%	-6.40%	-5.48%	-5.57%	-5.19%	-5.40%	-5.37%	-5.41%	-5.28%
April-24	Hub	ME	NH	VT	CT	RI	SEMA	WCMA	NEMA
Day-Ahead	\$25.93	\$25.09	\$25.85	\$25.73	\$25.34	\$25.93	\$26.16	\$25.92	\$26.09
Real-Time	\$25.27	\$24.24	\$25.20	\$25.05	\$24.78	\$25.15	\$25.44	\$25.26	\$25.42
RT Delta %	-2.55%	-3.39%	-2.51%	-2.64%	-2.21%	-3.01%	-2.75%	-2.55%	-2.57%
Annual Diff.	Hub	ME	NH	VT	CT	RI	SEMA	WCMA	NEMA
Yr over Yr DA	-9.93%	-11.72%	-10.27%	-8.69%	-11.15%	-9.11%	-9.32%	-10.09%	-9.91%
Yr over Yr RT	-7.27%	-8.87%	-7.46%	-5.86%	-8.36%	-6.82%	-6.81%	-7.37%	-7.33%

Hourly DA LMPs, April 1-24, 2024

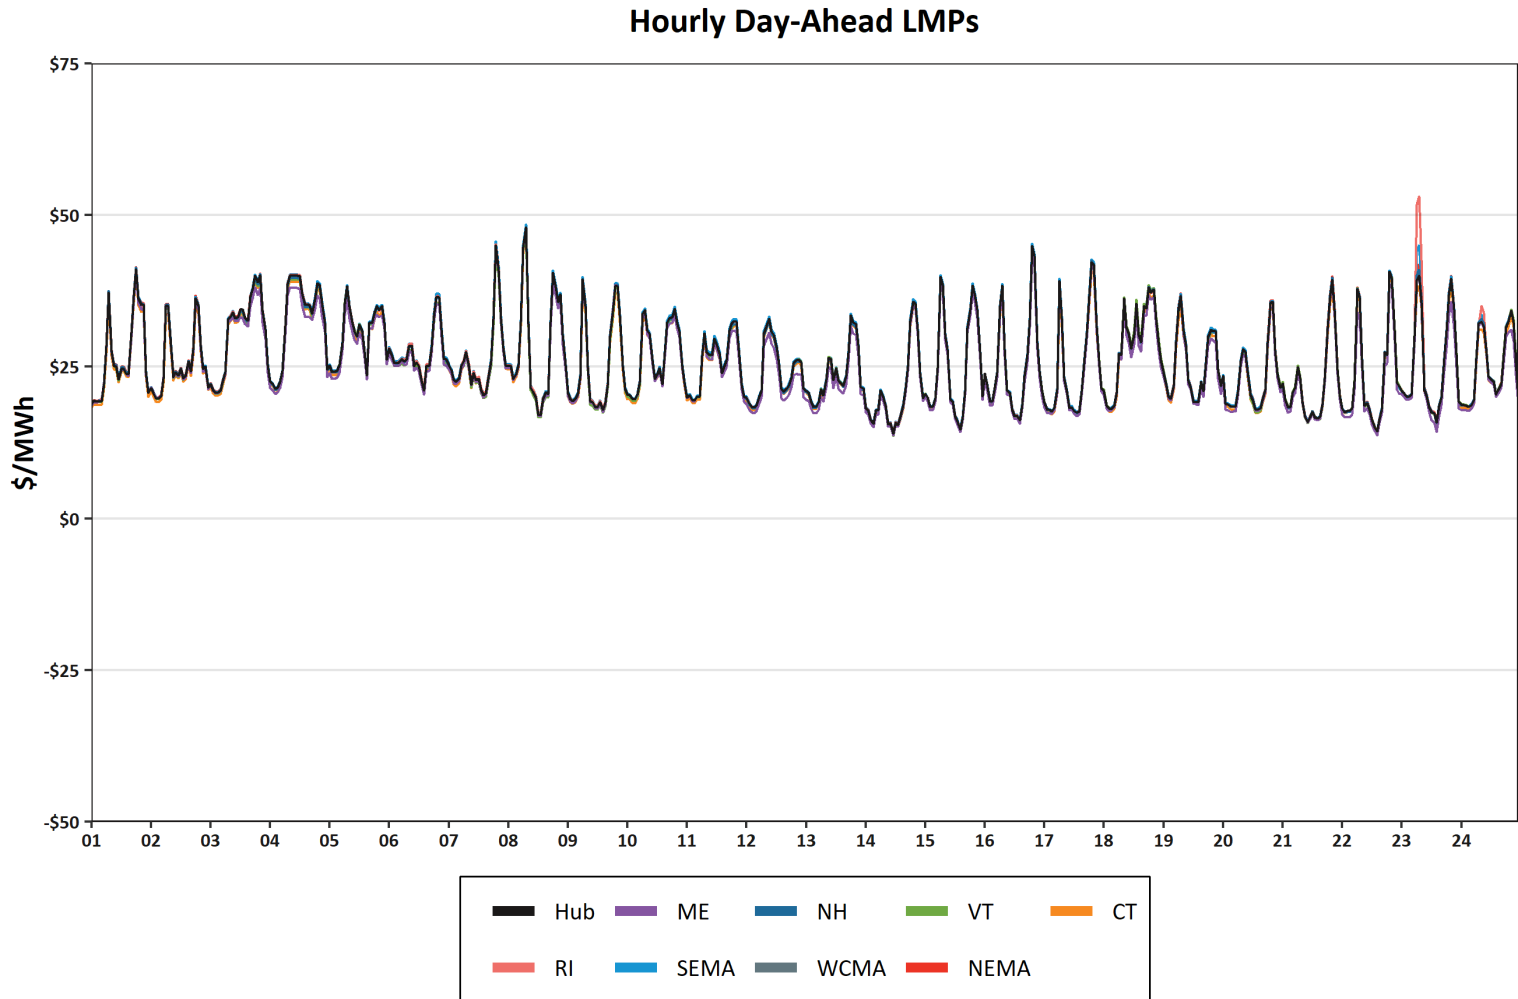


Hourly RT LMPs, April 1-24, 2024

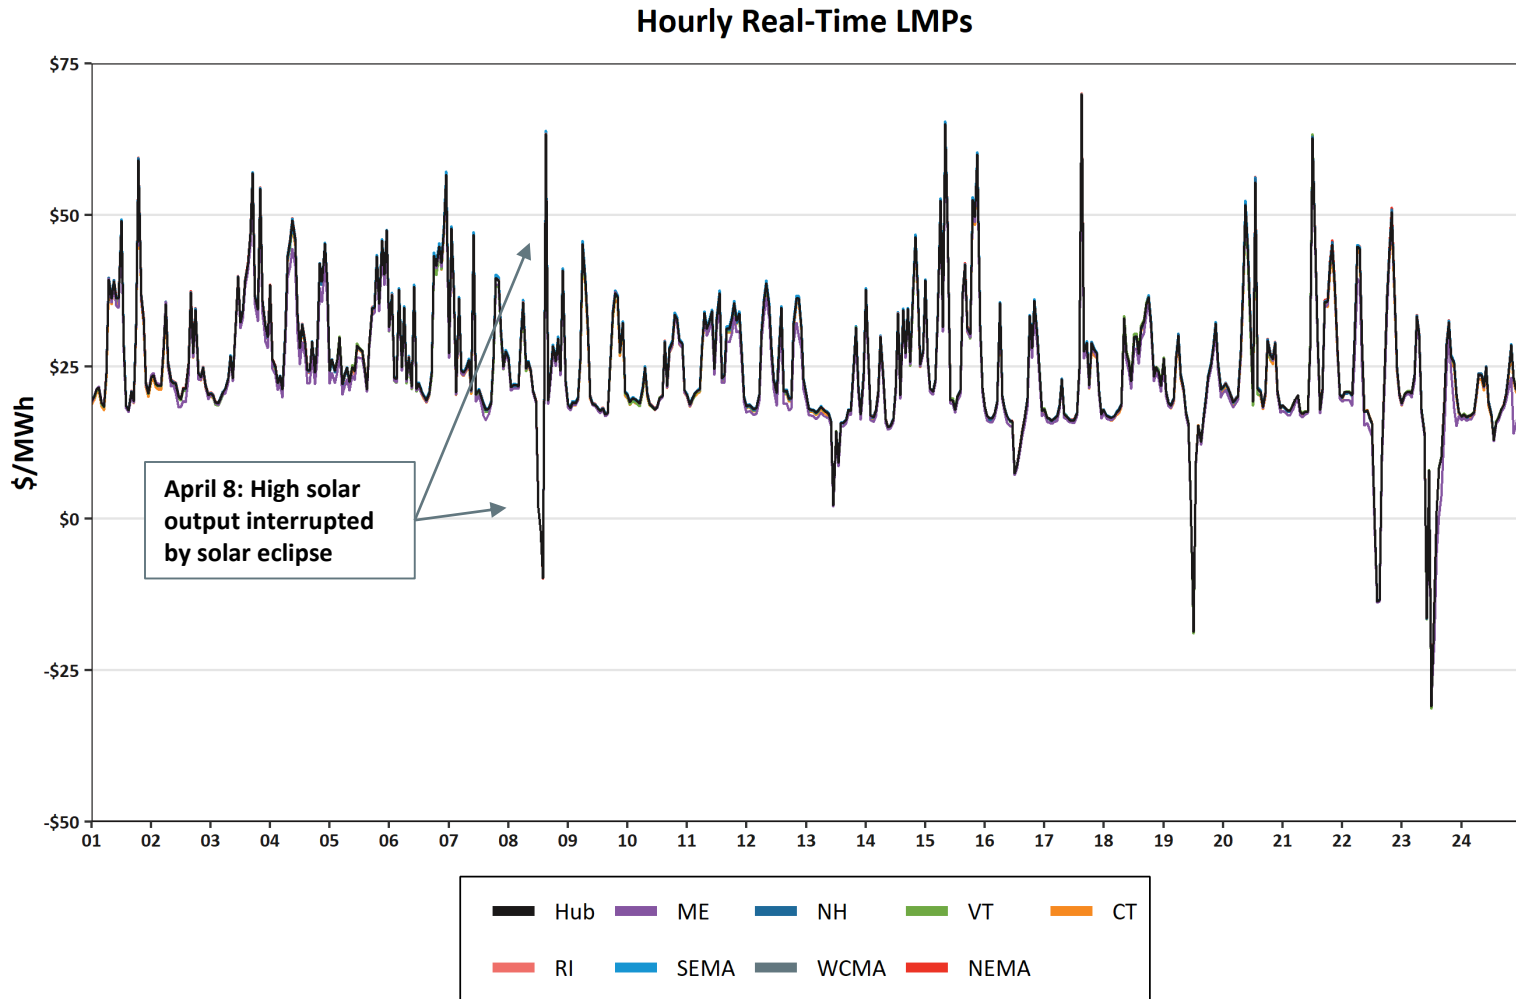


Wholesale Electricity vs Natural Gas Prices by Month

Daily Price

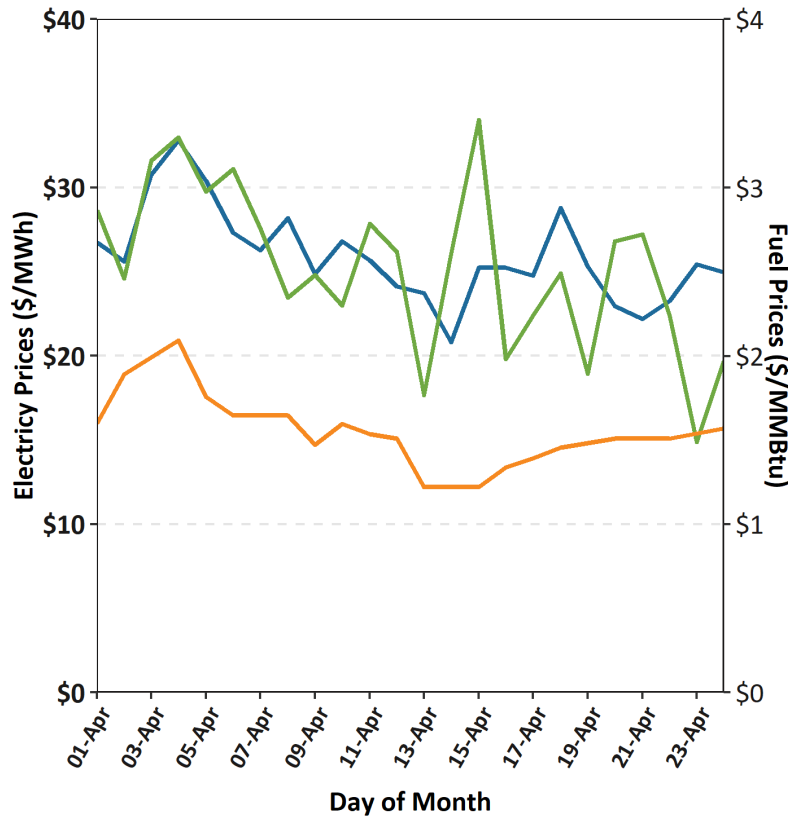

— DA LMP — RT LMP — Natural Gas

Monthly Average Price

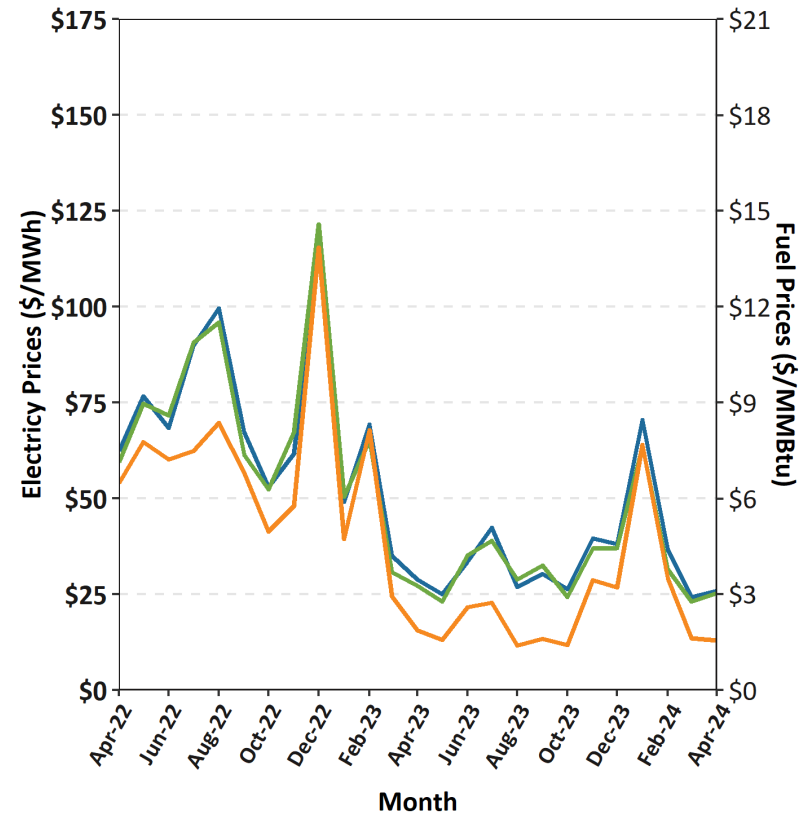

— DA LMP — RT LMP — Natural Gas

Gas price is average of Massachusetts delivery points

Underlying natural gas data furnished by:




New England, NY, and PJM Hourly Average RT Prices by Month

Daily: This Month



Monthly, Last 13 Months

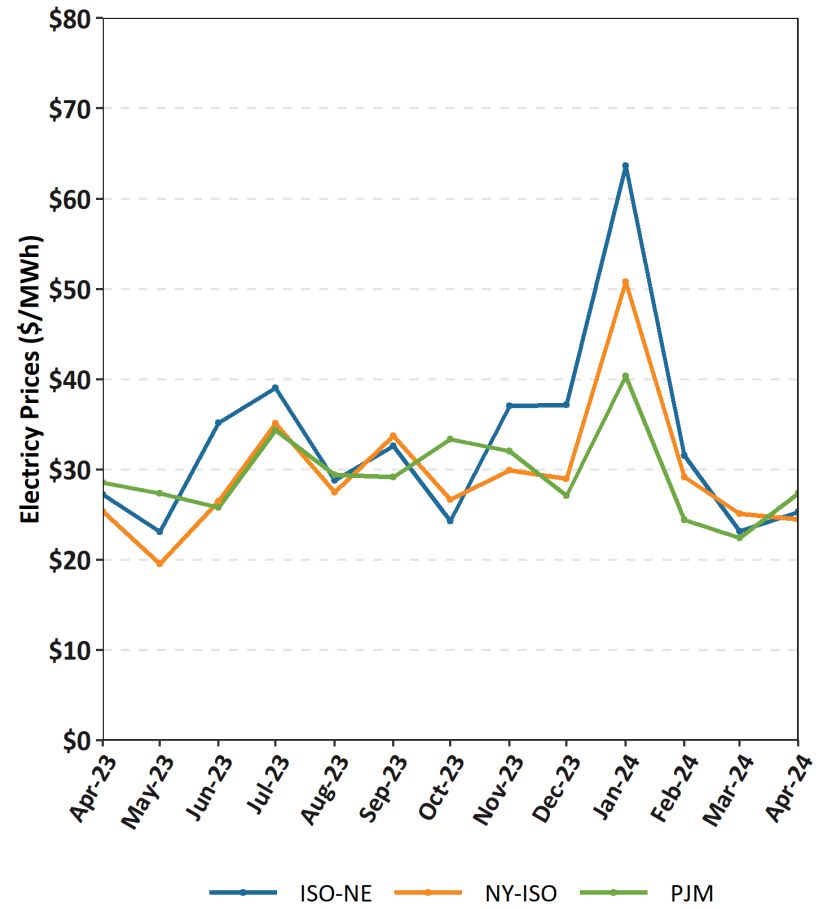


Hourly average prices are shown




New England, NY, and PJM Average Forecasted Peak Hour RT Prices

Daily: This Month

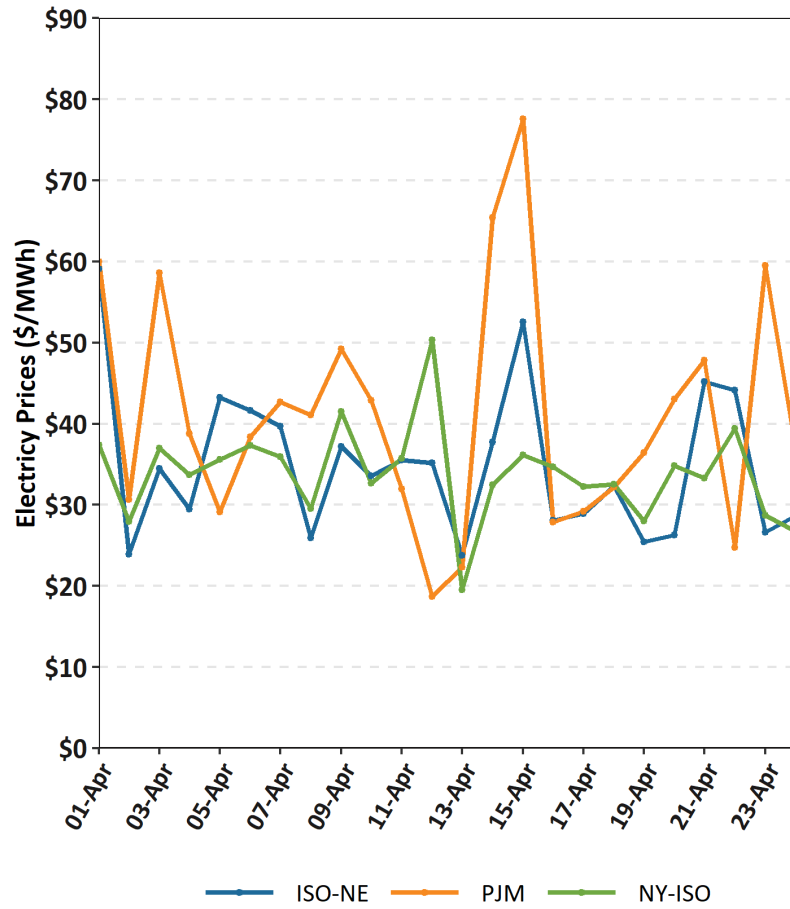


Monthly, Last 13 Months

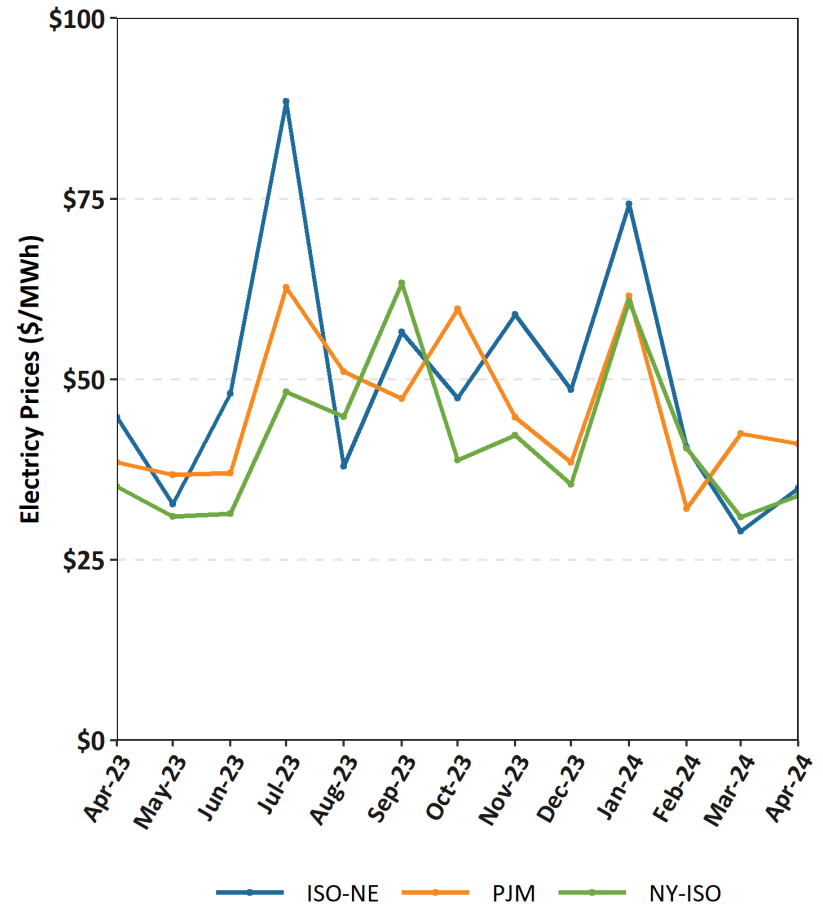


Zonal Increment Offers and Decrement Bid Amounts

April Inc Monthly Totals By Zone

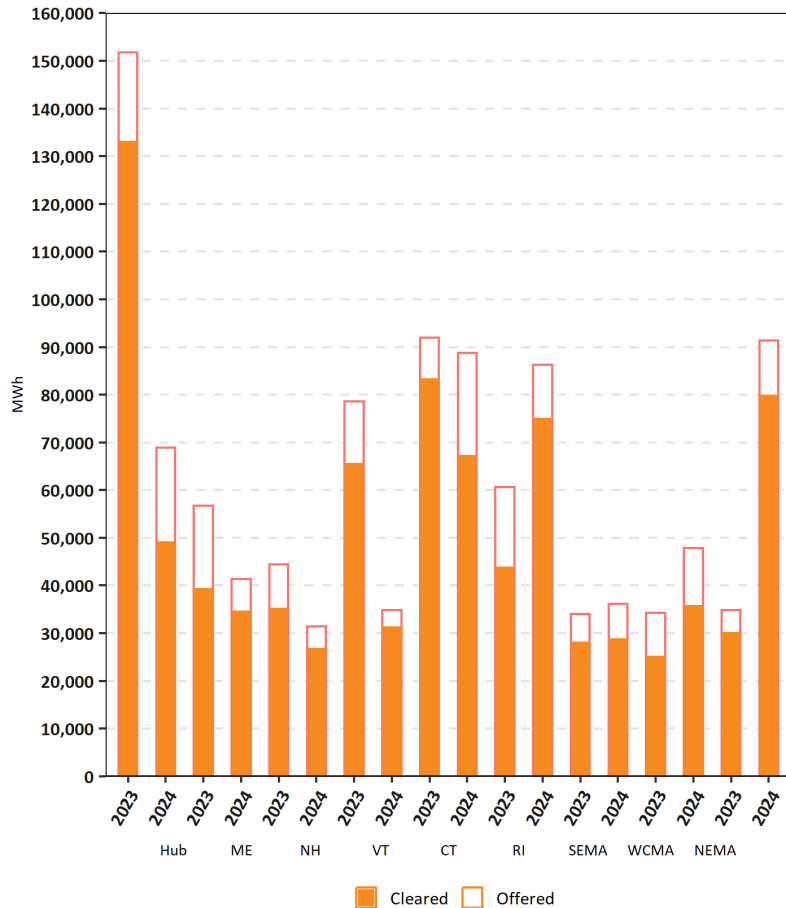

April Dec Monthly Totals By Zone

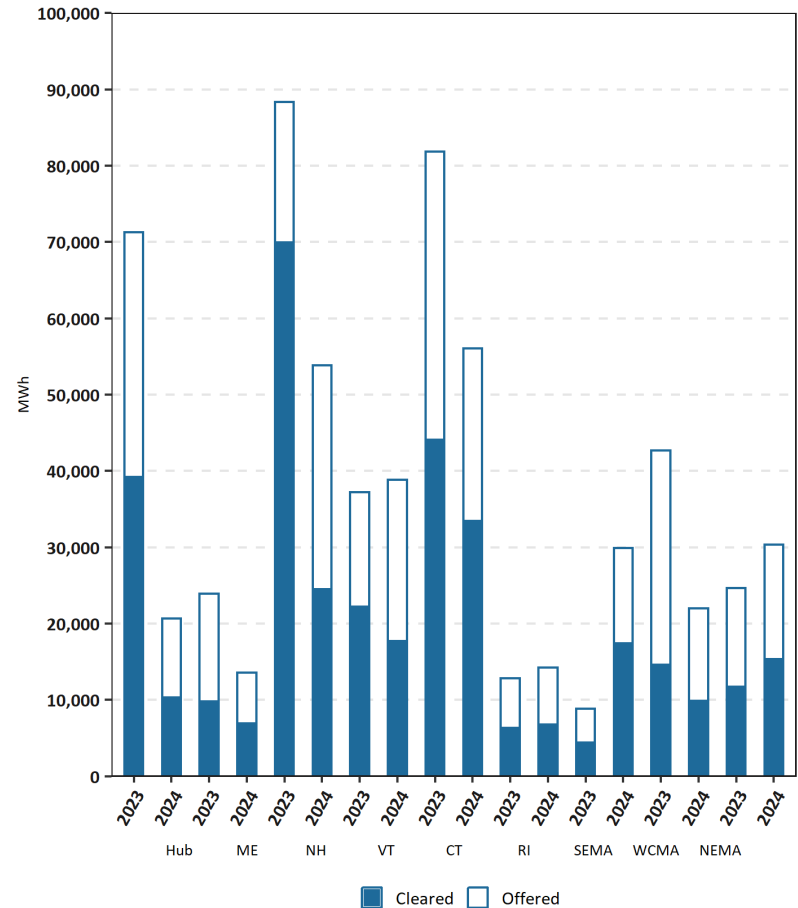


Includes nodal activity within the zone; excludes external nodes



Total Increment Offers and Decrement Bids


Zonal Level, Last 13 Months

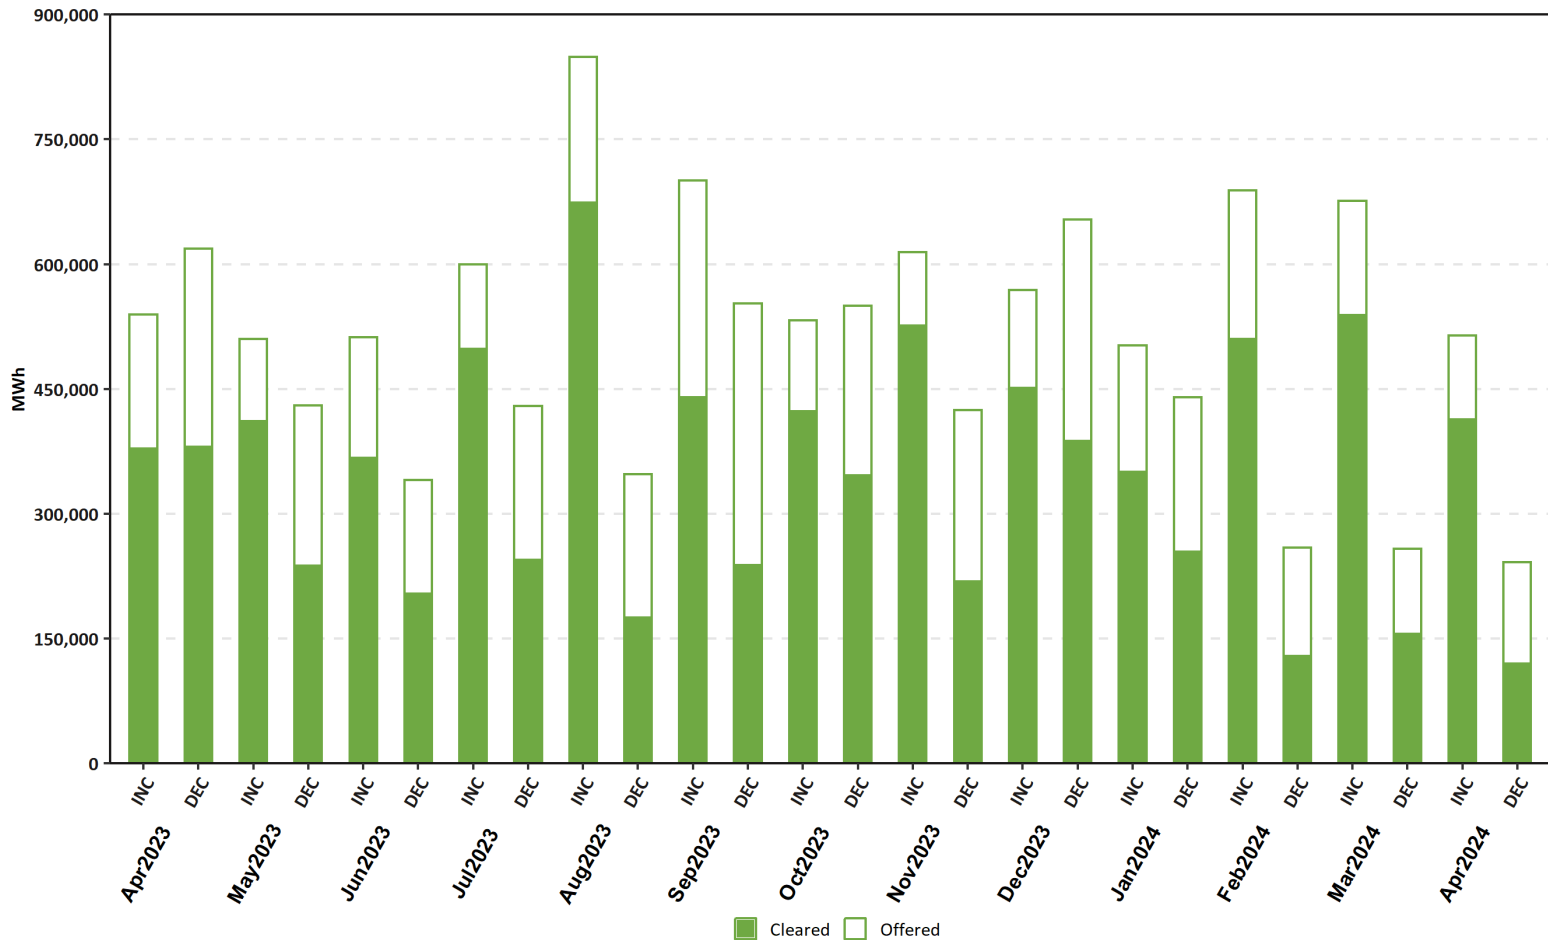

Includes nodal activity within the zone; excludes external nodes



System Unit Availability

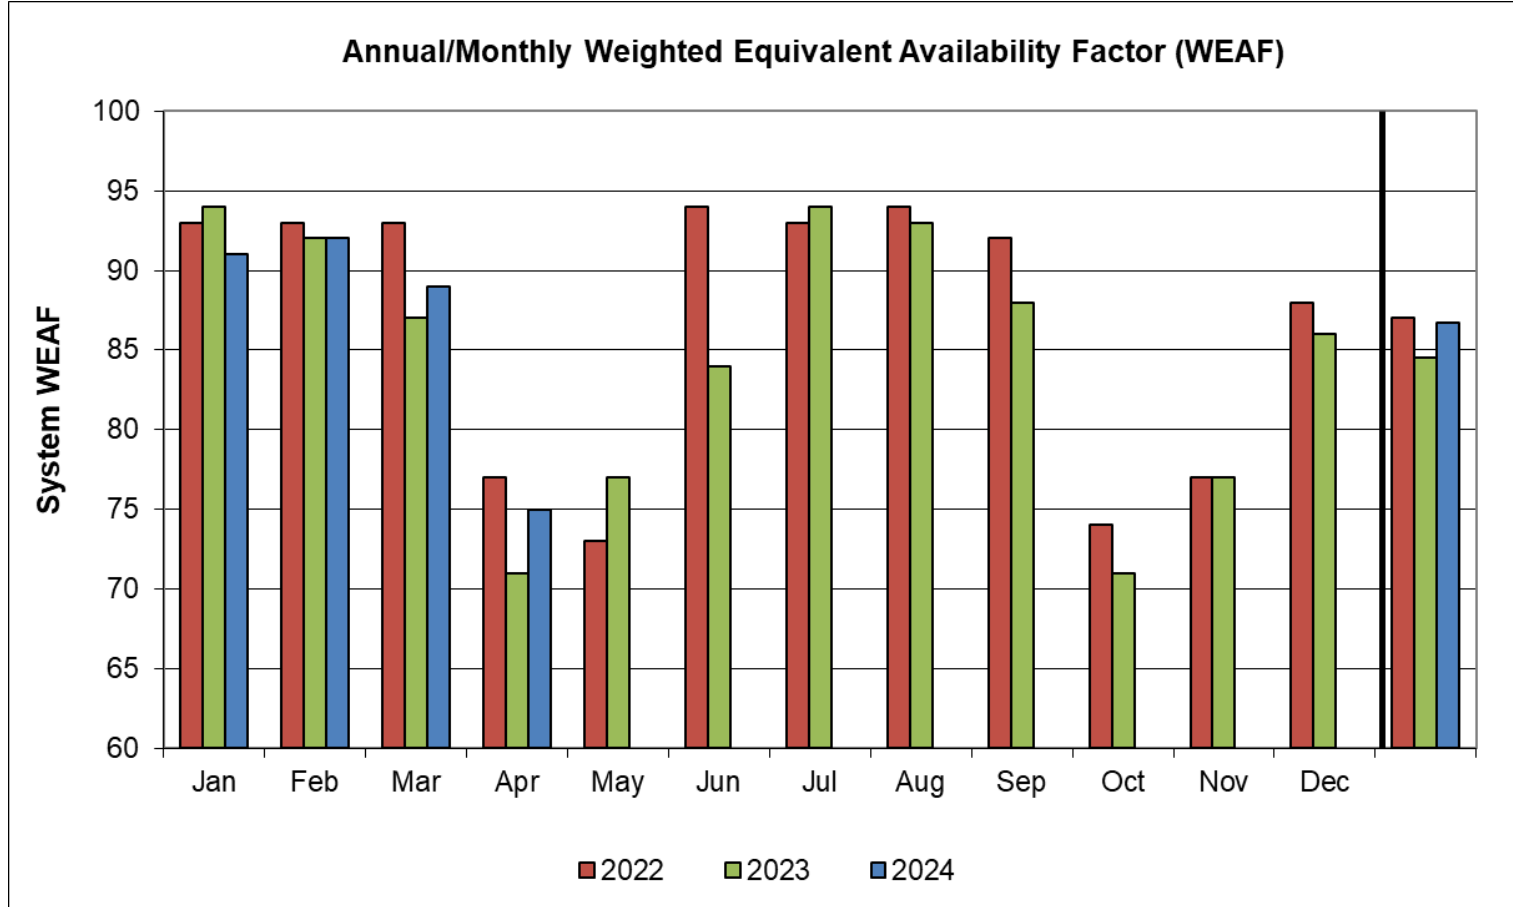

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD
2024	91	92	89	75									87
2023	94	92	87	71	77	84	94	93	88	71	77	86	85
2022	93	93	93	77	73	94	93	94	92	74	77	88	87

Data as of 4/22/24



BACK-UP DETAIL




DEMAND RESPONSE




Price Responsive Demand (PRD) Energy Market Activity by Month

DA, RT, and RT Dev MWh

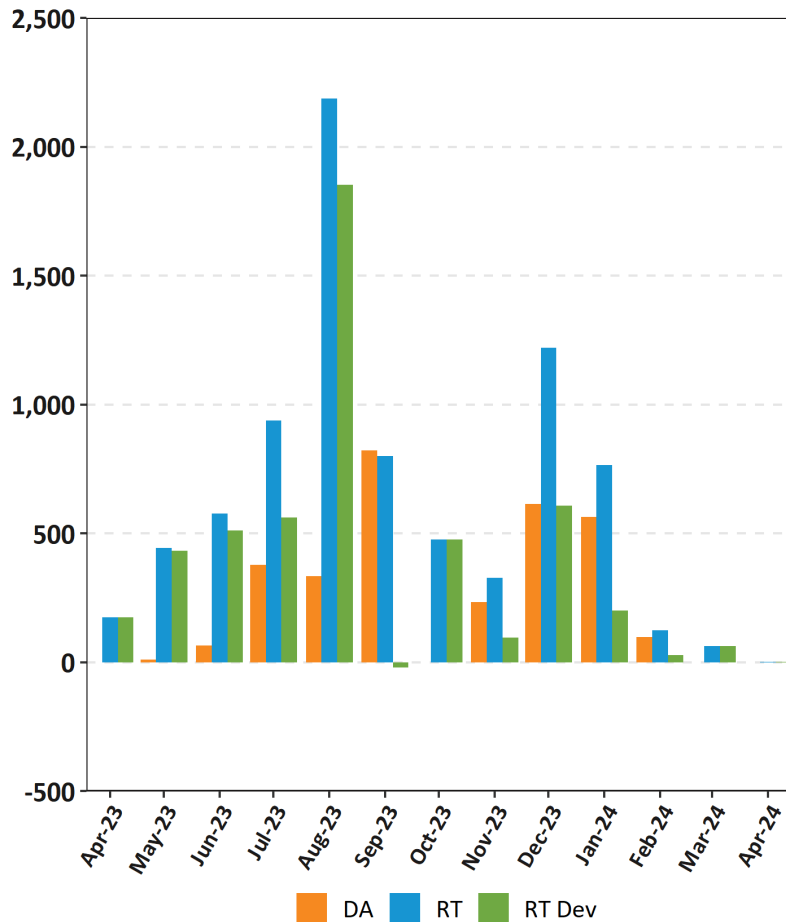

Market Value

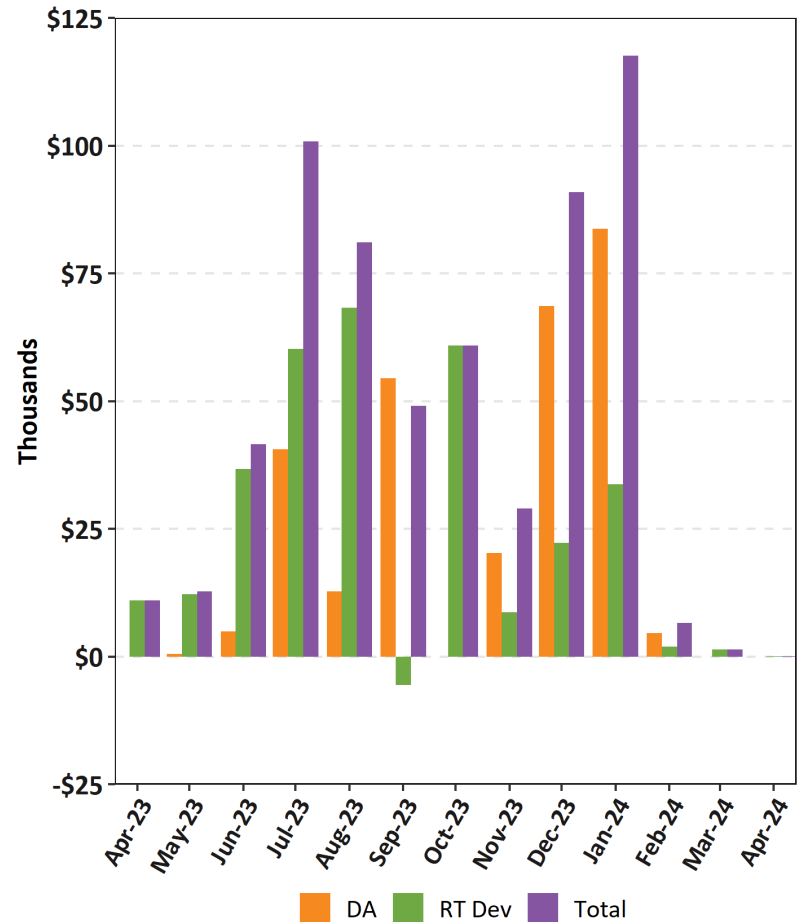

DA and RT (deviation) MWh are settlement obligations and reflect appropriate gross-ups for distribution losses.



NEW GENERATION


New Generation Update

Based on Queue as of 04/29/24

- Fourteen projects totaling 4,344 MW were added to the interconnection queue since the last update
 - Thirteen battery and one wind project with in-service dates between 2027 and 2031
- In total, 419 generation projects are currently being tracked by the ISO, totaling approximately 46,972 MW



Actual and Projected Annual Capacity Additions By Supply Fuel Type and Demand Resource Type

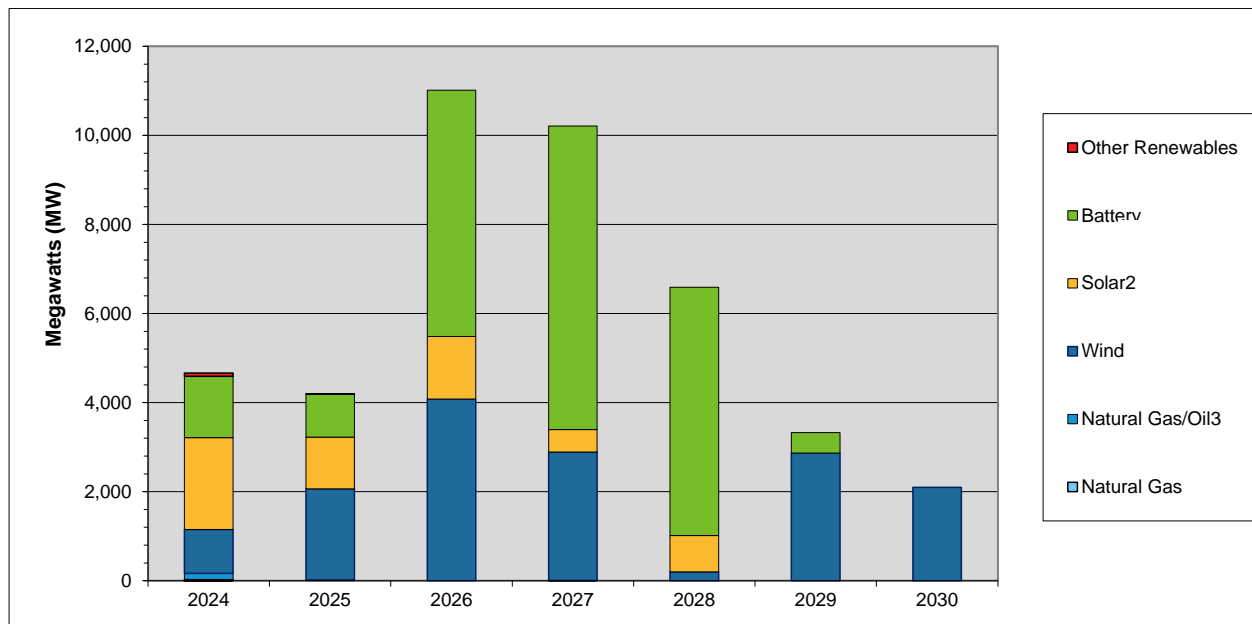


	2024	2025	2026	2027	2028	2029	2030	Total MW	% of Total ¹
Other Renewables	72	2	0	0	0	0	0	74	0.2
Battery	1,376	965	5,532	6,819	5,575	454	0	20,721	49.2
Solar ²	2,063	1,161	1,406	502	818	0	0	5,950	14.1
Wind	989	2,049	4,079	2,887	197	2,870	2,100	15,171	36.0
Natural Gas/Oil ³	135	16	0	0	0	0	0	151	0.4
Natural Gas	26	0	0	4	0	0	0	30	0.1
Totals	4,661	4,193	11,017	10,212	6,590	3,324	2,100	42,097	100.0

¹ Sum may not equal 100% due to rounding

² This category includes both solar-only, and co-located solar and battery projects

³ The projects in this category are dual fuel, with either gas or oil as the primary fuel

Actual and Projected Annual Generator Capacity Additions By State

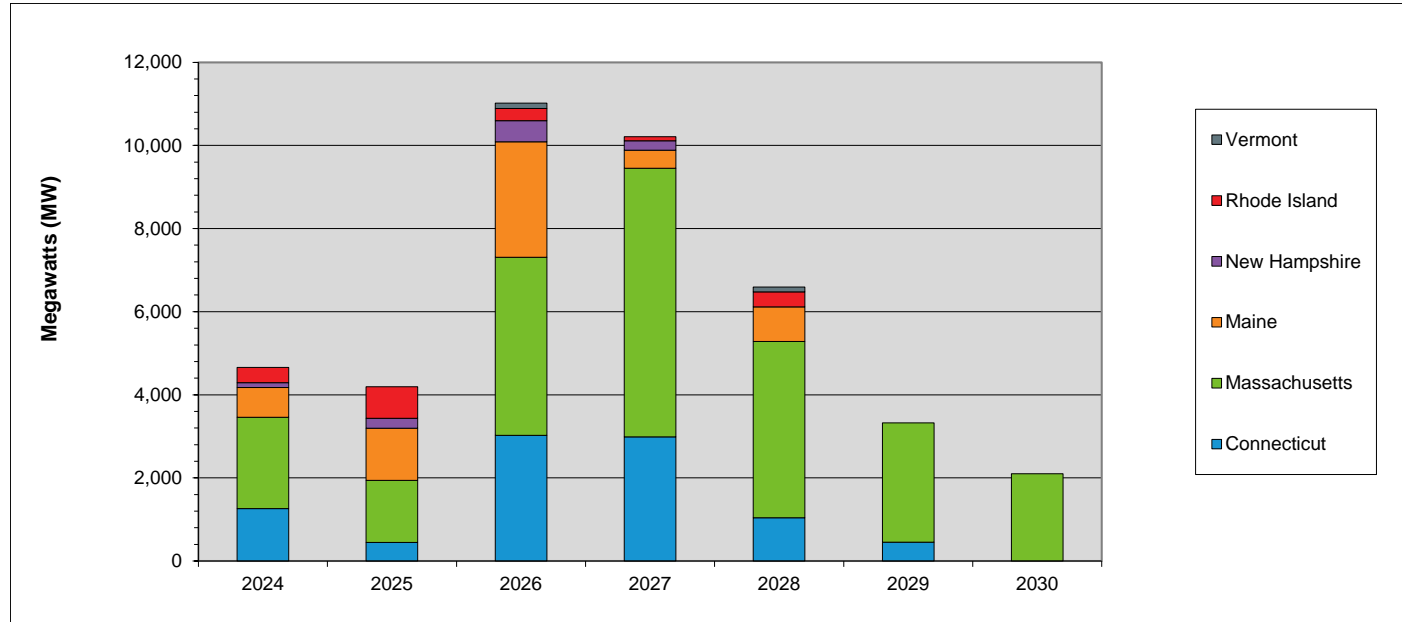

	2024	2025	2026	2027	2028	2029	2030	Total MW	% of Total ¹
Vermont	0	0	128	0	115	0	0	243	0.6
Rhode Island	371	758	295	102	360	0	0	1,886	4.5
New Hampshire	114	239	504	226	0	0	0	1,083	2.6
Maine	720	1,256	2,779	433	832	0	0	6,020	14.3
Massachusetts	2,196	1,496	4,287	6,462	4,245	2,870	2,100	23,656	56.2
Connecticut	1,260	444	3,024	2,989	1,038	454	0	9,209	21.9
Totals	4,661	4,193	11,017	10,212	6,590	3,324	2,100	42,097	100.0

¹ Sum may not equal 100% due to rounding

New Generation Projection

By Fuel Type

Unit Type	Total		Green		Yellow	
	No. of Projects	Capacity (MW)	No. of Projects	Capacity (MW)	No. of Projects	Capacity (MW)
Biomass/Wood Waste	0	0	0	0	0	0
Battery Storage	131	20,721	1	150	130	20,571
Fuel Cell	4	46	1	20	3	26
Hydro	1	28	1	28	0	0
Natural Gas	4	30	0	0	4	30
Natural Gas/Oil	3	151	1	62	2	89
Nuclear	0	0	0	0	0	0
Solar	247	5,950	15	343	232	5,607
Wind	29	20,046	2	926	27	19,120
Total	419	46,972	21	1,529	398	45,443

- Projects in the Natural Gas/Oil category may have either gas or oil as the primary fuel
- Green denotes projects with a high probability of going into service within the next 12 months
- Yellow denotes projects with a lower probability of going into service or new applications

New Generation Projection

By Operating Type

Operating Type	Total		Green		Yellow	
	No. of Projects	Capacity (MW)	No. of Projects	Capacity (MW)	No. of Projects	Capacity (MW)
Baseload	7	87	2	48	5	39
Intermediate	2	89	0	0	2	89
Peaker	381	26,750	17	555	364	26,195
Wind Turbine	29	20,046	2	926	27	19,120
Total	419	46,972	21	1,529	398	45,443

- Green denotes projects with a high probability of going into service within the next 12 months
- Yellow denotes projects with a lower probability of going into service or new applications

New Generation Projection

By Operating Type and Fuel Type

Unit Type	Total		Baseload		Intermediate		Peaker		Wind Turbine	
	No. of Projects	Capacity (MW)	No. of Projects	Capacity (MW)	No. of Projects	Capacity (MW)	No. of Projects	Capacity (MW)	No. of Projects	Capacity (MW)
Biomass/Wood Waste	0	0	0	0	0	0	0	0	0	0
Battery Storage	131	20,721	0	0	0	0	131	20,721	0	0
Fuel Cell	4	46	4	46	0	0	0	0	0	0
Hydro	1	28	1	28	0	0	0	0	0	0
Natural Gas	4	30	2	13	0	0	2	17	0	0
Natural Gas/Oil	3	151	0	0	2	89	1	62	0	0
Nuclear	0	0	0	0	0	0	0	0	0	0
Solar	247	5,950	0	0	0	0	247	5,950	0	0
Wind	29	20,046	0	0	0	0	0	0	29	20,046
Total	419	46,972	7	87	2	89	381	26,750	29	20,046

- Projects in the Natural Gas/Oil category may have either gas or oil as the primary fuel

FORWARD CAPACITY MARKET



Capacity Supply Obligation FCA 14

Resource Type	Resource Type	FCA	ARA 1		ARA 2		ARA 3	
		CSO	CSO	Change	CSO	Change	CSO	Change
		MW	MW	MW	MW	MW	MW	MW
Demand	Active Demand	592.043	688.07	96.027	659.671	-28.399	564.371	-95.3
	Passive Demand	3,327.071	3,327.932	0.861	3,315.207	-12.725	3,253.179	-62.028
Demand Total		3,919.114	4,016.002	96.888	3,974.878	-41.124	3,817.550	-157.328
Generator	Non-Intermittent	27,816.902	28,275.143	458.241	27,697.714	-577.429	27,684.252	-13.462
	Intermittent	1,160.916	1,128.446	-32.47	925.942	-202.504	893.444	-32.498
Generator Total		28,977.818	29,403.589	425.771	28,623.656	-779.933	28,577.696	-45.96
Import Total		1,058.72	1,058.72	0	1,029.800	-28.92	958.380	-71.42
Grand Total*		33,955.652	34,478.311	522.661	33,628.334	-849.977	33,353.626	-274.708
Net ICR (NICR)		32,490	32,980	490	31,480	-1,500	31,690	210

* Grand Total reflects both CSO Grand Total and the net total of the Change Column

Note: A resource's CSO may change for a variety of reasons outside ISO-NE administered trading windows. Reasons for CSO changes beyond reconfiguration auctions may include terminations or recent declaration of commercial operation. Details of the changes that occurred due to non-annual event purposes are contained in the 2023-2027 CCP Month Capacity Supply Obligation Changes report on the ISO New England website.

Capacity Supply Obligation FCA 15

Resource Type	Resource Type	FCA	ARA 1		ARA 2		ARA 3	
		CSO	CSO	Change	CSO	Change	CSO	Change
		MW	MW	MW	MW	MW	MW	MW
Demand	Active Demand	677.673	673.401	-4.272	579.692	-93.709	461.416	-118.276
	Passive Demand	3,212.865	3,211.403	-1.462	3,134.652	-76.751	3,113.332	-21.32
Demand Total		3,890.538	3,884.804	-5.734	3,714.344	-170.460	3,574.748	-139.596
Generator	Non-Intermittent	28,154.203	27,714.778	-439.425	27,081.653	-633.125	27,132.413	50.76
	Intermittent	1,089.265	1,073.794	-15.471	1,056.601	-17.193	865.694	-190.907
Generator Total		29,243.468	28,788.572	-454.896	28,138.254	-650.318	27,998.107	-140.147
Import Total		1,487.059	1297.132	-189.927	1,249.545	-47.587	1,193.583	-55.962
Grand Total*		34,621.065	33,970.508	-650.557	33,102.143	-868.365	32,766.438	-335.705
Net ICR (NICR)		33,270	31,775	-1,495	31,545	-230	31,380	-165

* Grand Total reflects both CSO Grand Total and the net total of the Change Column

Note: A resource's CSO may change for a variety of reasons outside ISO-NE administered trading windows. Reasons for CSO changes beyond reconfiguration auctions may include terminations or recent declaration of commercial operation. Details of the changes that occurred due to non-annual event purposes are contained in the 2023-2027 CCP Month Capacity Supply Obligation Changes report on the ISO New England website.

Capacity Supply Obligation FCA 16

Resource Type	Resource Type	FCA	ARA 1		ARA 2		ARA 3	
		CSO	CSO	Change	CSO	Change	CSO	Change
		MW	MW	MW	MW	MW	MW	MW
Demand	<i>Active Demand</i>	765.35	589.882	-175.468				
	<i>Passive Demand</i>	2,557.256	2,579.120	21.864				
Demand Total		3,322.606	3,169.002	-153.604				
Generator	<i>Non-Intermittent</i>	26,805.003	26,643.379	-161.624				
	<i>Intermittent</i>	1,178.933	1,146.783	-32.15				
Generator Total		27,983.936	27,790.162	-193.774				
Import Total		1,503.842	1,247.601	-256.241				
Grand Total*		32,810.384	32,206.765	-603.619				
Net ICR (NICR)		31,645	30,585	-1,060				

* Grand Total reflects both CSO Grand Total and the net total of the Change Column

Note: A resource's CSO may change for a variety of reasons outside ISO-NE administered trading windows. Reasons for CSO changes beyond reconfiguration auctions may include terminations or recent declaration of commercial operation. Details of the changes that occurred due to non-annual event purposes are contained in the 2023-2027 CCP Month Capacity Supply Obligation Changes report on the ISO New England website.

Capacity Supply Obligation FCA 17

Resource Type	Resource Type	FCA	ARA 1		ARA 2		ARA 3	
		CSO	CSO	Change	CSO	Change	CSO	Change
		MW	MW	MW	MW	MW	MW	MW
Demand	Active Demand	622.854						
	Passive Demand	2,316.815						
Demand Total		2,939.669						
Generator	Non-Intermittent	26,507.420						
	Intermittent	1,356.084						
Generator Total		27,863.504						
Import Total		566.998						
Grand Total*		31,370.171						
Net ICR (NICR)		30,305						

* Grand Total reflects both CSO Grand Total and the net total of the Change Column

Note: A resource's CSO may change for a variety of reasons outside ISO-NE administered trading windows. Reasons for CSO changes beyond reconfiguration auctions may include terminations or recent declaration of commercial operation. Details of the changes that occurred due to non-annual event purposes are contained in the 2023-2027 CCP Month Capacity Supply Obligation Changes report on the ISO New England website.

Capacity Supply Obligation FCA 18

Resource Type	Resource Type	FCA	ARA 1		ARA 2		ARA 3	
		CSO	CSO	Change	CSO	Change	CSO	Change
		MW	MW	MW	MW	MW	MW	MW
Demand	Active Demand	543.580						
	Passive Demand	2,070.498						
Demand Total		2,614.078						
Generator	Non-Intermittent	27,026.635						
	Intermittent	1,450.872						
Generator Total		28,477.507						
Import Total		464.835						
Grand Total*		31,556.420						
Net ICR (NICR)		30,550						

* Grand Total reflects both CSO Grand Total and the net total of the Change Column

Note: A resource's CSO may change for a variety of reasons outside ISO-NE administered trading windows. Reasons for CSO changes beyond reconfiguration auctions may include terminations or recent declaration of commercial operation. Details of the changes that occurred due to non-annual event purposes are contained in the 2023-2027 CCP Month Capacity Supply Obligation Changes report on the ISO New England website.


Active/Passive Demand Response

CSO Totals by Commitment Period

Commitment Period	Active/Passive	Existing	New	Grand Total
2021-22	Active	480.941	143.504	624.445
	Passive	2,604.79	370.568	2,975.36
	Grand Total	3,085.734	514.072	3,599.806
2022-23	Active	598.376	87.178	685.554
	Passive	2,788.33	566.363	3,354.69
	Grand Total	3,386.703	653.541	4,040.244
2023-24	Active	560.55	31.493	592.043
	Passive	3,035.51	291.565	3,327.07
	Grand Total	3,596.056	323.058	3,919.114
2024-25	Active	674.153	3.520	677.673
	Passive	3,046.064	166.801	3,212.865
	Grand Total	3,720.217	170.321	3,890.538
2025-26	Active	664.01	101.34	765.35
	Passive	2,428.638	128.618	2557.256
	Grand Total	3,092.648	229.958	3,322.606
2026-27	Active	615.369	7.485	622.854
	Passive	2,194.172	122.643	2,316.815
	Grand Total	2,809.541	130.128	2,939.669
2027-28	Active	543.58	0.0	543.58
	Passive	1,965.515	104.983	2070.498
	Grand Total	2,509.095	104.983	2,614.498

Forward Capacity Market Auctions

Cumulative FCM Charges by CCP

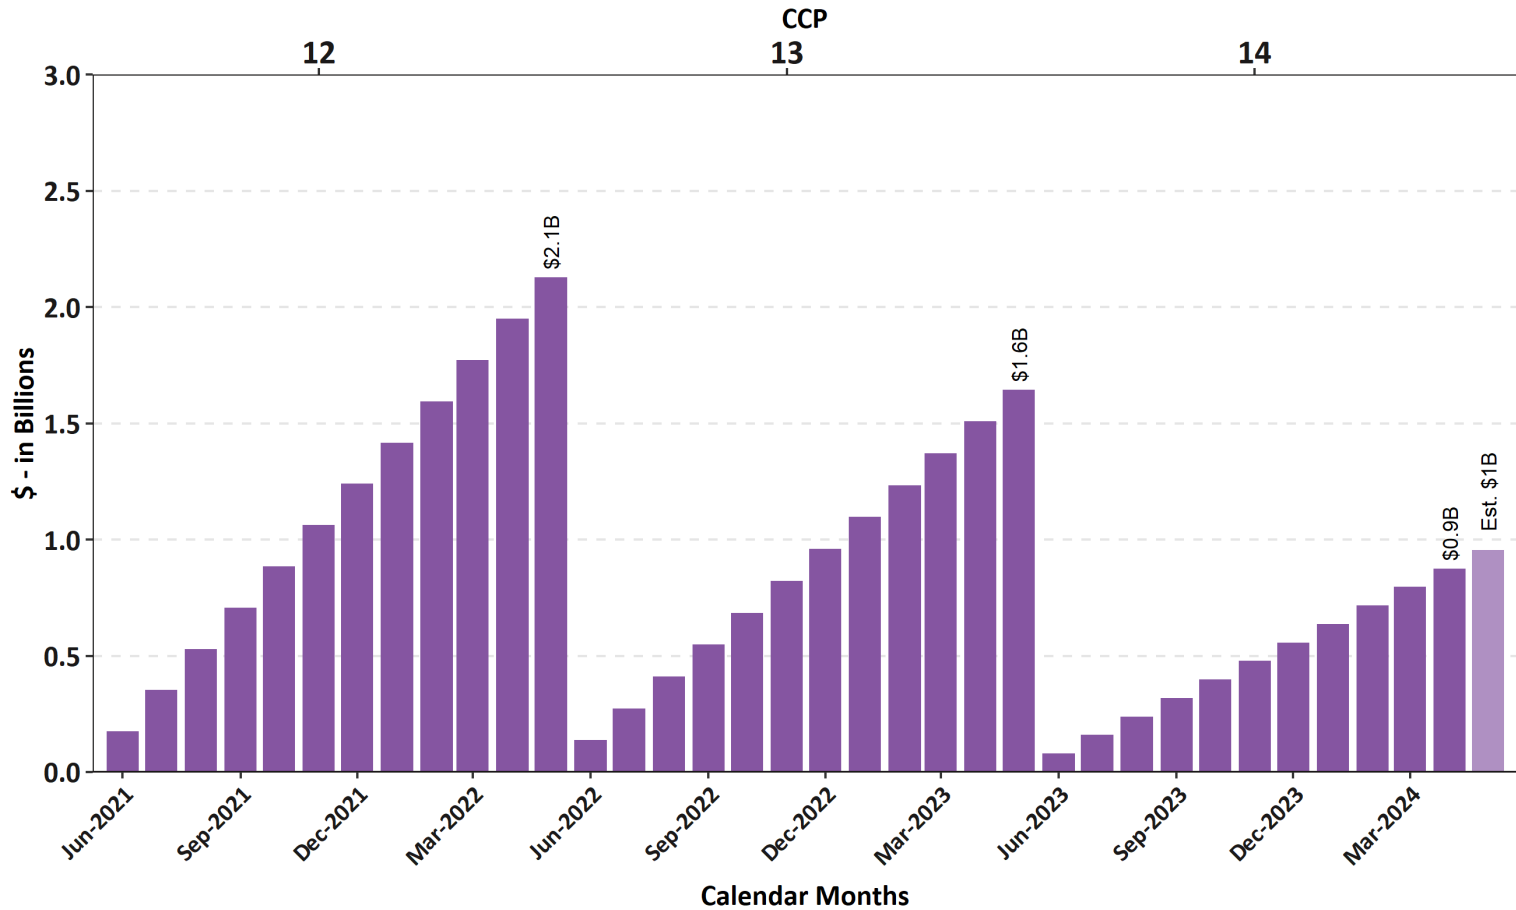


The items in the graph shaded in a lighter color represent the forecast for future months in the Capacity Commitment Period (CCP)



NET COMMITMENT PERIOD COMPENSATION


DA and RT NCPC Charges

Apr-24 Total = \$1.2 M

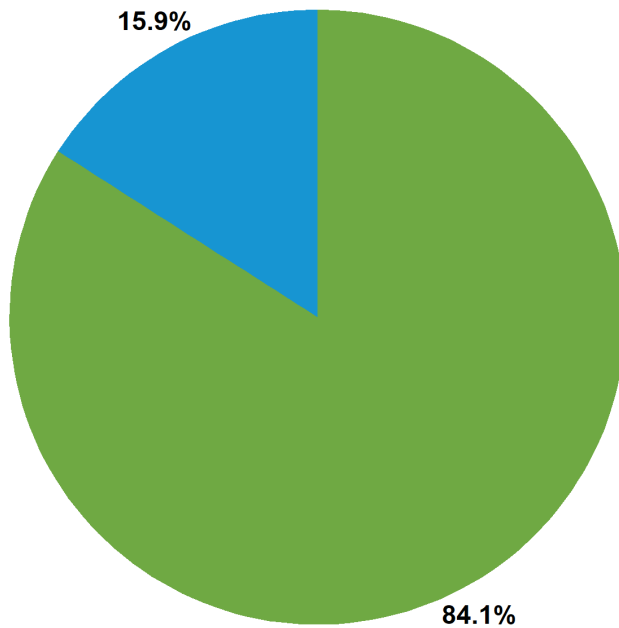

Day-Ahead Real-Time


Last 13 Months

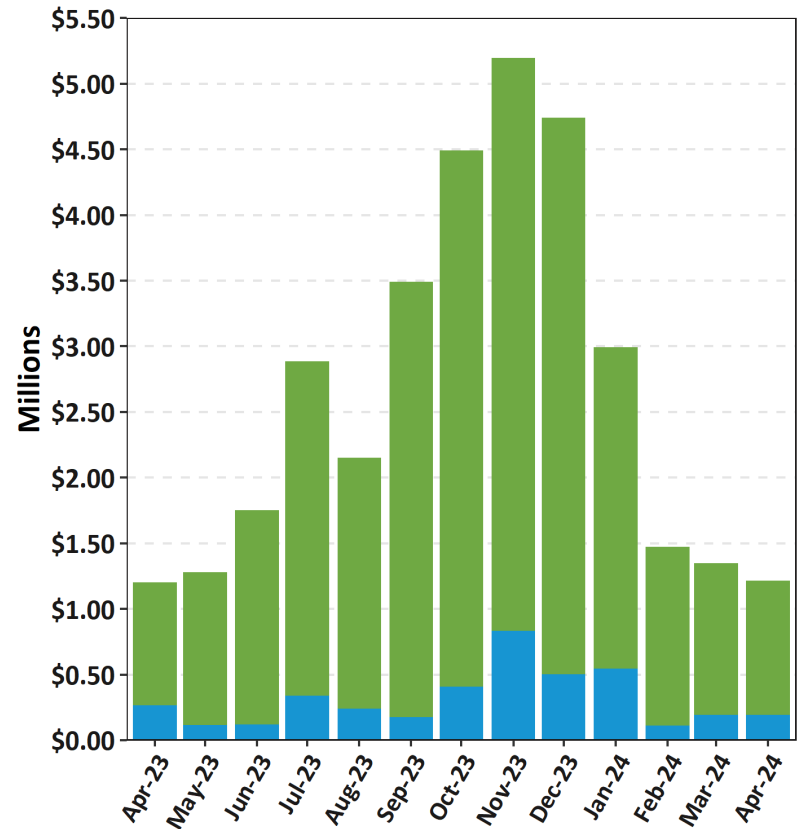

Day-Ahead Real-Time

NCPC Charges by Type



Apr-24 Total = \$1.2 M

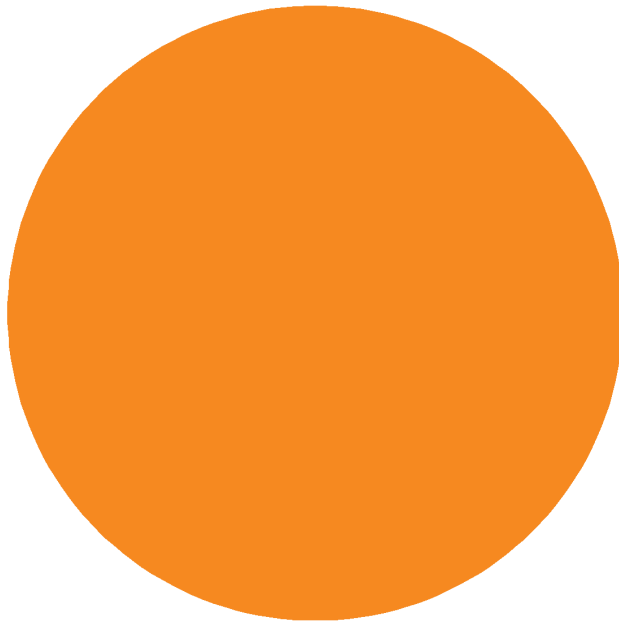


100.0%



Last 13 Months


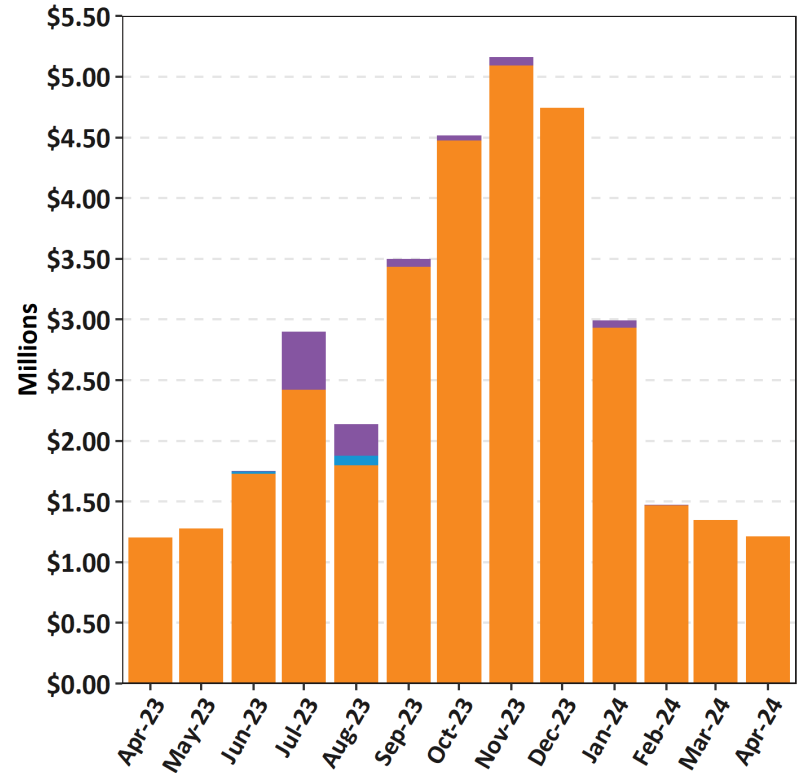


NCPC Charges by Type as Percent of Energy Market Value

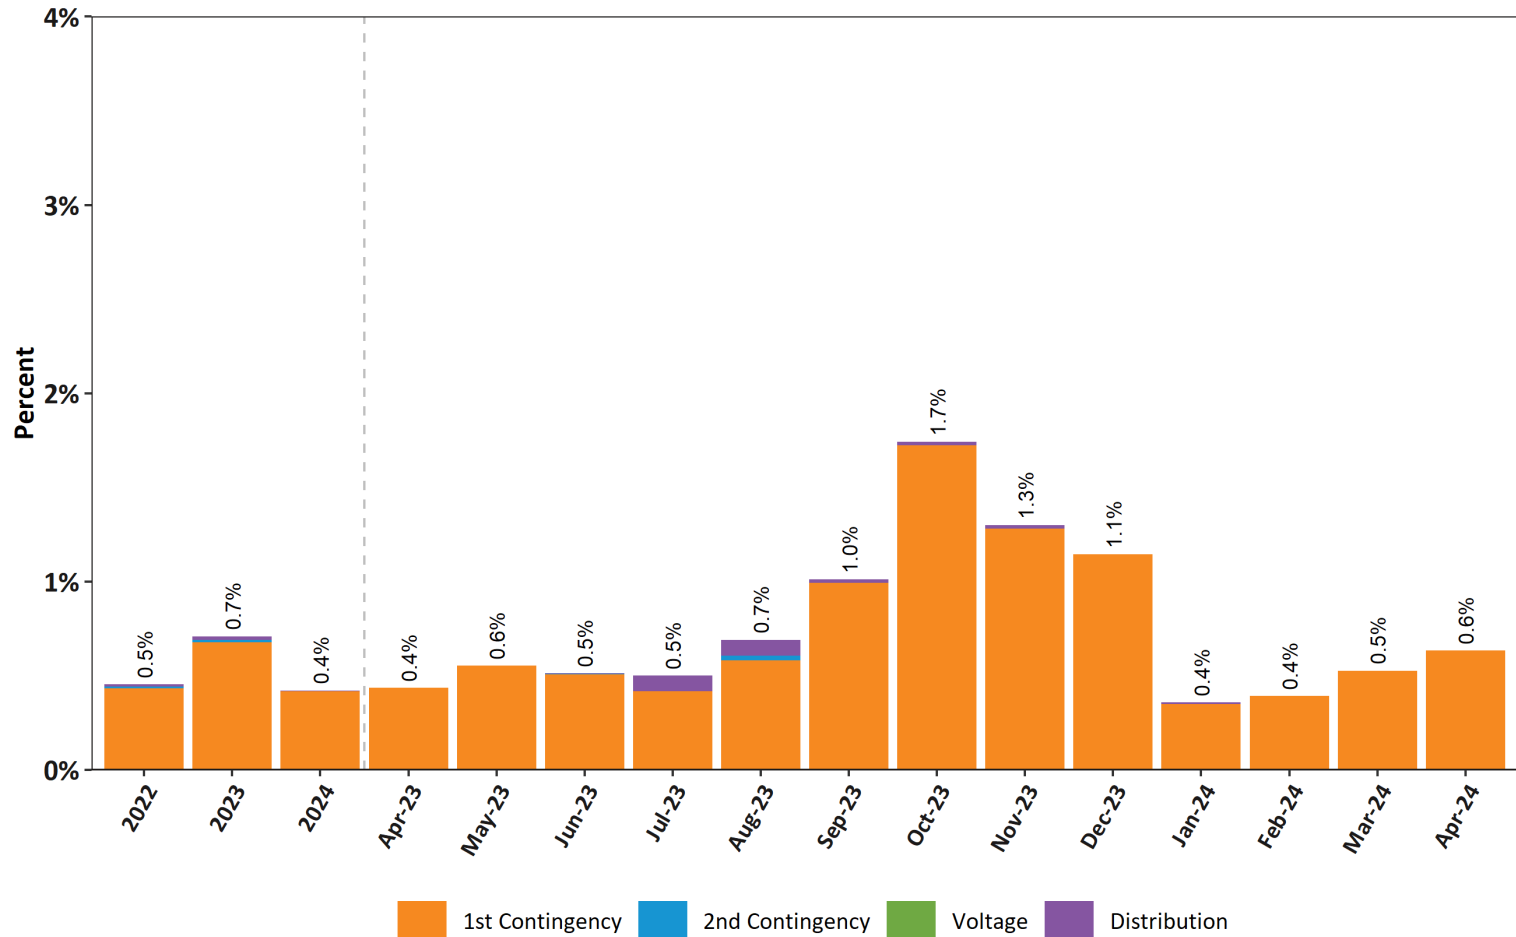


NCPC Charge Allocations

Apr-24 Total = \$1.2 M

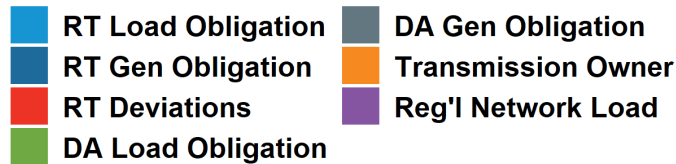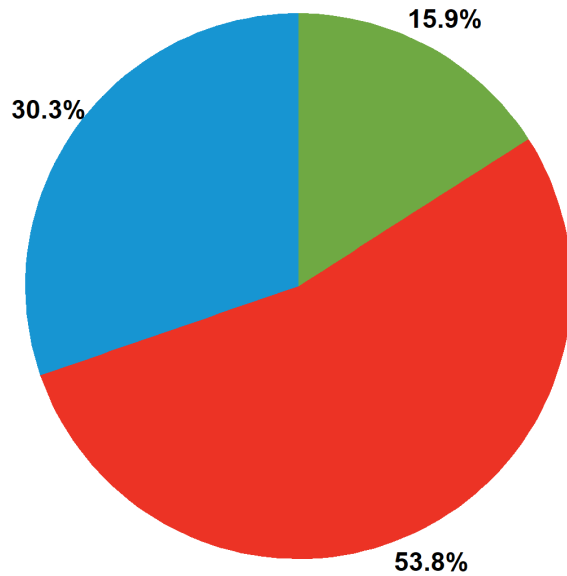


Last 13 Months


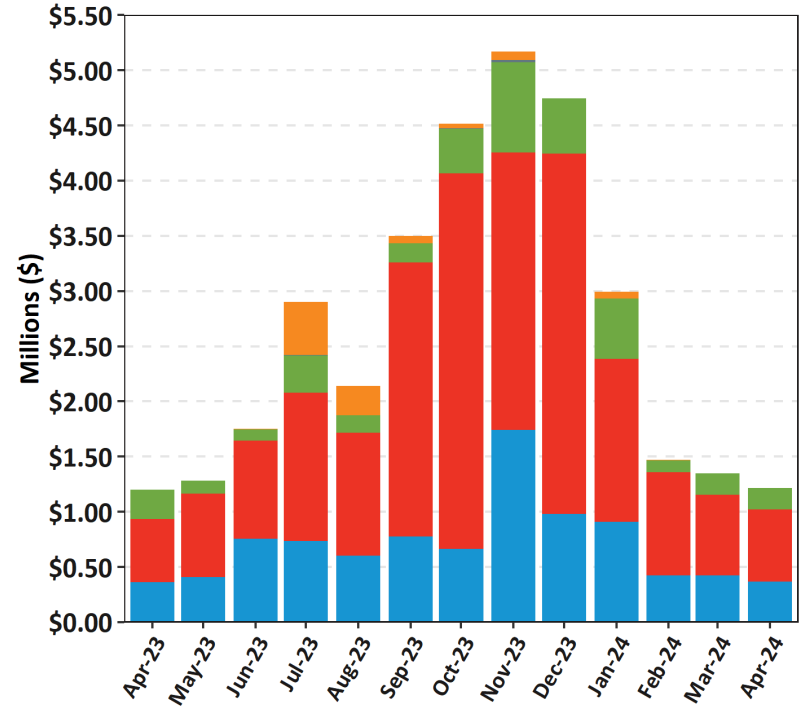


RT First Contingency NCPC Paid to Units and Allocated to RTLO and/or RTGO

Apr-24 Total = \$0.4 M

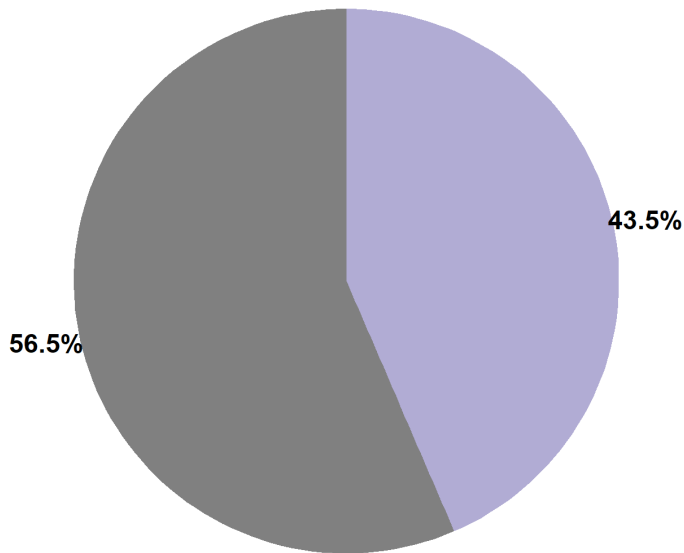


Last 13 Months

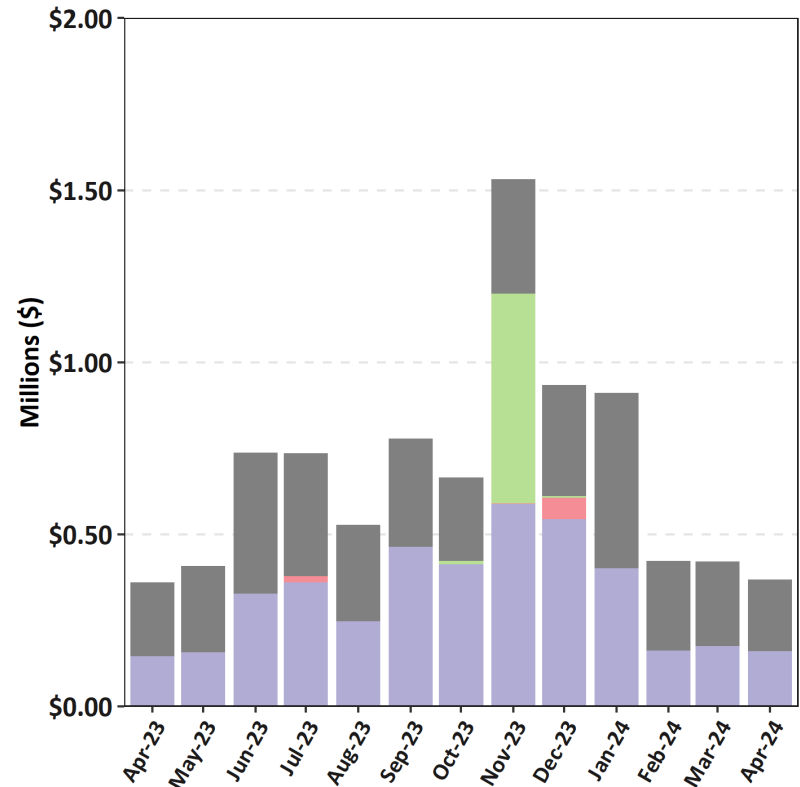


The categories shown above are a subset of those reflected in First Contingency NCPC throughout this report. The above categories are allocated to RTLO, except for Min Gen Emergency credits, which are allocated to RTGO.

RT First Contingency Charges by Deviation Type

Apr-24 Total = \$0.7 M

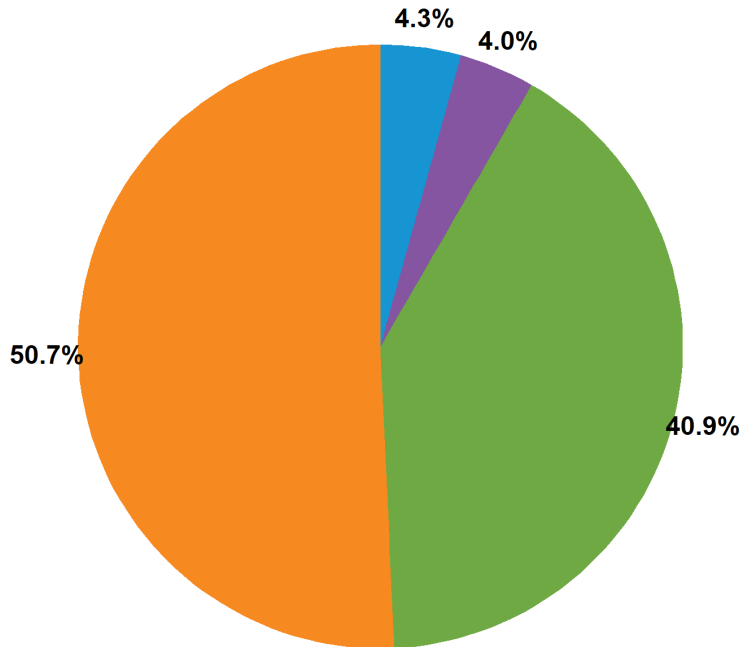


Last 13 Months

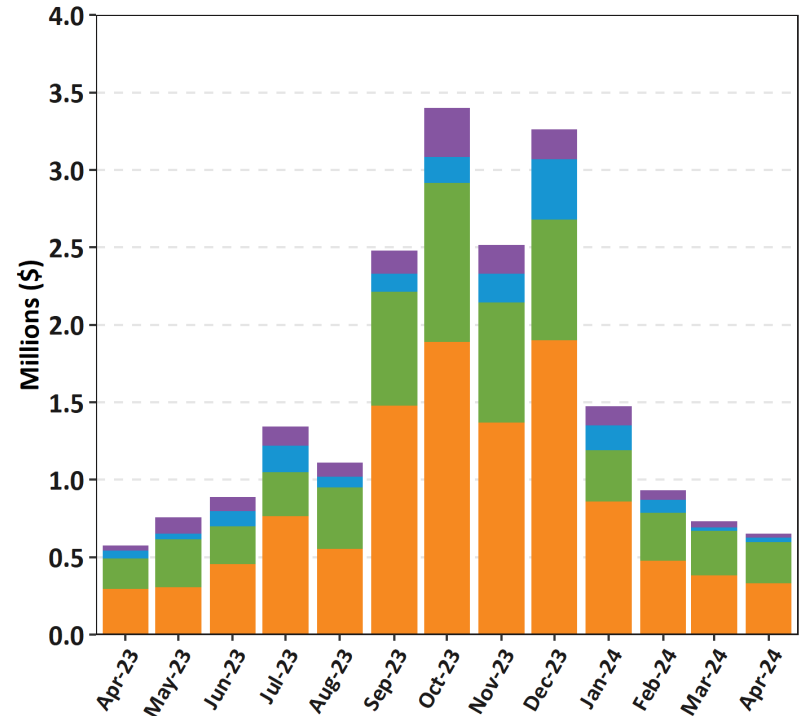


ISO BILLINGS

Total ISO Billings

Monthly Billed Amounts

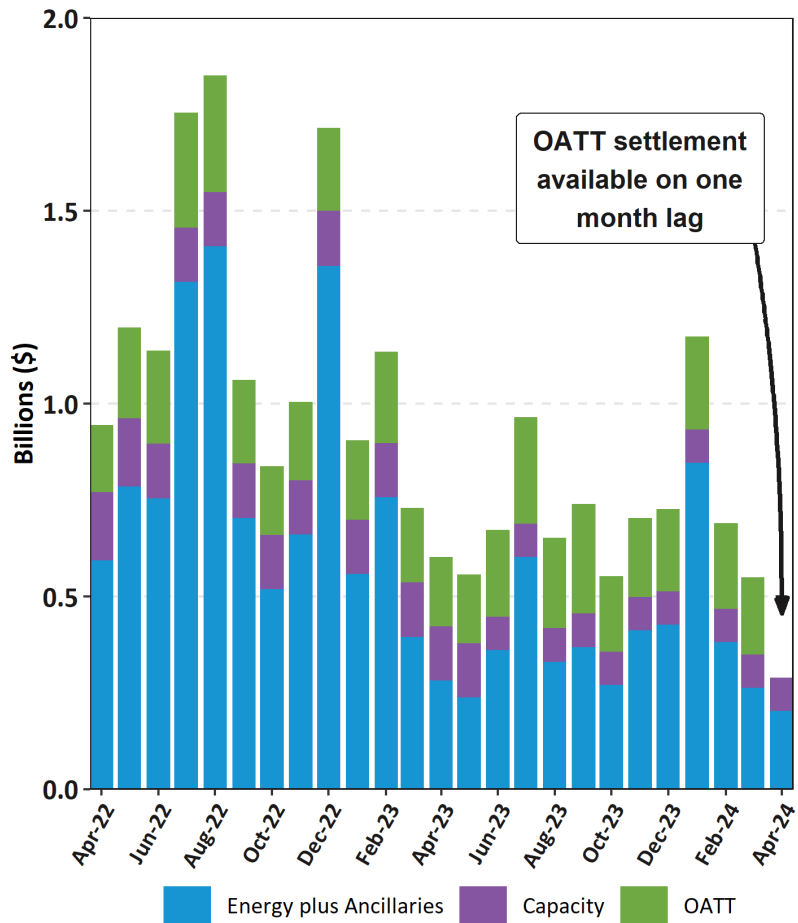

Annual Cumulative Billed Amounts

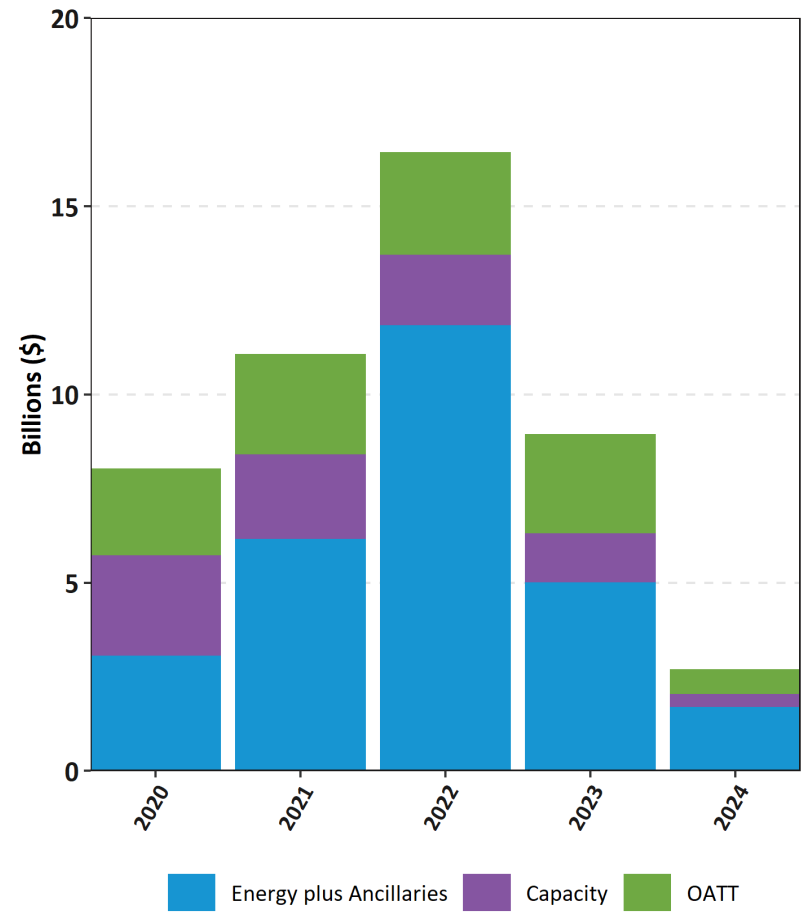

Ancillaries = Reserves, Regulation, NCPC, minus Marginal Loss Revenue Fund. OATT = RNS, Through and Out, Schedule 9



REGIONAL SYSTEM PLAN (RSP)

Planning Advisory Committee (PAC)

- May 15 PAC Meeting Agenda Topics*
 - Asset Condition Projects
 - W-149 115 kV Line Asset Condition Refurbishment – National Grid
 - O-141/P-142 115 kV Line Asset Condition Refurbishment – National Grid
 - Third Maine Resource Integration Study
 - Order 881 Update
 - Update on Legacy Distributed Energy Resource Assumptions in Needs Assessments
 - Overview of Joint NETO Asset Condition Process Guide

* Agenda topics are subject to change. Visit <https://www.iso-ne.com/committees/planning/planning-advisory> for the latest PAC agendas.

2050 Transmission Study

- Final version of the study, technical appendix, responses to stakeholder feedback, and study fact sheet were published on 2/14/24
- Additional analysis to address stakeholder comments on offshore wind points of interconnection was presented to PAC on 3/20/24, and will continue through Q2 and Q3 2024
- Results of additional analysis on offshore wind relocation were presented at the 4/18/24 PAC meeting

Economic Studies: EPCET

- Economic Planning for the Clean Energy Transition (EPCET) Pilot Study
 - An effort to review all assumptions in economic planning and perform a test study consistent with the changes to the Tariff
 - PAC presentations began in April 2022. To date, the ISO has presented results from the Benchmark, Market Efficiency Need, and Policy scenarios and is now in the process of finalizing the study. The last set of results was presented in April 2024.
 - A report will be issued in Q3 2024

Economic Studies: 2024 Study


- 2024 Economic Study
 - First use of new Tariff language
 - Study was initiated at the January PAC meeting
 - Study will begin with Benchmark Scenario in Q1-Q2 2024, followed by Policy Scenario in Q3-Q4 2024
 - Stakeholder-Requested Scenario proposals will be reviewed and discussed at the June PAC meeting
 - Market Efficiency Needs Scenario will be studied in 2025

ISO-NE Tie Benefits Evaluation

- The ISO started the tie benefits evaluation at the October 19 PSPC meeting. The third presentation was given at a special March 15 PSPC meeting and topics included:
 - Responses to stakeholder questions from January
 - A deeper dive into the MARS model methodology
 - Review of flows within MARS replications during tie benefits analyses
- The evaluation will extend through Q4 of 2024
 - Additional PSPC time will be dedicated for this topic
- The next PSPC meeting is scheduled for June 21
 - As a result of the FERC-approved FCA 19 delay, we will be altering this year's PSPC schedule and will be canceling the May PSPC meeting
 - The ISO will review the 2024 PSPC cycle in greater detail at the May RC meeting

New England Power System Carbon Emissions


2023 vs. 2024 New England Power System Estimated Carbon Dioxide (CO₂) Emissions

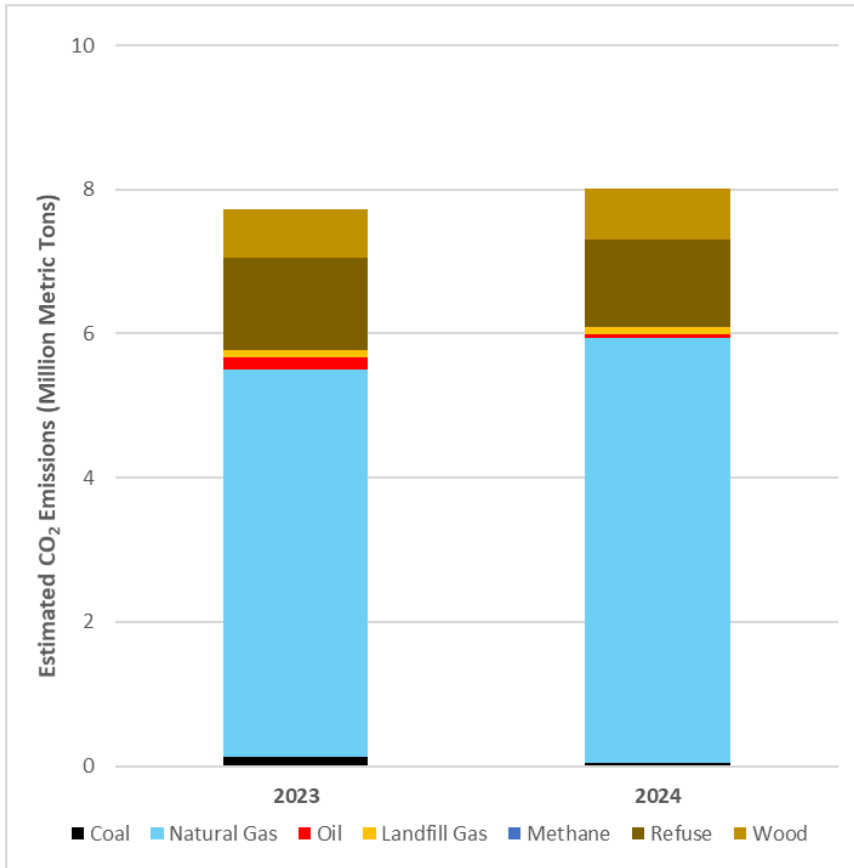

Data as of 4/14/24

RGGI – Regional Greenhouse Gas Initiative

RGGI Allowance Prices

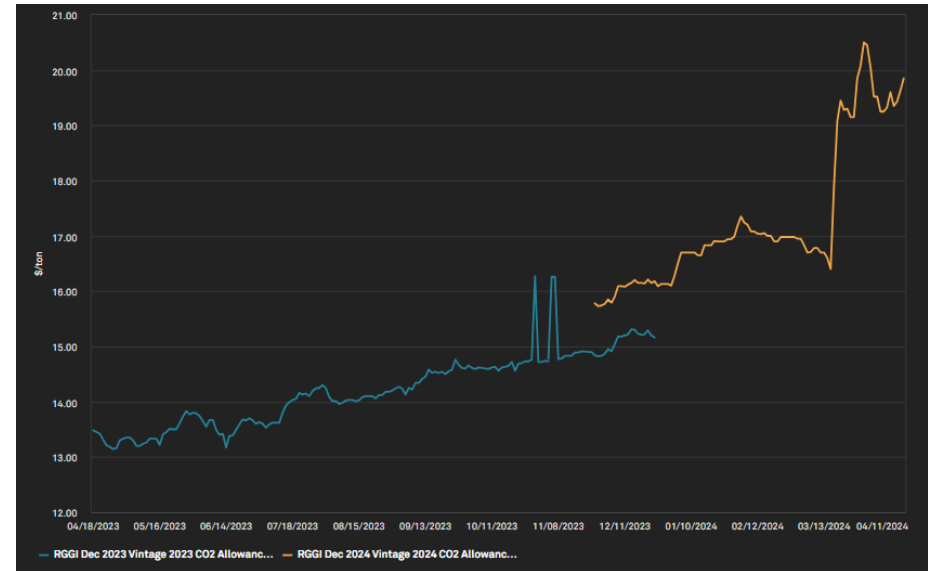

- 4/17/24: RGGI allowance spot price - \$19.85
- The 64th RGGI auction will be held on June 5
- RGGI states [released](#) fifth three-year control period Compliance Summary Report:
 - 221 of the 222 power plants under RGGI have met their compliance obligations
 - 99.9% of covered power sector emissions were in compliance


Massachusetts CO₂ Generator Emissions Cap

2024 Estimated Emissions Under CO₂ Cap

- As of 4/18/24, April estimated GWSA CO₂ emissions range between **172,085** and **206,073** metric tons
 - Year-to-date 2024 estimated emissions range between **21.7%** and **25.1%** of the 2024 cap of 7.61 MMT


2023 Estimated Emissions Under CO₂ Cap

- According to the [EPA CAMPD](#), 2023 total GWSA CO₂ emissions were **5.86 MMT**, or **75%** of the 2023 cap of 7.84 MMT

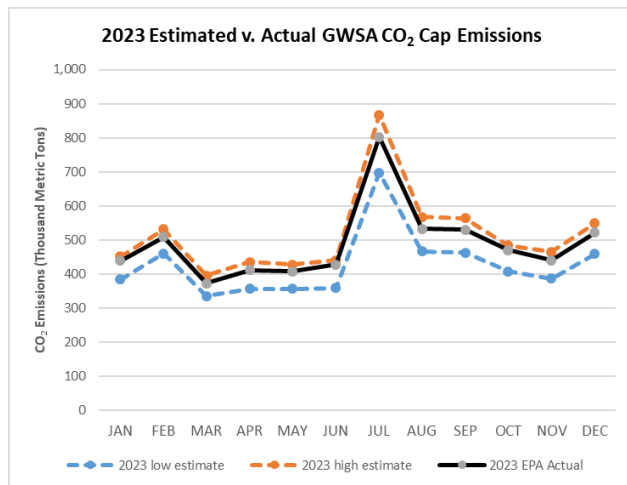

2021-2024 Estimated Monthly Emissions (Thousand Metric Tons)

GWSA 2024 Monthly Estimated Emissions

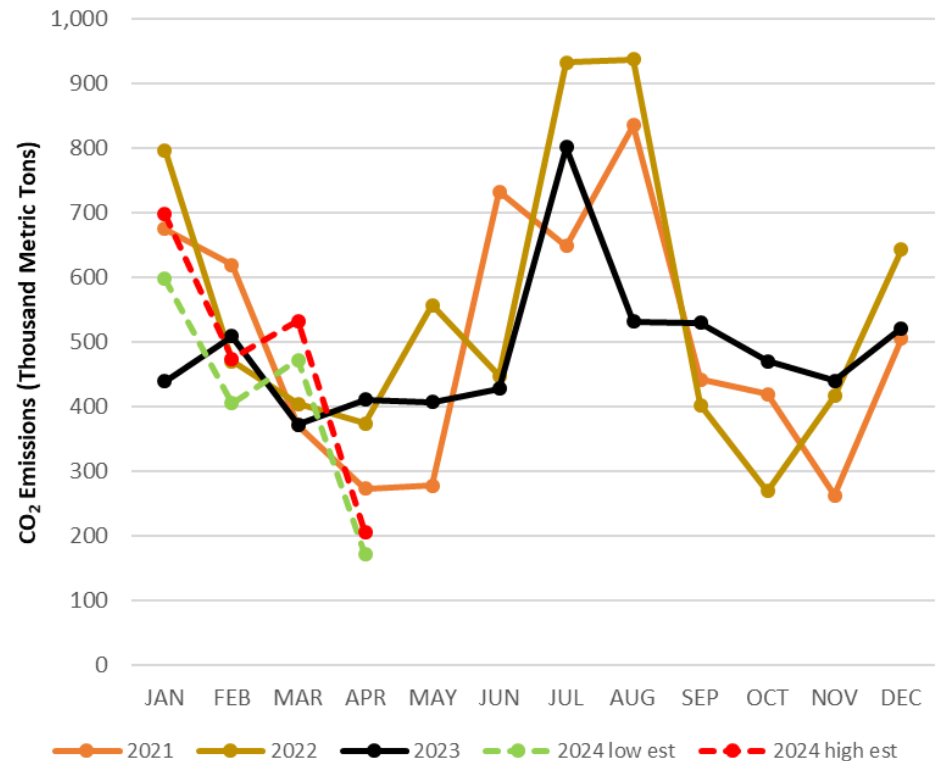

GWSA – Global Warming Solutions Act
MMT – Million Metric Tons

Source: ISO-NE (estimated emissions)

RSP Project Stage Descriptions

Stage	Description
1	Planning and Preparation of Project Configuration
2	Pre-construction (e.g., material ordering, project scheduling)
3	Construction in Progress
4	In Service

Note: The listings in this section focus on major transmission line construction and rebuilding.



Greater Boston Projects

Status as of 4/18/2024

Plan Benefit: Addresses long-term system needs in the Greater Boston area and improves system reliability

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1213, 1220, 1365	Install new 345 kV line from Scobie to Tewksbury	Dec-17	4
1527, 1528	Reconductor the Y-151 115 kV line from Dracut Junction to Power Street	Apr-17	4
1212, 1549	Reconductor the M-139 115 kV line from Tewksbury to Pinehurst and associated work at Tewksbury	May-17	4
1549	Reconductor the N-140 115 kV line from Tewksbury to Pinehurst and associated work at Tewksbury	May-17	4
1260	Reconductor the F-158N 115 kV line from Wakefield Junction to Maplewood and associated work at Maplewood	Dec-15	4
1550	Reconductor the F-158S 115 kV line from Maplewood to Everett	Jun-19	4
1551, 1552	Install new 345 kV cable from Woburn to Wakefield Junction, install two new 160 MVAR variable shunt reactors and associated work at Wakefield Junction and Woburn*	Mar-24	4
1329	Refurbish X-24 69 kV line from Millbury to Northboro Road	Dec-15	4
1327	Reconductor W-23W 69 kV line from Woodside to Northboro Road	Jun-19	4

Greater Boston Projects, cont.

Status as of 4/18/2024

Plan Benefit: Addresses long-term system needs in the Greater Boston area and improves system reliability

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1330	Separate X-24 and E-157W DCT	Dec-18	4
1363	Separate Q-169 and F-158N DCT	Dec-15	4
1637, 1640	Reconductor M-139/211-503 and N-140/211-504 115 kV lines from Pinehurst to North Woburn tap	May-17	4
1516	Install new 115 kV station at Sharon to segment three 115 kV lines from West Walpole to Holbrook	Sep-20	4
965	Install third 115 kV line from West Walpole to Holbrook	Sep-20	4
1558	Install new 345 kV breaker in series with the 104 breaker at Stoughton	May-16	4
1199	Install new 230/115 kV autotransformer at Sudbury and loop the 282-602 230 kV line in and out of the new 230 kV switchyard at Sudbury	Dec-17	4
1335	Install a new 115 kV line from Sudbury to Hudson	Mar-25	3

Greater Boston Projects, cont.

Status as of 4/18/2024

Plan Benefit: Addresses long-term system needs in the Greater Boston area and improves system reliability

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1336	Replace 345/115 kV autotransformer, 345 kV breakers, and 115 kV switchgear at Woburn	Dec-19	4
1553	Install a 345 kV breaker in series with breaker 104 at Woburn	Jun-17	4
1337	Reconfigure Waltham by relocating PARs, 282-507 line, and a breaker	Dec-17	4
1339	Upgrade 533-508 115 kV line from Lexington to Hartwell and associated work at the stations	Aug-16	4
1521	Install a new 115 kV 54 MVAR capacitor bank at Newton	Dec-16	4
1522	Install a new 115 kV 36.7 MVAR capacitor bank at Sudbury	May-17	4
1352	Install a second Mystic 345/115 kV autotransformer and reconfigure the bus	May-19	4
1353	Install a 115 kV breaker on the East bus at K Street	Jun-16	4
1354, 1738	Install 115 kV cable from Mystic to Chelsea and upgrade Chelsea 115 kV station to BPS standards	Jul-21	4
1355	Split 110-522 and 240-510 DCT from Baker Street to Needham for a portion of the way and install a 115 kV cable for the rest of the way	Mar-21	4

Greater Boston Projects, cont.

Status as of 4/18/2024

Plan Benefit: Addresses long-term system needs in the Greater Boston area and improves system reliability

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1356	Install a second 115 kV cable from Mystic to Woburn to create a bifurcated 211-514 line	Mar-24	4
1357	Open lines 329-510/511 and 250-516/517 at Mystic and Chatham, respectively. Operate K Street as a normally closed station.	May-19	4
1518	Upgrade Kingston to create a second normally closed 115 kV bus tie and reconfigure the 345 kV switchyard	Mar-19	4
1519	Relocate the Chelsea capacitor bank to the 128-518 termination postion	Dec-16	4



Greater Boston Projects, cont.

Status as of 4/18/2024

Plan Benefit: Addresses long-term system needs in the Greater Boston area and improves system reliability

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1520	Upgrade North Cambridge to mitigate 115 kV 5 and 10 stuck breaker contingencies	Dec-17	4
1643	Install a 200 MVAR STATCOM at Coopers Mills	Nov-18	4
1341, 1645	Install a 115 kV 36.7 MVAR capacitor bank at Hartwell	May-17	4
1646	Install a 345 kV 160 MVAR shunt reactor at K Street	Dec-19	4
1647	Install a 115 kV breaker in series with the 5 breaker at Framingham	Mar-17	4
1554	Install a 115 kV breaker in series with the 29 breaker at K Street	Apr-17	4

SEMA/RI Reliability Projects

Status as of 4/18/2024

Project Benefit: Addresses system needs in the Southeast Massachusetts/Rhode Island area

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1714	Construct a new 115 kV GIS switching station (Grand Army) which includes remote terminal station work at Brayton Point and Somerset substations, and the looping in of the E-183E, F-184, X3, and W4 lines	Oct-20	4
1742	Conduct remote terminal station work at the Wampanoag and Pawtucket substations for the new Grand Army GIS switching station	Oct-20	4
1715	Install upgrades at Brayton Point substation which include a new 115 kV breaker, new 345/115 kV transformer, and upgrades to E183E, F184 station equipment	Oct-20	4
1716	Increase clearances on E-183E & F-184 lines between Brayton Point and Grand Army substations	Nov-19	4
1717	Separate the X3/W4 DCT and reconductor the X3 and W4 lines between Somerset and Grand Army substations; reconfigure Y2 and Z1 lines	Nov-19	4

SEMA/RI Reliability Projects, cont.

Status as of 4/18/2024

Project Benefit: Addresses system needs in the Southeast Massachusetts/Rhode Island area

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1718	Add 115 kV circuit breaker at Robinson Ave substation and re-terminate the Q10 line	Mar-22	4
1719	Install 45.0 MVAR capacitor bank at Berry Street substation	Cancelled*	N/A
1720	Separate the N12/M13 DCT and reconductor the N12 and M13 between Somerset and Bell Rock substations	Mar-27	2
1721	Reconfigure Bell Rock to breaker-and-a-half station, split the M13 line at Bell Rock substation, and terminate 114 line at Bell Rock; install a new breaker in series with N12/D21 tie breaker, upgrade D21 line switch, and install a 37.5 MVAR capacitor	Aug-23	4
1722	Extend the Line 114 from the Dartmouth town line (Eversource-National Grid border) to Bell Rock substation	Dec-25	2
1723	Reconductor L14 and M13 lines from Bell Rock substation to Bates Tap	Cancelled*	N/A

*Cancelled per ISO-NE PAC presentation on August 27, 2020

SEMA/RI Reliability Projects, cont.

Status as of 4/18/2024

Project Benefit: Addresses system needs in the Southeast Massachusetts/Rhode Island area

RSP Project List ID	Upgrade	Expected/Actual In-Service	Present Stage
1725	Build a new 115 kV line from Bourne to West Barnstable substations which includes associated terminal work	May-24	3
1726	Separate the 135/122 DCT from West Barnstable to Barnstable substations	Dec-21	4
1727	Retire the Barnstable SPS	Nov-21	4
1728	Build a new 115 kV line from Carver to Kingston substations and add a new Carver terminal	Aug-23	4
1729	Install a new bay position at Kingston substation to accommodate new 115 kV line	Aug-23	4
1730	Extend the 114 line from the Eversource/National Grid border to the Industrial Park Tap	Dec-25	2

SEMA/RI Reliability Projects, cont.

Status as of 4/18/2024

Project Benefit: Addresses system needs in the Southeast Massachusetts/Rhode Island area

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1731	Install 35.3 MVAR capacitors at High Hill and Wing Lane substations	Dec-21	4
1732	Loop the 201-502 line into the Medway substation to form the 201-502N and 201-502S lines	Dec-25	3
1733	Separate the 325/344 DCT lines from West Medway to West Walpole substations	Cancelled**	N/A
1734	Reconductor and upgrade the 112 Line from the Tremont substation to the Industrial Tap	Jun-18	4
1736	Reconductor the 108 line from Bourne substation to Horse Pond Tap*	Oct-18	4
1737	Replace disconnect switches on 323 line at West Medway substation and replace 8 line structures	Aug-20	4

* Does not include the reconductoring work over the Cape Cod canal

** Cancelled per ISO-NE PAC presentation on August 27, 2020

SEMA/RI Reliability Projects, cont.

Status as of 4/18/2024

Project Benefit: Addresses system needs in the Southeast Massachusetts/Rhode Island area

RSP Project List ID	Upgrade	Expected/Actual In-Service	Present Stage
1741	Rebuild the Middleborough Gas and Electric portion of the E1 line from Bridgewater to Middleborough	Apr-19	4
1782	Reconductor the J16S line	May 22	4
1724	Replace the Kent County 345/115 kV transformer	Mar-22	4
1789	West Medway 345 kV circuit breaker upgrades	Apr-21	4
1790	Medway 115 kV circuit breaker replacements	Nov-20	4

Eastern CT Reliability Projects

Status as of 4/18/2024

Project Benefit: Addresses system needs in the Eastern Connecticut area

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1815	Reconductor the L190-4 and L190-5 line sections	Dec-24	3
1850	Install a second 345/115 kV autotransformer (4X) and one 345 kV breaker at Card substation	Dec-22	4
1851	Upgrade Card 115 kV to BPS standards	Dec-22	4
1852	Install one 115 kV circuit breaker in series with Card substation 4T	Feb-23	4
1853	Convert Gales Ferry substation from 69 kV to 115 kV	Nov-23	4
1854	Rebuild the 100 Line from Montville to Gales Ferry to allow operation at 115 kV	Jun-23	4

Eastern CT Reliability Projects, cont.

Status as of 4/18/2024

Project Benefit: Addresses system needs in the Eastern Connecticut area

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1855	Re-terminate the 100 Line at Montville station and associated work. Energize the 100 Line at 115 kV	Jun-23	4
1856	Rebuild 400-1 Line section to allow operation at 115 kV (Tunnel to Ledyard Jct.)	Feb-23	4
1857	Add one 115 kV circuit breaker and re-terminate the 400-1 line section into Tunnel substation. Energize 400 Line at 115 kV	Feb-23	4
1858	Rebuild 400-2 Line section to allow operation at 115 kV (Ledyard Jct. to Border Bus with CMEEC)	Sept-22	4
1859	Rebuild the 400-3 Line Section to allow operation at 115 kV (Gales Ferry to Ledyard Jct.)	Feb-23	4
1860	Install a 25.2 MVAR 115 kV capacitor and one capacitor breaker at Killingly	Dec-21	4

Eastern CT Reliability Projects, cont.

Status as of 4/18/2024

Project Benefit: Addresses system needs in the Eastern Connecticut area

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1861	Install one 345 kV series breaker with the Montville 1T	Nov-21	4
1862	Install a +55/-29 MVAR synchronous condenser with two 115 kV breakers at Shunock	Dec-23	4
1863	Install a 1% series reactor with bypass switch at Mystic, CT on the 1465 Line	Mar-22	4
1864	Convert the 400-2 Line Section to 115 kV (Border Bus to Buddington)	Feb-23	4
1904	Convert 69 kV equipment at Buddington to 115 kV to facilitate the conversion of the 400-2 line to 115 kV	Dec-23	4

New Hampshire Solution Projects

Status as of 4/18/2024

Project Benefit: Addresses system needs in the New Hampshire area

RSP Project List ID	Upgrade	Expected/Actual In-Service	Present Stage
1878	Install a +55/-32.2 MVAR synchronous condenser at N. Keene 115 kV Substation with a 115 kV breaker	Sep-24	3
1879	Install a +55/-32.2 MVAR synchronous condenser at Huckins Hill 115 kV Substation with a 115 kV breaker	May-24	3
1880	Install a +127/-50 MVAR synchronous condenser at Amherst 345 kV Substation with two 345 kV breakers	Sep-24	3
1881	Install two 50 MVAR capacitors on Line 363 near Seabrook Station with three 345 kV breakers	Oct-23	4



Upper Maine Solution Projects

Status as of 4/18/2024

Project Benefit: Addresses system needs in the Upper Maine area

RSP Project List ID	Upgrade	Expected/Actual In-Service	Present Stage
1882	Rebuild 21.7 miles of the existing 115 kV line Section 80 Highland-Coopers Mills 115 kV line	Dec-24	3
1883	Convert the Highland 115 kV substation to an eight breaker, breaker-and-a-half configuration with a bus connected 115/34.5 kV transformer	Jul-28	1
1884	Install a 15 MVAR capacitor at Belfast 115 kV substation	Jul-28	1
1885	Install a +50/-25 MVAR synchronous condenser at Highland 115 kV substation	Jul-28	1
1886	Install +50/-25 MVAR synchronous condenser at Boggy Brook 115 kV substation, and install a new 115 kV breaker to separate Line 67 from the proposed solution elements	Jun-24	3

Upper Maine Solution Projects, cont.


Status as of 4/18/2024

Project Benefit: Addresses system needs in the Upper Maine area

RSP Project List ID	Upgrade	Expected/ Actual In-Service	Present Stage
1887	Install 25 MVAR reactor at Boggy Brook 115 kV substation	Jun-24	3
1888	Install 10 MVAR reactor at Keene Road 115 kV substation	Apr-24	3
1889	Install three remotely monitored and controlled switches to split the existing Orrington reactors between the two Orrington 345/115 kV autotransformers	Cancelled *	N/A
1914	Install a new 80 MVAR reactor, reconfigure the existing two reactors at the 345 kV Orrington substation	Jun-25	2


* Cancelled per the Upper Maine Solutions Study Addendum that was published on January 11, 2024

Status of Tariff Studies as of April 1, 2024

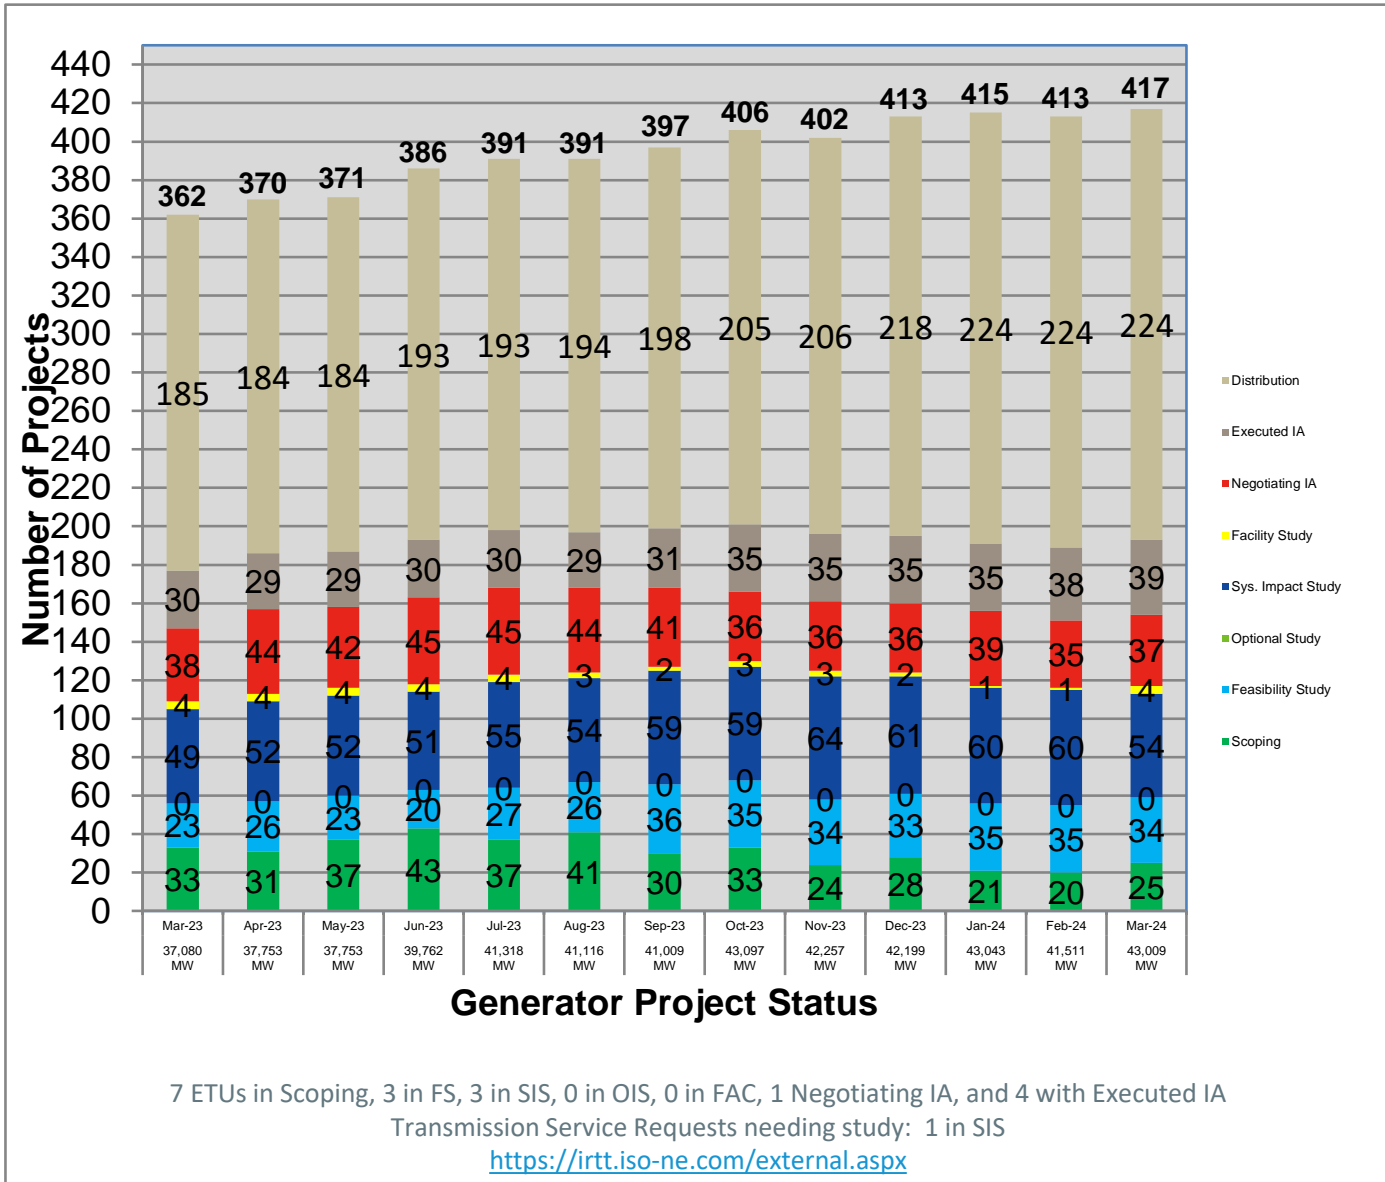

What is in the Queue (as of April 1, 2024)

Storage Projects are proposed as stand-alone storage or as co-located with wind or solar projects

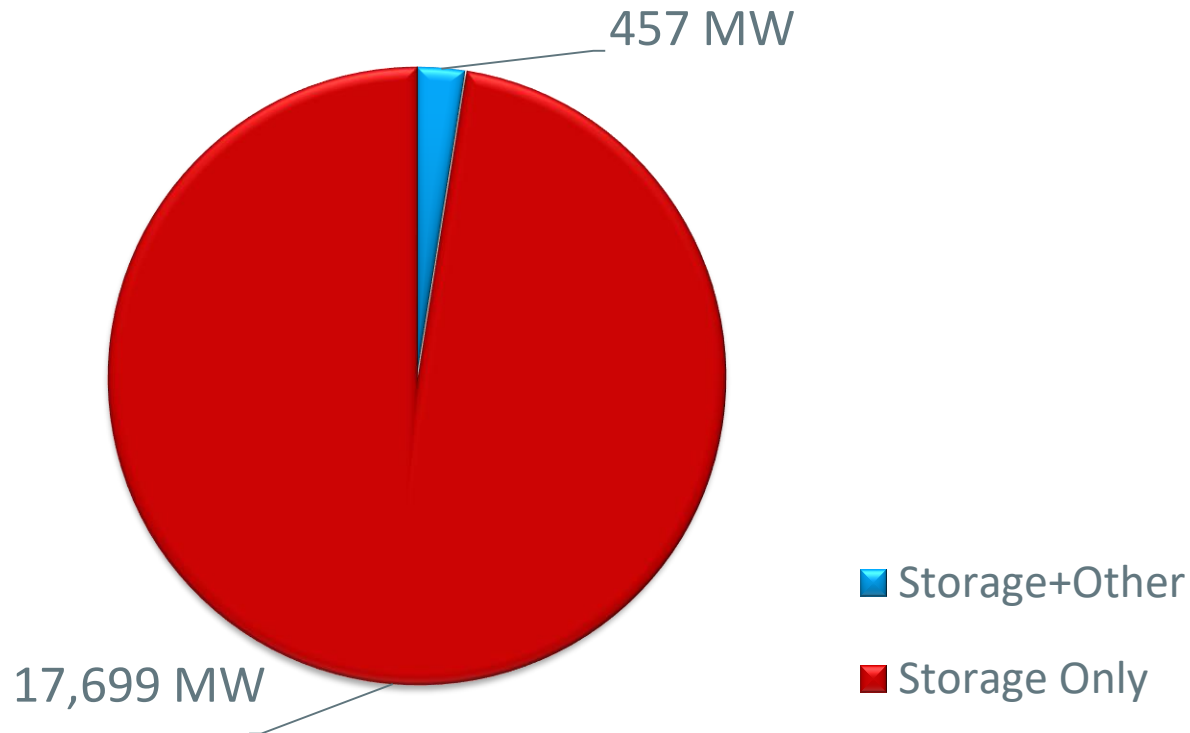

OPERABLE CAPACITY ANALYSIS

Spring 2024 Analysis

Spring 2024 Operable Capacity Analysis

50/50 Load Forecast (Reference)	May - 2024 ² CSO (MW)	May - 2024 ² SCC (MW)
Operable Capacity MW ¹	28,339	31,711
Active Demand Capacity Resource (+) ⁵	395	348
External Node Available Net Capacity, CSO imports minus firm capacity exports (+)	894	894
Non Commercial Capacity (+)	15	15
Non Gas-fired Planned Outage MW (-)	1,941	2,429
Gas Generator Outages MW (-)	2,418	2,861
Allowance for Unplanned Outages (-) ⁴	3,400	3,400
Generation at Risk Due to Gas Supply (-) ³	0	0
Net Capacity (NET OPCAP SUPPLY MW)	21,884	24,278
Peak Load Forecast MW (adjusted for Other Demand Resources) ²	18,909	18,909
Operating Reserve Requirement MW	2,305	2,305
Operable Capacity Required (NET LOAD OBLIGATION MW)	21,214	21,214
Operable Capacity Margin	670	3,064

¹Operable Capacity is based on data as of **April 23, 2024** and does not include Capacity associated with Settlement Only Generators, Passive and Active Demand Response, and external capacity. The Capacity Supply Obligation (CSO) and Seasonal Claim Capability (SCC) values are based on data as of **April 23, 2024**.

² Load forecast that is based on the 2024 CELT report and represents the week with the lowest Operable Capacity Margin, week beginning **May 11, 2024**.

³ Total of (Gas at Risk MW) – (Gas Gen Outages MW).

⁴ Allowance For Unplanned Outage MW is based on the month corresponding to the day with the lowest Operable Capacity Margin for the week.

⁵ Active Demand Capacity Resources (ADCRs) can participate in the Forward Capacity Market (FCM), have the ability to obtain a CSO and also participate in the Day-Ahead and Real-Time Energy Markets.

Spring 2024 Operable Capacity Analysis

90/10 Load Forecast	May - 2024 ² CSO (MW)	May - 2024 ² SCC (MW)
Operable Capacity MW ¹	28,339	31,711
Active Demand Capacity Resource (+) ⁵	395	348
External Node Available Net Capacity, CSO imports minus firm capacity exports (+)	894	894
Non Commercial Capacity (+)	15	15
Non Gas-fired Planned Outage MW (-)	1,941	2,429
Gas Generator Outages MW (-)	2,418	2,861
Allowance for Unplanned Outages (-) ⁴	3,400	3,400
Generation at Risk Due to Gas Supply (-) ³	0	0
Net Capacity (NET OPCAP SUPPLY MW)	21,884	24,278
Peak Load Forecast MW (adjusted for Other Demand Resources) ²	20,356	20,356
Operating Reserve Requirement MW	2,305	2,305
Operable Capacity Required (NET LOAD OBLIGATION MW)	22,661	22,661
Operable Capacity Margin	-777	1,617

¹Operable Capacity is based on data as of **April 23, 2024** and does not include Capacity associated with Settlement Only Generators, Passive and Active Demand Response, and external capacity. The Capacity Supply Obligation (CSO) and Seasonal Claim Capability (SCC) values are based on data as of **April 23, 2024**.

² Load forecast that is based on the 2024 CELT report and represents the week with the lowest Operable Capacity Margin, week beginning **May 11, 2024**.

³ Total of (Gas at Risk MW) – (Gas Gen Outages MW).

⁴ Allowance For Unplanned Outage MW is based on the month corresponding to the day with the lowest Operable Capacity Margin for the week.

⁵ Active Demand Capacity Resources (ADCRs) can participate in the Forward Capacity Market (FCM), have the ability to obtain a CSO and also participate in the Day-Ahead and Real-Time Energy Markets.

Spring 2024 Operable Capacity Analysis

50/50 Forecast (Reference)

ISO-NE OPERABLE CAPACITY ANALYSIS

April 23, 2024 - 50-50 FORECAST using CSO MW

This analysis is a tabulation of weekly assessments shown in one single table. The information shows the operable capacity situation under assumed conditions for each week. It is not expected that the system peak will occur every week in May.

Report created: 4/23/2024

Study Week (Week Beginning , Saturday)	CSO Supply Resource Capacity MW	CSO Demand Resource Capacity MW	External Node Capacity MW	Non-Commercial Capacity MW	CSO Non Gas- Only Generator Planned Outages MW	CSO Gas-Only Generator Planned Outages MW	Unplanned Outages Allowance MW	CSO Generation at Risk Due to Gas Supply 50- 50PLE MW	CSO Net Available Capacity MW	Peak Load Forecast 50- 50PLE MW	Operating Reserve Requirement MW	CSO Net Required Capacity MW	CSO Operable Capacity Margin MW	Season Min Opcap Margin Flag	Season_Label
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	
5/11/2024	28339	395	894	15	1941	2418	3400	0	21884	18909	2305	21214	670	Y	Spring 2024
5/18/2024	28339	395	894	15	1411	1808	3400	0	23024	19803	2305	22108	916	N	Spring 2024
5/25/2024	28339	395	894	15	98	843	3400	0	25302	20785	2305	23090	2212	N	Spring 2024

Column Definitions

- CSO Supply Resource Capacity MW:** Summation of all resource Capacity supply Obligations (CSO). Does not include Settlement Only Generators (SOG).
- CSO Demand Resource Capacity MW:** Demand resources known as Real-Time Demand Response (RTDR) will become Active Demand Capacity Resources (ADCRs) and can participate in the Forward Capacity market (FCM). These resources will have the ability to obtain a CSO and also participate in the Day-Ahead and Real-Time Energy Markets.
- External Node Capacity MW:** Sum of external Capacity Supply Obligations (CSO) imports and exports.
- Non-Commercial capacity MW:** New resources and generator improvements that have acquired a CSO but have not become commercial.
- CSO Non Gas-Only Generator Planned Outages MW:** All Non-Gas Planned Outages is the total of Non Gas-fired Generator/DARD Outages for the period. This value would also include any known long-term Non Gas-fired Forced Outages.Outages.
- CSO Gas-Only Generator Planned Outages MW:** All Planned Gas-fired generation outage for the period. This value would also include any known long-term Gas-fired Forced Outages.
- Unplanned Outage Allowance MW:** Forced Outages and Maintenance Outages scheduled less than 14 days in advance per ISO New England Operating Procedure No. 5 Appendix A.
- CSO Generation at Risk Due to Gas Supply MW:** Gas fired capacity expected to be at risk during cold weather conditions or gas pipeline maintenance outages.
- CSO Net Available Capacity MW:** the summation of columns (1+2+3+4-5-6-7-8=9)
- Peak Load Forecast MW:** Provided in the annual 2024 CELT Report and adjusted for Passive Demand Resources assumes Peak Load Exposure (PLE) and does include credit of Passive Demand Response (PDR) and behind-the-meter PV (BTM PV).
- Operating Reserve Requirement MW:** 120% of first largest contingency plus 50% of the second largest contingency.
- CSO Net Required Capacity MW:** (Net Load Obligation) (10+11=12)
- CSO Operable Capacity Margin MW:** CSO Net Available Capacity MW minus CSO Net Required Capacity MW (9-12=13)
- Operable Capacity Season Label:** Applicable season and year.
- Season Minimum Operable Capacity Flag:** this column indicates whether or not a week has the lowest capacity margin for its applicable season.

Spring 2024 Operable Capacity Analysis

90/10 Forecast

ISO-NE OPERABLE CAPACITY ANALYSIS

April 23, 2024 - 90/10 FORECAST using CSO MW

This analysis is a tabulation of weekly assessments shown in one single table. The information shows the operable capacity situation under assumed conditions for each week. It is not expected that the system peak will occur every week in May.

Report created: 4/23/2024

Study Week (Week Beginning , Saturday)	CSO Supply Resource Capacity MW	CSO Demand Resource Capacity MW	External Node Capacity MW	Non-Commercial Capacity MW	CSO Non Gas- Only Generator Planned Outages MW	CSO Gas-Only Generator Planned Outages MW	Unplanned Outages Allowance MW	CSO Generation at Risk Due to Gas Supply 90- 10PLE MW	CSO Net Available Capacity MW	Peak Load Forecast 90- 10PLE MW	Operating Reserve Requirement MW	CSO Net Required Capacity MW	CSO Operable Capacity Margin MW	Season Min Opcap Margin Flag	Season_Label
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
5/11/2024	28339	395	894	15	1941	2418	3400	0	21884	20356	2305	22661	-777	Y	Spring 2024
5/18/2024	28339	395	894	15	1411	1808	3400	0	23024	21309	2305	23614	-590	N	Spring 2024
5/25/2024	28339	395	894	15	98	843	3400	0	25302	22357	2305	24662	640	N	Spring 2024

Column Definitions

- CSO Supply Resource Capacity MW:** Summation of all resource Capacity supply Obligations (CSO). Does not include Settlement Only Generators (SOG).
- CSO Demand Resource Capacity MW:** Demand resources known as Real-Time Demand Response (RTDR) will become Active Demand Capacity Resources (ADCRs) and can participate in the Forward Capacity market (FCM). These resources will have the ability to obtain a CSO and also participate in the Day-Ahead and Real-Time Energy Markets.
- External Node Capacity MW:** Sum of external Capacity Supply Obligations (CSO) imports and exports.
- Non-Commercial capacity MW:** New resources and generator improvements that have acquired a CSO but have not become commercial.
- CSO Non Gas-Only Generator Planned Outages MW:** All Non-Gas Planned Outages is the total of Non Gas-fired Generator/DARD Outages for the period. This value would also include any known long-term Non Gas-fired Forced Outages.Outages.
- CSO Gas-Only Generator Planned Outages MW:** All Planned Gas-fired generation outage for the period. This value would also include any known long-term Gas-fired Forced Outages.
- Unplanned Outage Allowance MW:** Forced Outages and Maintenance Outages scheduled less than 14 days in advance per ISO New England Operating Procedure No. 5 Appendix A.
- CSO Generation at Risk Due to Gas Supply MW:** Gas fired capacity expected to be at risk during cold weather conditions or gas pipeline maintenance outages.
- CSO Net Available Capacity MW:** the summation of columns (1+2+3+4-5-6-7-8=9)
- Peak Load Forecast MW:** Provided in the annual 2024 CELT Report and adjusted for Passive Demand Resources assumes Peak Load Exposure (PLE) and does include credit of Passive Demand Response (PDR) and behind-the-meter PV (BTM PV).
- Operating Reserve Requirement MW:** 120% of first largest contingency plus 50% of the second largest contingency.
- CSO Net Required Capacity MW:** (Net Load Obligation) (10+11=12)
- CSO Operable Capacity Margin MW:** CSO Net Available Capacity MW minus CSO Net Required Capacity MW (9-12=13)
- Operable Capacity Season Label:** Applicable season and year.
- Season Minimum Operable Capacity Flag:** this column indicates whether or not a week has the lowest capacity margin for its applicable season.

*Highlighted week is based on the week determined by the 50/50 Load Forecast Reference week

OPERABLE CAPACITY ANALYSIS

Summer 2024 Analysis

Summer 2024 Operable Capacity Analysis

50/50 Load Forecast (Reference)	June - 2024 ² CSO (MW)	June - 2024 ² SCC (MW)
Operable Capacity MW ¹	27,304	27,406
Active Demand Capacity Resource (+) ⁵	427	380
External Node Available Net Capacity, CSO imports minus firm capacity exports (+)	1,134	1,134
Non Commercial Capacity (+)	315	315
Non Gas-fired Planned Outage MW (-)	236	260
Gas Generator Outages MW (-)	0	0
Allowance for Unplanned Outages (-) ⁴	2,800	2,800
Generation at Risk Due to Gas Supply (-) ³	0	0
Net Capacity (NET OPCAP SUPPLY MW)	26,144	26,175
Peak Load Forecast MW (adjusted for Other Demand Resources) ²	24,553	24,553
Operating Reserve Requirement MW	2,305	2,305
Operable Capacity Required (NET LOAD OBLIGATION MW)	26,858	26,858
Operable Capacity Margin	-714	-683

¹Operable Capacity is based on data as of **April 23, 2024** and does not include Capacity associated with Settlement Only Generators, Passive and Active Demand Response, and external capacity. The Capacity Supply Obligation (CSO) and Seasonal Claim Capability (SCC) values are based on data as of **April 23, 2024**.

² Load forecast that is based on the 2024 CELT report and represents the week with the lowest Operable Capacity Margin, week beginning **June 1, 2024**.

³ Total of (Gas at Risk MW) – (Gas Gen Outages MW).

⁴ Allowance For Unplanned Outage MW is based on the month corresponding to the day with the lowest Operable Capacity Margin for the week.

⁵ Active Demand Capacity Resources (ADCRs) can participate in the Forward Capacity Market (FCM), have the ability to obtain a CSO and also participate in the Day-Ahead and Real-Time Energy Markets.

Summer 2024 Operable Capacity Analysis

90/10 Load Forecast	June - 2024 ² CSO (MW)	June - 2024 ² SCC (MW)
Operable Capacity MW ¹	27,304	27,406
Active Demand Capacity Resource (+) ⁵	427	380
External Node Available Net Capacity, CSO imports minus firm capacity exports (+)	1,134	1,134
Non Commercial Capacity (+)	315	315
Non Gas-fired Planned Outage MW (-)	236	260
Gas Generator Outages MW (-)	0	0
Allowance for Unplanned Outages (-) ⁴	2,800	2,800
Generation at Risk Due to Gas Supply (-) ³	0	0
Net Capacity (NET OPCAP SUPPLY MW)	26,144	26,175
Peak Load Forecast MW (adjusted for Other Demand Resources) ²	26,383	26,383
Operating Reserve Requirement MW	2,305	2,305
Operable Capacity Required (NET LOAD OBLIGATION MW)	28,688	28,688
Operable Capacity Margin	-2,544	-2,513

¹ Operable Capacity is based on data as of **April 23, 2024** and does not include Capacity associated with Settlement Only Generators, Passive and Active Demand Response, and external capacity. The Capacity Supply Obligation (CSO) and Seasonal Claim Capability (SCC) values are based on data as of **April 23, 2024**.

² Load forecast that is based on the 2024 CELT report and represents the week with the lowest Operable Capacity Margin, week beginning **June 1, 2024**.

³ Total of (Gas at Risk MW) – (Gas Gen Outages MW).

⁴ Allowance For Unplanned Outage MW is based on the month corresponding to the day with the lowest Operable Capacity Margin for the week.

⁵ Active Demand Capacity Resources (ADCRs) can participate in the Forward Capacity Market (FCM), have the ability to obtain a CSO and also participate in the Day-Ahead and Real-Time Energy Markets.

Summer 2024 Operable Capacity Analysis

50/50 Forecast (Reference)

ISO-NE OPERABLE CAPACITY ANALYSIS

April 23, 2024 - 50-50 FORECAST using CSO MW

This analysis is a tabulation of weekly assessments shown in one single table. The information shows the operable capacity situation under assumed conditions for each week. It is not expected that the system peak will occur every week in June through mid September.

Report created: 4/23/2024

Study Week (Week Beginning , Saturday)	CSO Supply Resource Capacity MW	CSO Demand Resource Capacity MW	External Node Capacity MW	Non-Commercial Capacity MW	CSO Non Gas- Only Generator Planned Outages MW	CSO Gas-Only Generator Planned Outages MW	Unplanned Outages Allowance MW	CSO Generation at Risk Due to Gas Supply 50- 50PLE MW	CSO Net Available Capacity MW	Peak Load Forecast 50- 50PLE MW	Operating Reserve Requirement MW	CSO Net Required Capacity MW	CSO Operable Capacity Margin MW	Season Min Opcap Margin Flag	Season_Label
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	
6/1/2024	27304	427	1134	315	236	0	2800	0	26144	24553	2305	26858	-714	Y	Summer 2024
6/8/2024	27304	427	1194	315	240	0	2800	0	26200	24553	2305	26858	-658	N	Summer 2024
6/15/2024	27304	427	1194	315	235	0	2800	0	26205	24553	2305	26858	-653	N	Summer 2024
6/22/2024	27304	427	1194	315	235	0	2800	0	26205	24553	2305	26858	-653	N	Summer 2024
6/29/2024	27304	427	1194	315	283	0	2100	0	26857	24553	2305	26858	-1	N	Summer 2024
7/6/2024	27304	427	1194	315	421	0	2100	0	26719	24553	2305	26858	-139	N	Summer 2024
7/13/2024	27304	427	1194	315	434	0	2100	0	26706	24553	2305	26858	-152	N	Summer 2024
7/20/2024	27304	427	1194	315	416	0	2100	0	26724	24553	2305	26858	-134	N	Summer 2024
7/27/2024	27304	427	1194	315	286	0	2100	0	26854	24553	2305	26858	-4	N	Summer 2024
8/3/2024	27304	427	1194	315	353	0	2100	0	26787	24553	2305	26858	-71	N	Summer 2024
8/10/2024	27304	427	1194	315	340	0	2100	0	26800	24553	2305	26858	-58	N	Summer 2024
8/17/2024	27304	427	1194	315	321	0	2100	0	26819	24553	2305	26858	-39	N	Summer 2024
8/24/2024	27304	427	1194	315	328	0	2100	0	26812	24553	2305	26858	-46	N	Summer 2024
8/31/2024	27304	427	1194	315	303	31	2100	0	26806	24553	2305	26858	-52	N	Summer 2024
9/7/2024	27304	427	1194	315	342	41	2100	0	26757	24553	2305	26858	-101	N	Summer 2024
9/14/2024	27304	427	1194	315	434	10	2100	0	26696	24553	2305	26858	-162	N	Summer 2024

Column Definitions

- CSO Supply Resource Capacity MW:** Summation of all resource Capacity supply Obligations (CSO). Does not include Settlement Only Generators (SOG).
- CSO Demand Resource Capacity MW:** Demand resources known as Real-Time Demand Response (RTDR) will become Active Demand Capacity Resources (ADCRs) and can participate in the Forward Capacity market (FCM). These resources will have the ability to obtain a CSO and also participate in the Day-Ahead and Real-Time Energy Markets.
- External Node Capacity MW:** Sum of external Capacity Supply Obligations (CSO) imports and exports.
- Non-Commercial capacity MW:** New resources and generator improvements that have acquired a CSO but have not become commercial.
- CSO Non Gas-Only Generator Planned Outages MW:** All Non-Gas Planned Outages is the total of Non Gas-fired Generator/DARD Outages for the period. This value would also include any known long-term Non Gas-fired Forced Outages.
- CSO Gas-Only Generator Planned Outages MW:** All Planned Gas-fired generation outage for the period. This value would also include any known long-term Gas-fired Forced Outages.
- Unplanned Outage Allowance MW:** Forced Outages and Maintenance Outages scheduled less than 14 days in advance per ISO New England Operating Procedure No. 5 Appendix A.
- CSO Generation at Risk Due to Gas Supply MW:** Gas fired capacity expected to be at risk during cold weather conditions or gas pipeline maintenance outages.
- CSO Net Available Capacity MW:** the summation of columns (1+2+3+4-5-6-7-8-9)
- Peak Load Forecast MW:** Provided in the annual 2024 CELT Report and adjusted for Passive Demand Resources assumes Peak Load Exposure (PLE) and does include credit of Passive Demand Response (PDR) and behind-the-meter PV (BTM PV).
- Operating Reserve Requirement MW:** 120% of first largest contingency plus 50% of the second largest contingency.
- CSO Net Required Capacity MW:** (Net Load Obligation) (10+11=12)
- CSO Operable Capacity Margin MW:** CSO Net Available Capacity MW minus CSO Net Required Capacity MW (9-12=13)
- Operable Capacity Season Label:** Applicable season and year.
- Season Minimum Operable Capacity Flag:** this column indicates whether or not a week has the lowest capacity margin for its applicable season.

Summer 2024 Operable Capacity Analysis

90/10 Forecast

ISO-NE OPERABLE CAPACITY ANALYSIS

April 23, 2024 - 90/10 FORECAST using CSO MW

This analysis is a tabulation of weekly assessments shown in one single table. The information shows the operable capacity situation under assumed conditions for each week. It is not expected that the system peak will occur every week in June through mid September.

Report created: 4/23/2024

Study Week (Week Beginning , Saturday)	CSO Supply Resource Capacity MW	CSO Demand Resource Capacity MW	External Node Capacity MW	Non-Commercial Capacity MW	CSO Non Gas- Only Generator Planned Outages MW	CSO Gas-Only Generator Planned Outages MW	Unplanned Outages Allowance MW	CSO Generation at Risk Due to Gas Supply 90- 10PLE MW	CSO Net Available Capacity MW	Peak Load Forecast 90- 10PLE MW	Operating Reserve Requirement MW	CSO Net Required Capacity MW	CSO Operable Capacity Margin MW	Season Min Opcap Margin Flag	Season_Label
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	
6/1/2024	27304	427	1134	315	236	0	2800	0	26144	26383	2305	28688	-2544	Y	Summer 2024
6/8/2024	27304	427	1194	315	240	0	2800	0	26200	26383	2305	28688	-2488	N	Summer 2024
6/15/2024	27304	427	1194	315	235	0	2800	0	26205	26383	2305	28688	-2483	N	Summer 2024
6/22/2024	27304	427	1194	315	235	0	2800	0	26205	26383	2305	28688	-2483	N	Summer 2024
6/29/2024	27304	427	1194	315	283	0	2100	0	26857	26383	2305	28688	-1831	N	Summer 2024
7/6/2024	27304	427	1194	315	421	0	2100	0	26719	26383	2305	28688	-1969	N	Summer 2024
7/13/2024	27304	427	1194	315	434	0	2100	0	26706	26383	2305	28688	-1982	N	Summer 2024
7/20/2024	27304	427	1194	315	416	0	2100	0	26724	26383	2305	28688	-1964	N	Summer 2024
7/27/2024	27304	427	1194	315	286	0	2100	0	26854	26383	2305	28688	-1834	N	Summer 2024
8/3/2024	27304	427	1194	315	353	0	2100	0	26787	26383	2305	28688	-1901	N	Summer 2024
8/10/2024	27304	427	1194	315	340	0	2100	0	26800	26383	2305	28688	-1888	N	Summer 2024
8/17/2024	27304	427	1194	315	321	0	2100	0	26819	26383	2305	28688	-1869	N	Summer 2024
8/24/2024	27304	427	1194	315	328	0	2100	0	26812	26383	2305	28688	-1876	N	Summer 2024
8/31/2024	27304	427	1194	315	303	31	2100	0	26806	26383	2305	28688	-1882	N	Summer 2024
9/7/2024	27304	427	1194	315	342	41	2100	0	26757	26383	2305	28688	-1931	N	Summer 2024
9/14/2024	27304	427	1194	315	434	10	2100	0	26696	26383	2305	28688	-1992	N	Summer 2024

Column Definitions

- CSO Supply Resource Capacity MW:** Summation of all resource Capacity supply Obligations (CSO). Does not include Settlement Only Generators (SOG).
- CSO Demand Resource Capacity MW:** Demand resources known as Real-Time Demand Response (RTDR) will become Active Demand Capacity Resources (ADCRs) and can participate in the Forward Capacity market (FCM). These resources will have the ability to obtain a CSO and also participate in the Day-Ahead and Real-Time Energy Markets.
- External Node Capacity MW:** Sum of external Capacity Supply Obligations (CSO) imports and exports.
- Non-Commercial capacity MW:** New resources and generator improvements that have acquired a CSO but have not become commercial.
- CSO Non Gas-Only Generator Planned Outages MW:** All Non-Gas Planned Outages is the total of Non Gas-fired Generator/DARD Outages for the period. This value would also include any known long-term Non Gas-fired Forced Outages.Outages.
- CSO Gas-Only Generator Planned Outages MW:** All Planned Gas-fired generation outage for the period. This value would also include any known long-term Gas-fired Forced Outages.
- Unplanned Outage Allowance MW:** Forced Outages and Maintenance Outages scheduled less than 14 days in advance per ISO New England Operating Procedure No. 5 Appendix A.
- CSO Generation at Risk Due to Gas Supply MW:** Gas fired capacity expected to be at risk during cold weather conditions or gas pipeline maintenance outages.
- CSO Net Available Capacity MW:** the summation of columns (1+2+3+4-5-6-7-8=9)
- Peak Load Forecast MW:** Provided in the annual 2024 CELT Report and adjusted for Passive Demand Resources assumes Peak Load Exposure (PLE) and does include credit of Passive Demand Response (PDR) and behind-the-meter PV (BTM PV).
- Operating Reserve Requirement MW:** 120% of first largest contingency plus 50% of the second largest contingency.
- CSO Net Required Capacity MW:** (Net Load Obligation) (10+11=12)
- CSO Operable Capacity Margin MW:** CSO Net Available Capacity MW minus CSO Net Required Capacity MW (9-12=13)
- Operable Capacity Season Label:** Applicable season and year.
- Season Minimum Operable Capacity Flag:** this column indicates whether or not a week has the lowest capacity margin for its applicable season.

*Highlighted week is based on the week determined by the 50/50 Load Forecast Reference week

Possible Relief Under OP4: Appendix A

OP 4 Action Number	Page 1 of 2 Action Description	Amount Assumed Obtainable Under OP 4 (MW)
1	Implement Power Caution and advise Resources with a CSO to prepare to provide capacity and notify "Settlement Only" generators with a CSO to monitor reserve pricing to meet those obligations. Begin to allow the depletion of 30-minute reserve.	0 ¹ 600
2	Declare Energy Emergency Alert (EEA) Level 1 ⁴	0
3	Voluntary Load Curtailment of Market Participants' facilities.	40 ²
4	Implement Power Watch	0
5	Schedule Emergency Energy Transactions and arrange to purchase Control Area-to-Control Area Emergency	1,000
6	Voltage Reduction requiring > 10 minutes	125 ³

NOTES:

1. Based on Summer Ratings. Assumes 25% of total MW Settlement Only units <5 MW will be available and respond.
2. The actual load relief obtained is highly dependent on circumstances surrounding the appeals, including timing and the amount of advanced notice that can be given.
3. The MW values are based on a 25,000 MW system load and verified by the most recent voltage reduction test.
4. EEA Levels are described in Attachment 1 to NERC Reliability Standard EOP-011 - Emergency Operations



Possible Relief Under OP4: Appendix A

OP 4 Action Number	Page 2 of 2 Action Description	Amount Assumed Obtainable Under OP 4 (MW)
7	Request generating resources not subject to a Capacity Supply Obligation to voluntarily provide energy for reliability purposes	0
8	5% Voltage Reduction requiring 10 minutes or less	250 ³
9	Transmission Customer Generation Not Contractually Available to Market Participants during a Capacity Deficiency. Voluntary Load Curtailment by Large Industrial and Commercial Customers.	5 200 ²
10	Radio and TV Appeals for Voluntary Load Curtailment Implement Power Warning	200 ²
11	Request State Governors to Reinforce Power Warning Appeals.	100 ²
Total		2,520

NOTES:

1. Based on Summer Ratings. Assumes 25% of total MW Settlement Only units <5 MW will be available and respond.
2. The actual load relief obtained is highly dependent on circumstances surrounding the appeals, including timing and the amount of advanced notice that can be given.
3. The MW values are based on a 25,000 MW system load and verified by the most recent voltage reduction test.
4. EEA Levels are described in Attachment 1 to NERC Reliability Standard EOP-011 - Emergency Operations