


Note: The relevant Markets, Services and Transmission Tariff and the relevant Market Manuals, Operating Procedures and Planning Procedures shall govern.

Acronyms	
Acronym / Terms	Definition
ACP	Actual Capacity Provided
ADCR	Active Demand Capacity Resource
CCP	Capacity Commitment Period
CSC	Capacity Scarcity Condition
CSO	Capacity Supply Obligation
CZ	Capacity Zone
DG	Distributed Generation
DRR	Demand Response Resource
EE	Energy Efficiency
FCA	Forward Capacity Auction
LM	Load Management
Minimum Total	CSC due to deficiency in System-Wide Thirty-Minute Operating Reserve
PFP	Pay-for-Performance
T&D Loss Factor	Transmission and Distribution Loss Factor
Ten-Minute	CSC due to deficiency in Ten-Minute Reserve
TMOR	Thirty Minute Operating Reserve
Zonal	CSC due to deficiency in Local Thirty-Minute Operating Reserve
Related Calculation Summaries	
Calculation Summary	Related Market
fcm_pfp_pmt_calc_sum.vsd	FCM
Related Market Information Server (MIS) and World-wide Web (WW) Reports	
Report Code	Report Long Name
SD_FCMPFPACP	Forward Capacity Market Pay for Performance Actual Capacity Provided Report
SD_FCMPFPSCORE	Forward Capacity Market Pay for Performance Capacity Performance Score Report
SD_FCMPFPSPBT	Forward Capacity Market Pay for Performance Capacity Performance Score Bilateral


5-Minute Interval , Asset

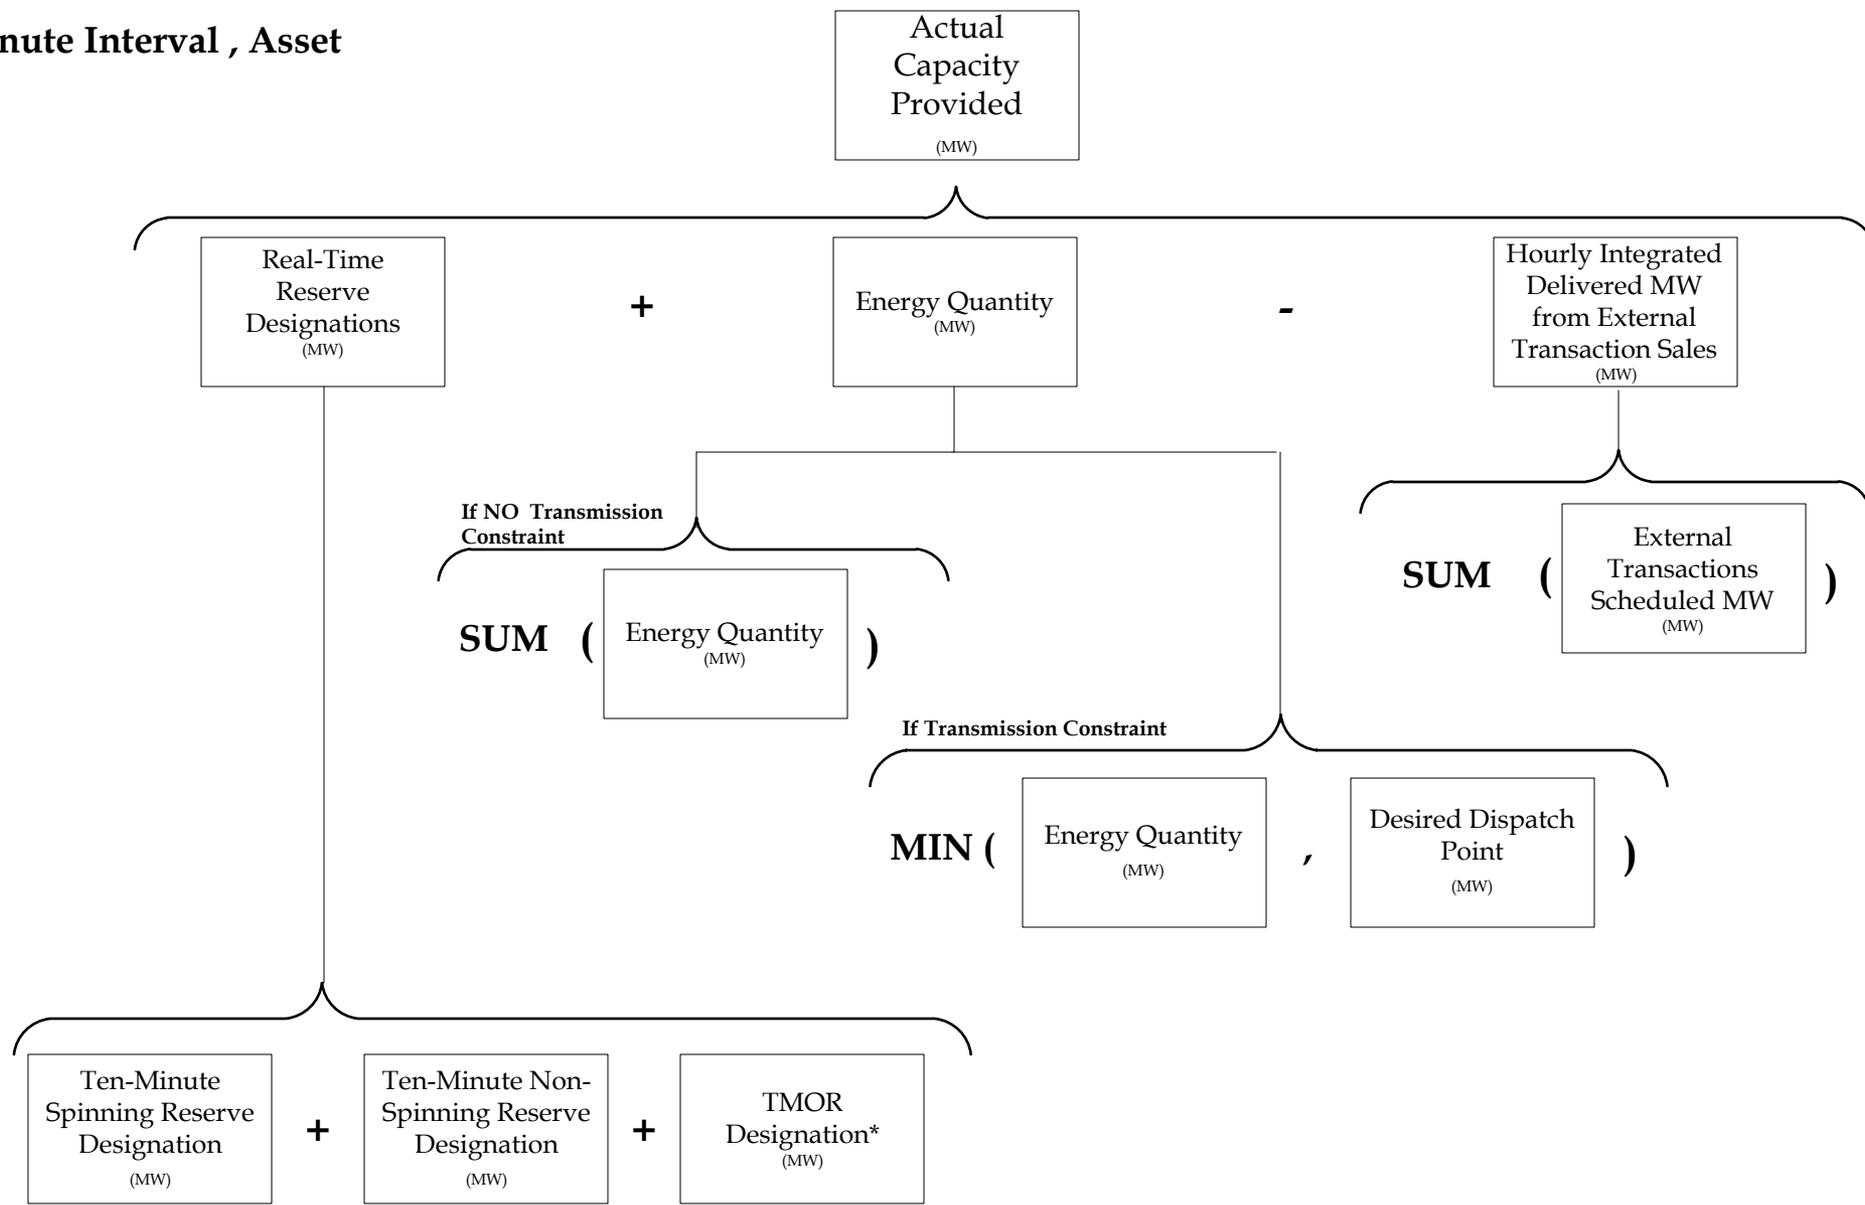


* Not included if Ten-Minute CSC

5-Minute Interval

Imports backed by an Import Resource

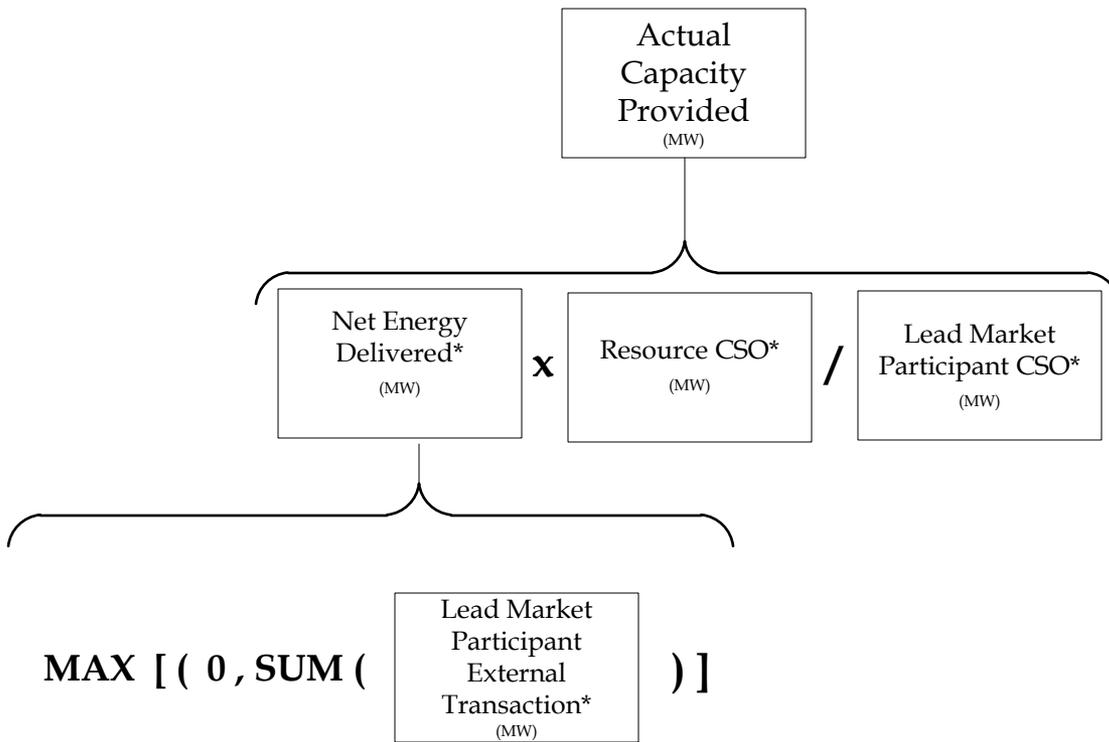


Imports not backed by an Import Resource

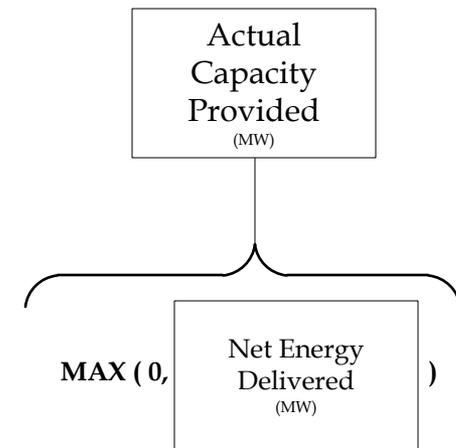

* If Zonal CSC, these values for affected Capacity Zone only

**5-Minute Interval
Asset**



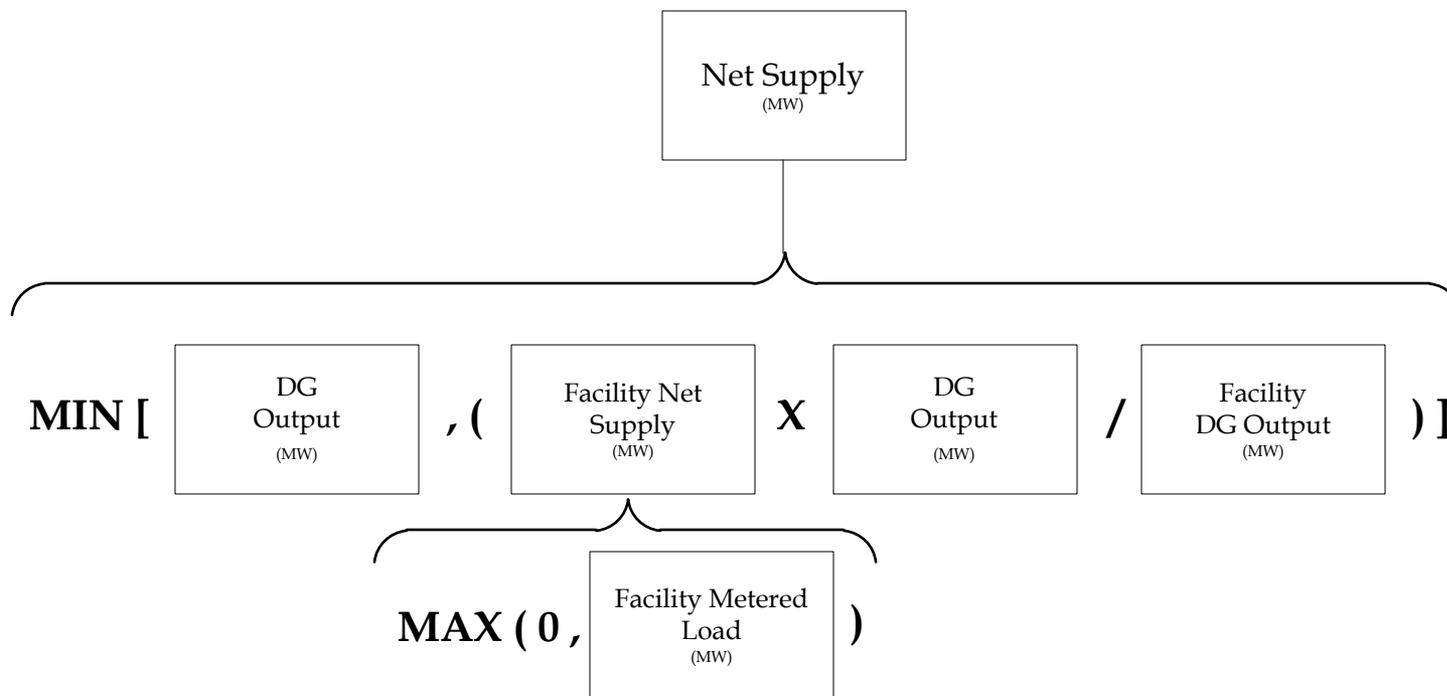


5-Minute Interval, Passive Demand Assets

Distributed Generation (DG)

Load Management (LM)


Energy Efficiency (EE) Calculated only for Peak Hours

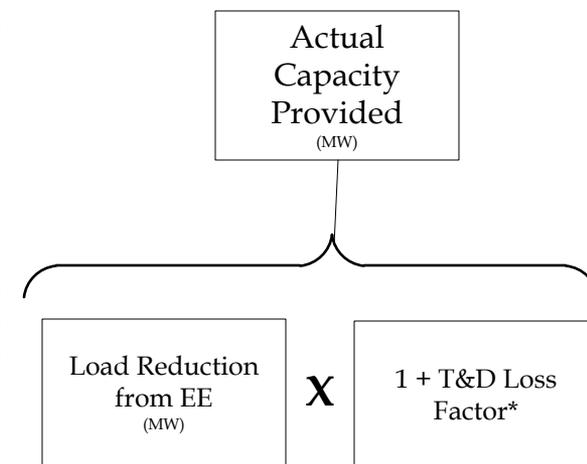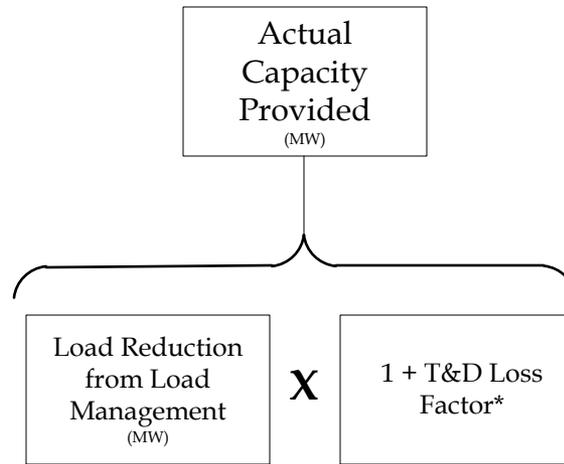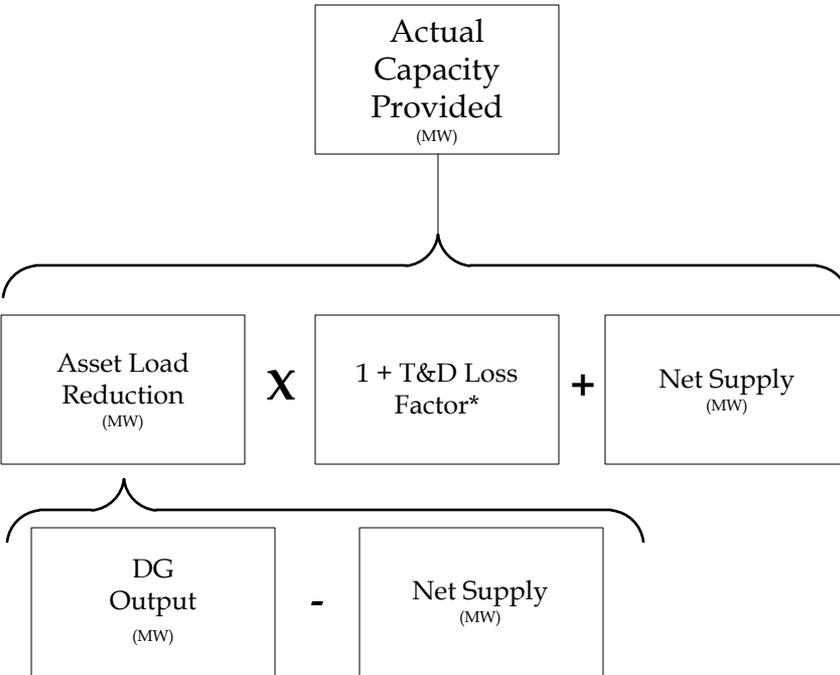

* Current value of T&D Loss Factor is 0.08

5-Minute Interval

Demand Response Resource (DRR)

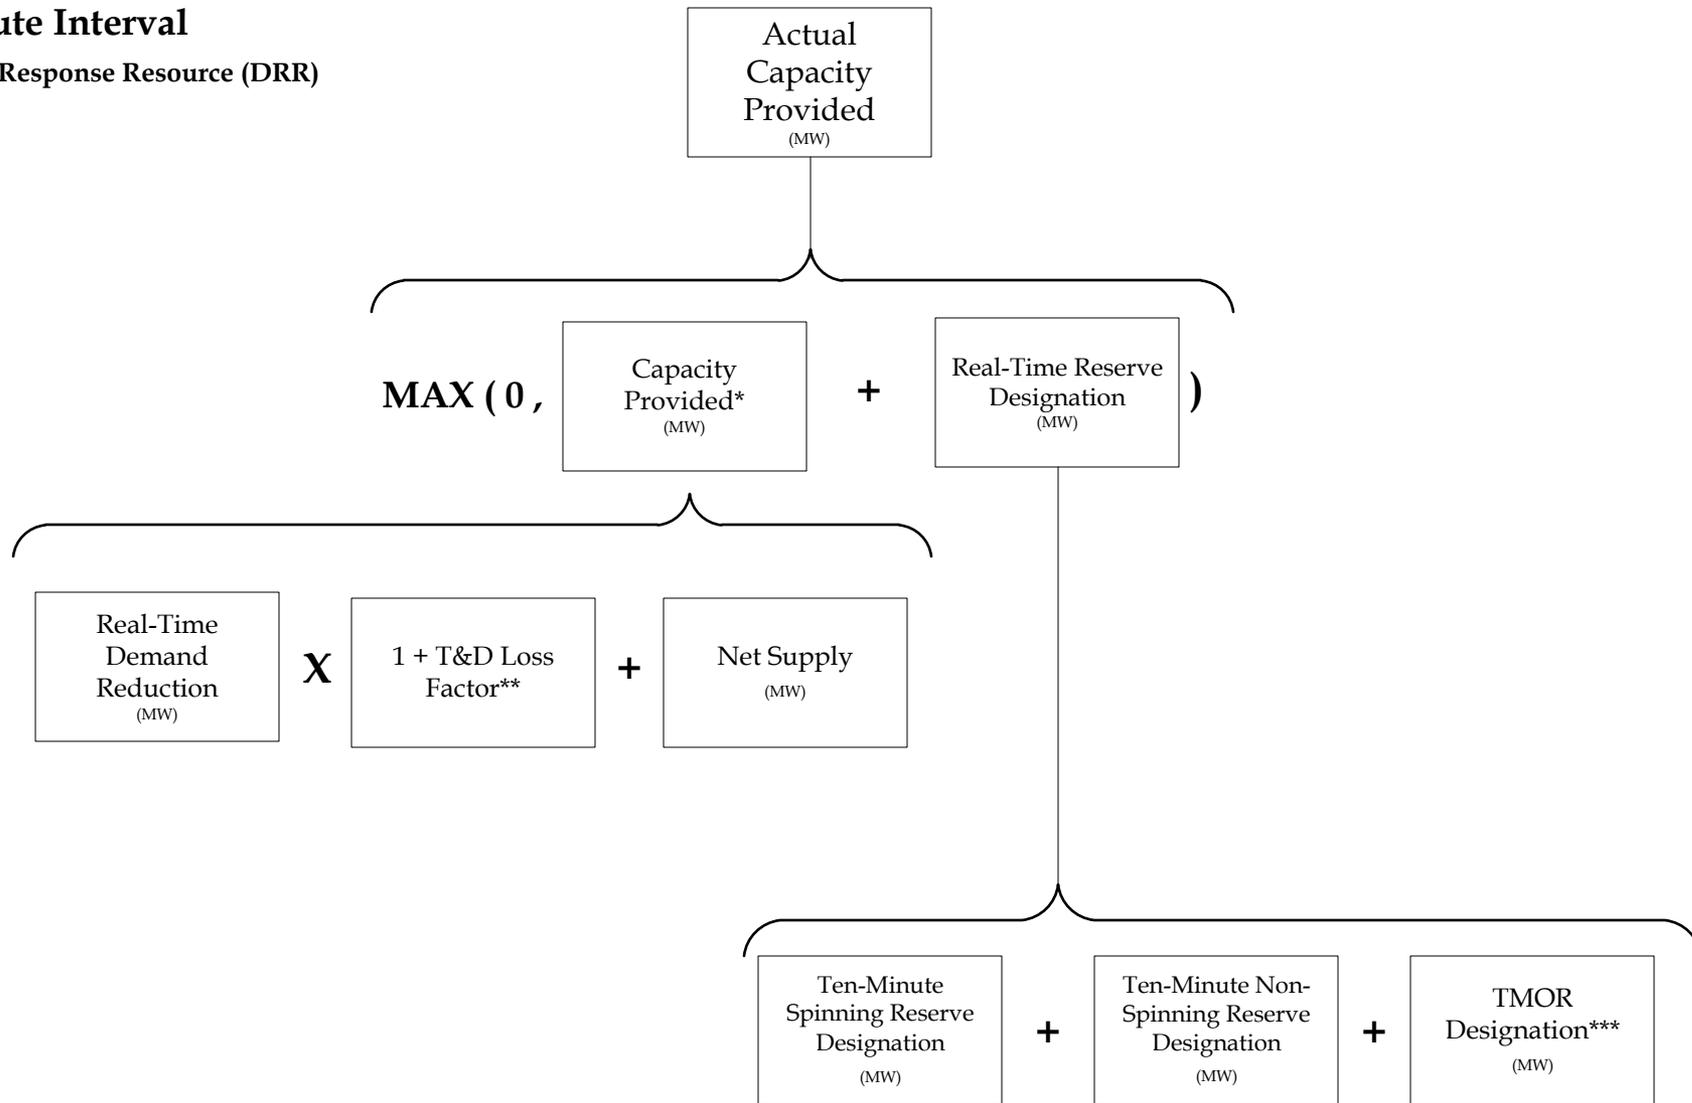


* If there is a transmission constraint, minimum of the Capacity provided or the desired dispatch point

** Current value of T&D Loss Factor is 0.08


*** Not included if Ten-Minute CSC

Note: The relevant Markets, Services and Transmission Tariff and the relevant Market Manuals, Operating Procedures and Planning Procedures shall govern.


5-Minute Interval

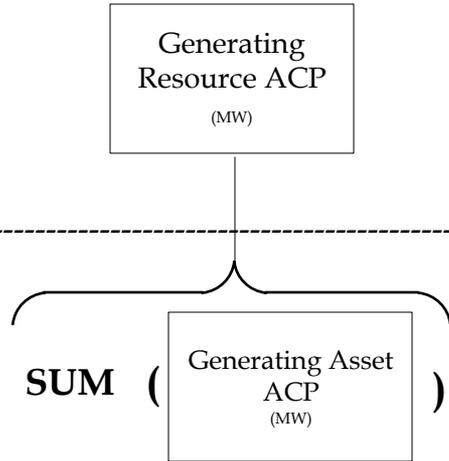

On-Peak and Seasonal Peak

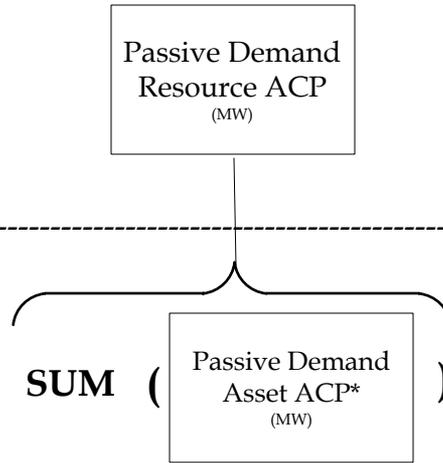


* DG, LM, EE

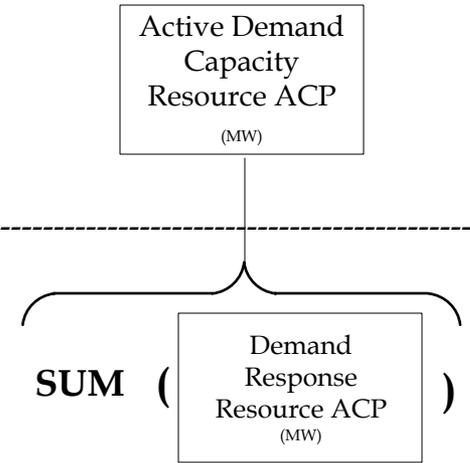

Note: Entities without CSO MW are eligible for ACP calculation but are not rolled up into a resource level.

Pool

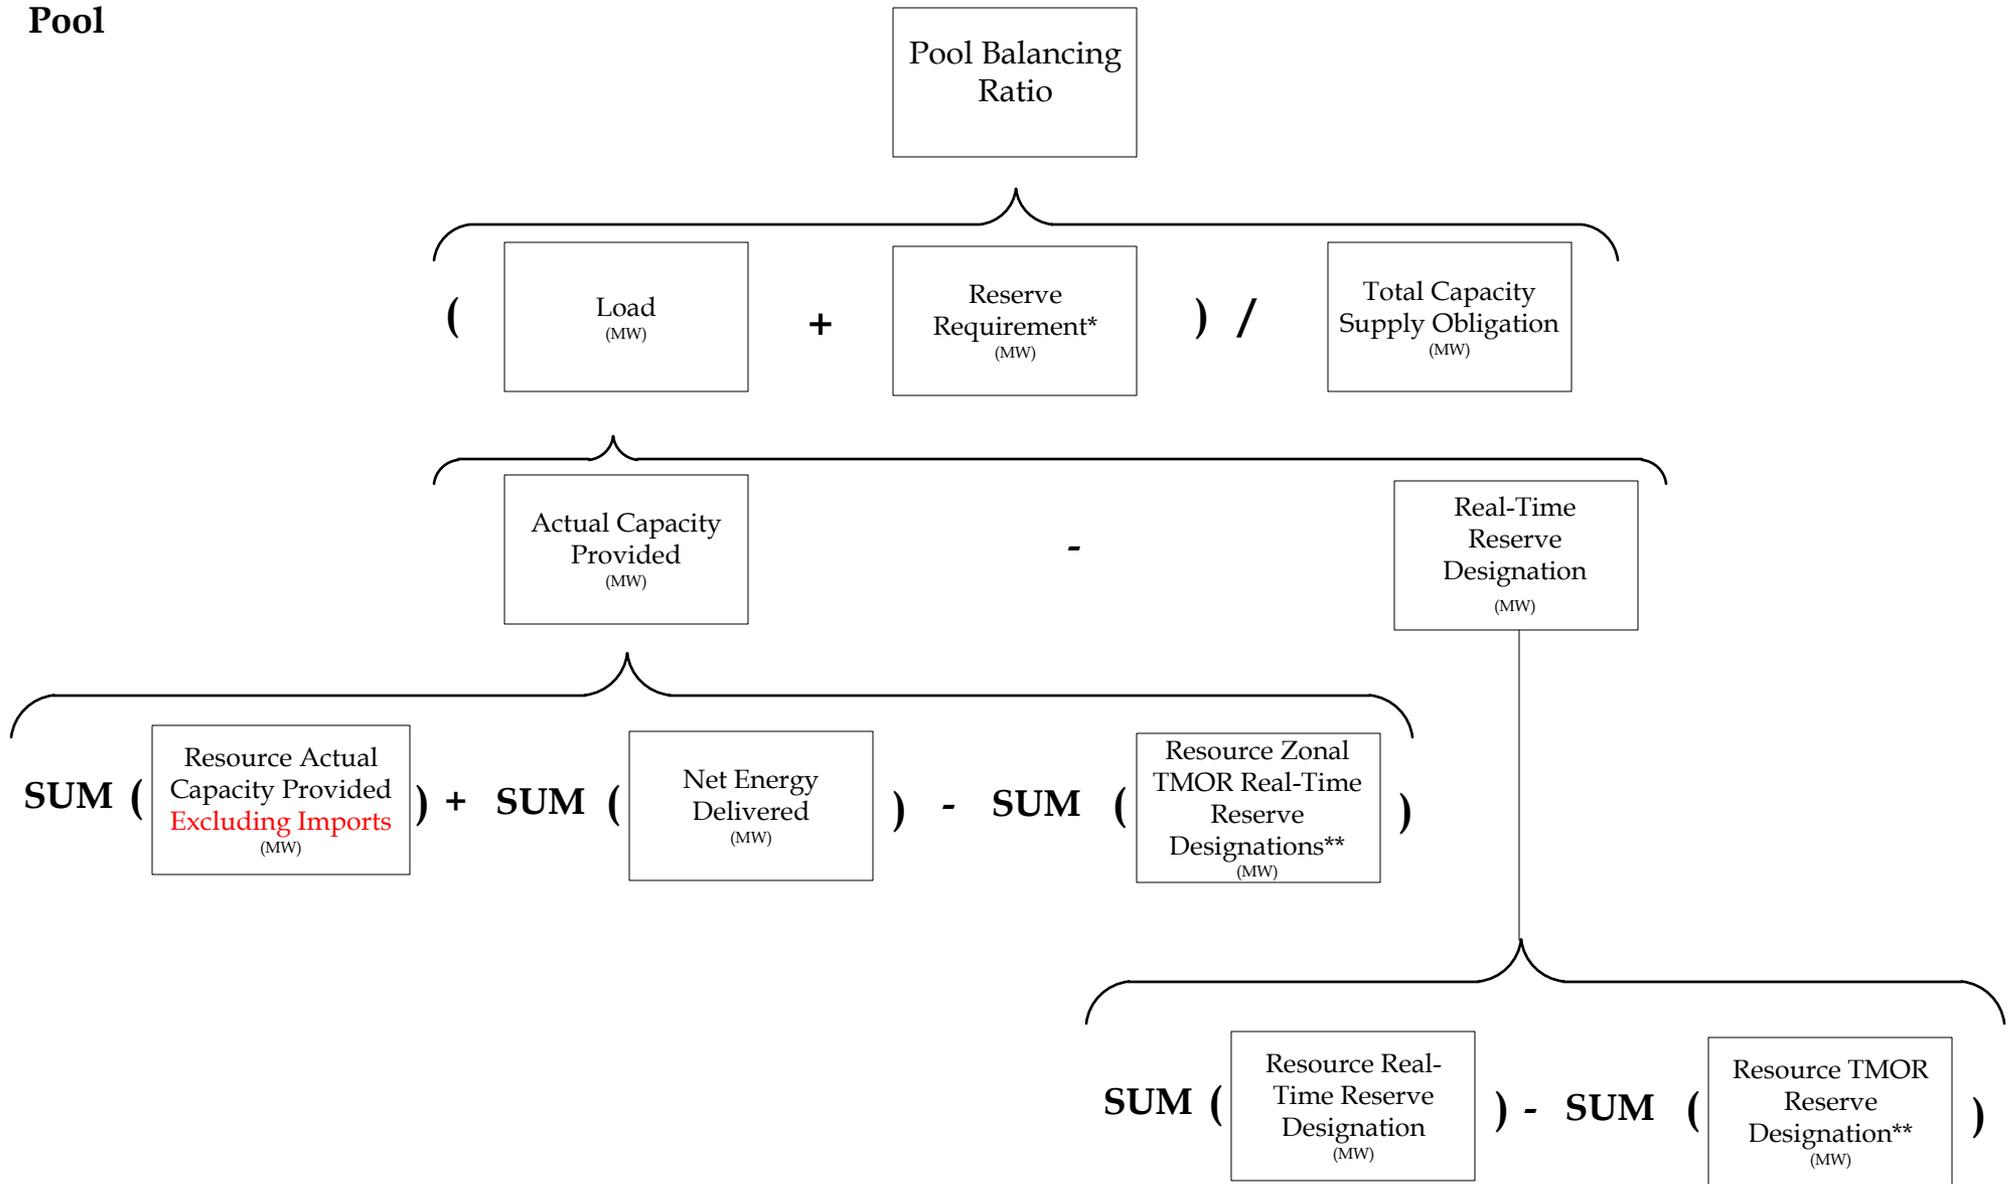


* If it is a Minimum Total CSC, Minimum Total Reserve Requirement otherwise, Ten-Minute Reserve Requirement.

** Only applies if there are Ten-Minute CSC and Zonal CSC in any Capacity Zone, but not a Minimum Total CSC


5-Minute Interval

Zonal Capacity Scarcity Condition

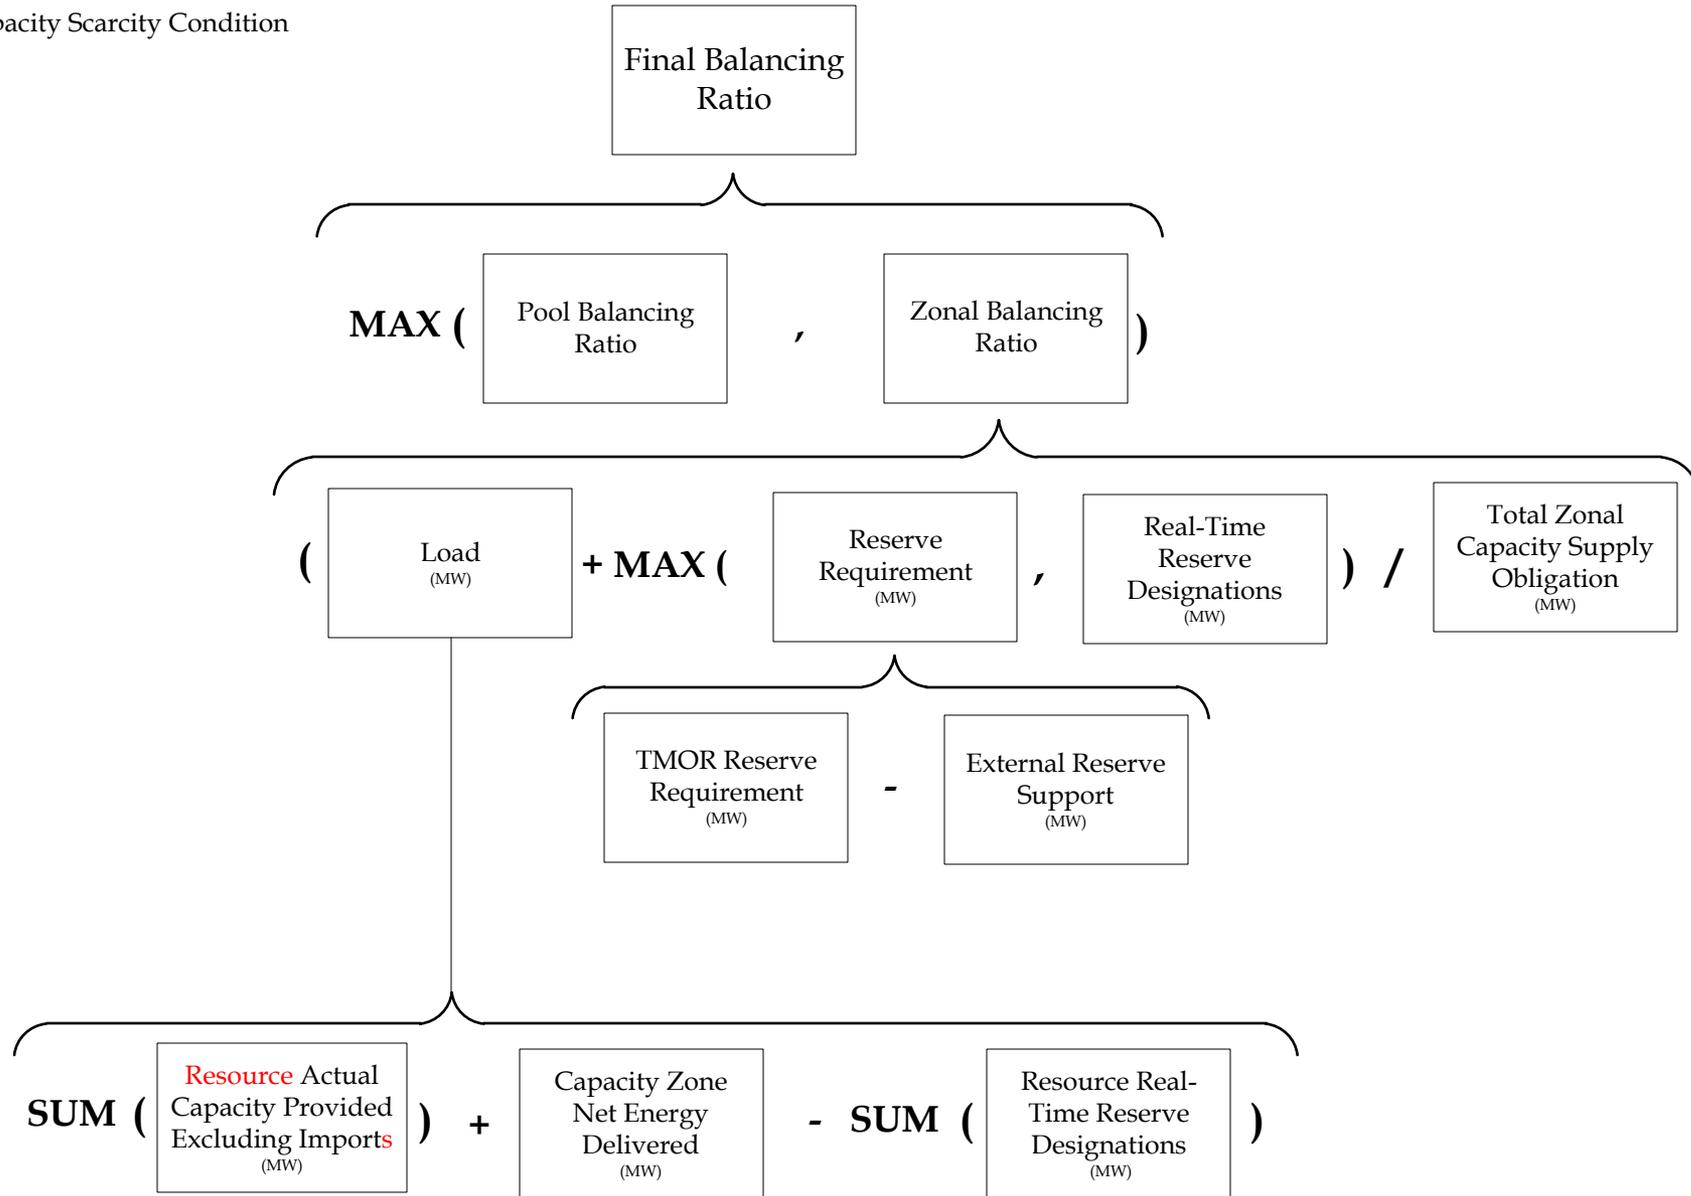

5-Minute Interval

Capacity Performance Score

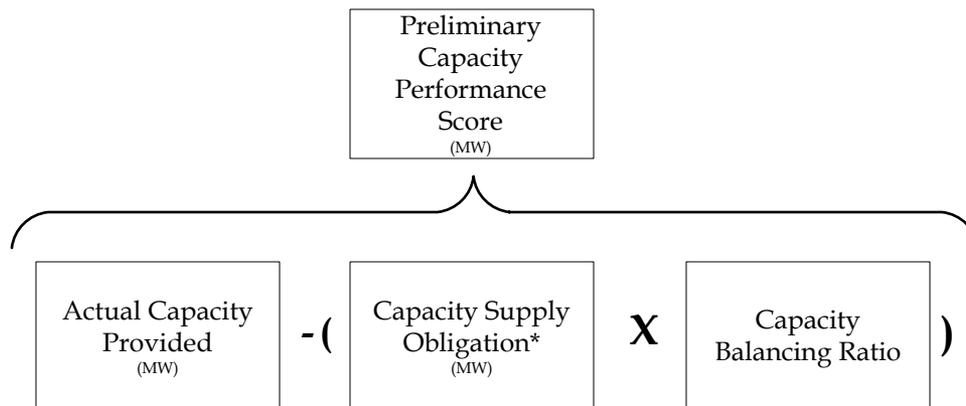

* If interval is a non-peak hour, the CSO MW for Passive Resources will be adjusted by Energy Efficiency Exempt CSO MW.