

ISO New England Operating Procedure No. 18 Metering and Telemetry Criteria (OP-18)

Effective Date: **draft**

Formatted: Highlight

Deleted: March 5, 2020

REFERENCES:

ISO New England Inc. Transmission, Markets, and Services Tariff Section I - General Terms and Conditions Section I.3.9 Review of Market Participant's Proposed Plans

ISO New England Market Rules and Procedures

ISO New England Planning Procedure No.11 - Planning Procedure to Support Geomagnetic Disturbance Analysis (PP11)

ISO New England Operating Procedure No. 14 - Technical Requirements for Generators, Demand Response Resources, Asset Related Demands and Alternative Technology Regulation Resources (OP-14)

ISO New England Operating Procedure No. 17 - Load Power Factor Correction (OP-17)

ISO New England Manual for Market Rule 1 Accounting Manual M-28 (Manual M-28)

ISO New England Manual for Definitions and Abbreviations Manual M-35 (Manual M-35)

ISO New England Manual for Registration and Performance Auditing Manual M-RPA (Manual M-RPA)

[NERC IRO-002-6 - Reliability Coordination – Monitoring and Analysis](#)

Formatted: Font: (Default) Arial, 12 pt

[NERC IRO-010-2 - Reliability Coordinator Data Specification and Collection](#)

Formatted: Font: (Default) Arial, 12 pt

[NERC IRO-018-1\(i\) - Reliability Coordinator Real-time Reliability Monitoring and Analysis Capabilities](#)

*This document is controlled when viewed on the ISO New England Internet web site. When downloaded and printed, this document becomes **UNCONTROLLED**, and users should check the Internet web site to ensure that they have the latest version. In addition, a Controlled Copy is available in the Master Control Room procedure binders at the ISO.*

Deleted: 19

Deleted: March 5, 2020

Revision **20**, Effective Date: **draft**

Hard Copy Uncontrolled
Page 1 of 30

ISO-NE PUBLIC

TABLE OF CONTENTS

I.	PURPOSE.....	4
II.	IMPLEMENTATION.....	4
III.	METERING, RECORDING AND TELEMETERING ON INTERCONNECTIONS WITH SYSTEMS OUTSIDE NEW ENGLAND.....	6
A.	Overall Requirements.....	6
B.	Instantaneous Megawatts and Megavars.....	6
C.	Megawatt-hours per Hour.....	7
IV.	METERING AND RECORDING FOR SETTLEMENTS.....	7
A.	Overall Requirements.....	7
B.	Wh Metering and MWh per Hour Data.....	7
C.	Generator Assets.....	9
D.	Tie-Line Assets.....	9
E.	Load Assets.....	10
V.	INTERNAL NEW ENGLAND METERING AND TELEMETERING FOR DISPATCH, MARKET, AND RELIABILITY PURPOSES.....	10
A.	Generator Asset, Alternative Technology Regulation Resources (ATRR) and Load Telemetry Criteria 10	
B.	Transmission System Telemetry Criteria.....	12
C.	Telemetered Data Scan Rates.....	14
D.	Telemetered Data Criteria.....	14
E.	Non-Telemetered Data Criteria.....	15
F.	Telemetered Data Identification.....	15
VI.	METERING FOR POWER FACTOR MEASUREMENT PURPOSES.....	15
VII.	EQUIPMENT STANDARDS FOR NEW AND UPGRADED INSTALLATIONS.....	15
A.	ANSI Standards.....	16
B.	Specific ISO New England Standards.....	16
VIII.	REQUIREMENTS FOR DATA COMMUNICATIONS EQUIPMENT FOR TELEMETERING SYSTEMS	17
IX.	TESTING, CALIBRATION AND MAINTENANCE STANDARDS.....	18
A.	Overall Requirements.....	18
B.	Overall Telemetry System Test.....	18
C.	Telemetry Component Tests.....	18
D.	Watt-hour Meters.....	20
E.	Instrument Transformers.....	25
F.	Test Equipment.....	25
G.	Record Keeping and Auditing.....	26
H.	Notifications.....	26
X.	SECURITY OF METERED AND RECORDED DATA.....	26
XI.	COMPLIANCE.....	26
XII.	Definitions.....	26
OP-18	Revision History.....	29

Deleted: 8

Deleted: 13

Deleted: 14

Deleted: 14

Deleted: 15

Deleted: 15

Deleted: 16

Deleted: 17

Deleted: 17

Deleted: 17

Deleted: 17

Deleted: 19

Deleted: 24

Deleted: 24

Deleted: 24

Deleted: 25

Deleted: 25

Deleted: 25

Deleted: 27

Deleted: 19

Deleted: March 5, 2020

APPENDICES:

Appendix A - ISO New England ICCP CNP Node Requirement

Appendix B - Retired (08/06/13)

Appendix C - Minimum Accuracy Standards For New And Upgraded Metering, Recording
And Telemetry Installations And For Calibration Of Existing Equipment

Appendix D - OP-18 Metering and Telemetry Diagrams

Appendix E - OP-18 Metering and Telemetry for Pseudo Combined Cycle Generator

Appendix F - ISO Communications Front End (CFE) Interface Specifications (Confidential)

Appendix G - Price Responsive Demand RTU Specification (Confidential)

Deleted: 19

Deleted: March 5, 2020

I. PURPOSE

This Operating Procedure (OP) establishes standards for metering (measurement) and telemetry (data transmission) for the purposes of ISO New England (ISO) dispatching, market settlement, Transmission Owner (TO) and Market Participant (MP) peak load determination, factors that impact voting shares and load power factor (lpf) measurement. This OP identifies the power system parameters that each TO and MP are to meter and/or telemeter. This OP also establishes standards to verify that the equipment that each TO or MP installs can provide an appropriate level of accuracy and/or appropriate recordings for audit purposes. This OP further prescribes maintenance procedures and schedules to be followed by each TO and MP so that the attainable level of accuracy may be realized.

There may be additional metering and telemetry requirements established by local state utility control and distribution utilities.

II. IMPLEMENTATION

A. Applicability

1. Each TO and/or MP shall have in-service all the metering, recording and telemetry equipment necessary to meet the requirements of this OP as described in Sections II.A.2 and II.A.3 of this OP.
2. For new and Non-Emergency Replacement Equipment, all requirements described in this OP shall be met on or before the date when the asset, line, or system commences operation.
 - a. The operational commencement date shall include all test power activities unless the ISO determines that compliance with the requirements is not necessary during test power activities.
 - b. Starting on the operational commencement date, each TO and/or MP shall meet all testing, calibration, and maintenance requirements established in this OP.
 - c. If any requirement of this OP cannot be met by the operational commencement date, then, prior to the operational commencement date, the TO and/or MP shall submit a mitigation plan request or an exemption request pursuant to, respectively, Section II.B or Section II.C of this OP.
3. Equipment existing prior to the effective date of the current version of this OP (i.e., <enter effective date>) ("Pre-existing Equipment") shall meet the requirements of this OP as described in this Section II.A.3.
 - a. Pre-existing Equipment shall meet the currently effective version of the requirements in Sections III, IV, V, and VI of this OP.
 - b. Pre-existing Equipment shall be required to be compliant with the version of the requirements in Sections VII and VIII of this OP that was in effect when the equipment commenced operation.
 - c. For any Pre-existing Equipment that is found to not meet the requirements of this OP as described above in Sections II.A.3.a and II.A.3.b, the TO/MP shall submit a mitigation plan request or an exemption request within 30 calendar days of the finding.

Deleted: March 5, 2020

Deleted: 19

Deleted: March 5, 2020

- d. If the ISO observes that the Pre-Existing equipment shows a severe anomaly, then the ISO may require that the equipment be replaced or repaired in order for it to meet the currently effective version of all the requirements of this OP.

B. Mitigation Plan Requests

1. A TO and/or MP shall submit a mitigation plan request for one or more of the requirements of this OP when a non-compliant condition is identified (as described in Sections II.A.2.c and II.A.3.c of this OP), if such condition may be corrected in order to meet the requirements of this OP.
2. Included with the request, the TO and/or MP shall provide:
 - a. A list of the requirement(s) for which the mitigation plan request is being submitted.
 - b. A proposed mitigation plan that describes the actions that will be taken to comply with any outstanding requirements as well as the deadlines for each of those actions.
3. The mitigation plan request shall be submitted to the ISO Customer Service and Training staff.
4. The ISO may request supporting documentation after it reviews the mitigation plan request.
5. The ISO, at its sole discretion, may grant or deny the mitigation plan request.
 - a. If the ISO grants the mitigation plan, then the TO and/or MP shall meet the deadlines for compliance with the requirements of this OP as established in the accepted mitigation plan.
 - b. For new and Non-Emergency Replacement Equipment, if the ISO does not accept the mitigation plan, then the TO or MP shall comply with the requirements of this OP on the operational commencement date described in Section II.A.2.a of this OP.
 - c. For existing equipment, if the ISO does not accept the mitigation plan, then the TO or MP shall revise the mitigation plan as directed by ISO.
6. Upon completion of the accepted mitigation plan, the TO and/or MP shall notify the ISO Customer Service and Training staff, which shall confirm that the mitigation plan has been completed.

C. Exemption Requests

1. A TO and/or MP shall submit an exemption request for one or more of the requirements of this OP if a non-compliant condition is identified (as described in Sections II.A.2.c and II.A.3.c of this OP).
2. Included with the exemption request, the TO and/or MP shall provide:
 - a. A list of the requirement(s) for which the exemption is being requested.
 - b. An explanation of how the unique configurations of an asset, line, or system would justify the exemption.
3. The exemption request shall be submitted to the ISO Customer Service and Training staff.

4. The ISO may request supporting documentation after it reviews the exemption request.
5. The ISO, at its sole discretion, may grant or deny the exemption request.
 - a. If the ISO grants the exemption request, then the TO and/or MP shall not be required to meet the requirements of this OP for which the exemption is granted. ISO may grant exemptions for up to five years from the date of the exemption approval. Before the exemption reaches its end date, the ISO shall review the exemption to determine whether significant changes that warrant revocation of the exemption have occurred. If no such changes have occurred, then the ISO may, at its sole discretion, renew the exemption for up to five years from the date of renewal. The ISO shall review the renewed exemption before it reaches its end date.
 - b. For new and Non-Emergency Replacement Equipment, if the ISO denies the exemption request, then the TO or MP shall comply with the requirements of this OP on the operational commencement date described in Section II.A.2.a of this OP.
 - c. For existing equipment, if the ISO denies the exemption request, then the TO or MP may submit a mitigation plan pursuant to Section II.B of this OP.

III. METERING, RECORDING AND TELEMETERING ON INTERCONNECTIONS WITH SYSTEMS OUTSIDE NEW ENGLAND

A. Overall Requirements

1. The metering, recording and telemetry requirements for each transmission line interconnecting Pool Transmission Facilities (PTF) to systems outside of New England are:
 - Metering and telemetry of instantaneous megawatts (MW) from the agreed upon metering terminals of the line
 - Metering and telemetry of instantaneous megavars (MVar) from the agreed upon metering terminals of the line [except for High Voltage Direct Current (HVDC) interconnection]
 - Metering, recording and telemetry of megawatt hours (MWh) per hour (i.e. energy per hour)
2. MW and MWh per hour metering shall be at the same terminal of each interconnection.
3. The TO/MP and the non-TO/MP shall agree on the location of the metering terminal(s).
4. Wherever feasible, both technically and economically, data transmission in the ISO Reliability Coordinator Area/Balancing Authority Area (RCA/BAA) should be via the New England Shared Telecommunications Network.

B. Instantaneous Megawatts and Megavars

1. This data shall be telemetered to JSO.
2. This data may also be required by other dispatch centers within either system and by systems beyond the interconnecting systems.

Formatted: Not Small caps

Deleted: all

Deleted: all

Deleted: i

Deleted: The

Deleted: shall be agreed upon by the TO/MP and the non-TO/MP who own the line

Deleted: dispatch communications n

Formatted: Not Small caps

Deleted: must

Deleted: both

Deleted: and the control center of the interconnected system

Deleted: 19

Deleted: March 5, 2020

3. For new interconnections, and any upgrades of existing equipment, currently supportable telemetering equipment shall be used and quantities shall be transmitted to each receiver location directly without retransmission (i.e., without an intermediate receiver and transmitter).

Deleted: state-of-the-art

C. Megawatt-hours per Hour

Formatted: Not Small caps

1. There shall be a device at each interconnection facility to record the hourly billing watt-hours on site. In all new and upgraded installations, solid-state data recorders shall be installed.
2. The MWh data shall be telemetered hourly to either ISO or the control center of the interconnected system. If it is telemetered to ISO, it shall be telemetered via the applicable TO/MP Local Control Center (LCC) or Supervisory Control And Data Acquisition (SCADA) Control Center (CC), that has responsibility for the particular interconnection line.
3. The watt-hour data shall be compensated for line losses to the ISO RCA/BAA boundary.
4. MWh may be recorded and telemetered as a net or as two quantities, MWh IN and MWh OUT.

Deleted: which

IV. METERING AND RECORDING FOR SETTLEMENTS

A. Overall Requirements

Formatted: Not Small caps

1. MWh per hour (i.e. energy per hour) data is required for each Generator Asset, Tie-Line Asset and Load Asset. There is an option for Generator Assets, Tie-Line Assets and Load Assets, subject to appropriate authorization¹, to have metering data submitted at the subhourly 5-minute interval. The 5-minute data reported shall be calculated by measuring the generation or consumption energy in units of MWh in the 5-minute interval and multiplying that value by 12 (resulting in an average generation or consumption in units of MW during the interval). This 5-minute subhourly data reporting option shall also apply to all other settlement Watt-hour (Wh) and MWh requirements.
2. In order for an Asset to be eligible to participate in one or more of the Markets, the Asset shall have Wh metering as defined in this OP. The exception to this is in the case of intra-MP Tie-Line Assets as defined in Section IV.D.3 of this OP.
3. For Demand Response Resources (DRR), MWh per 5-minute interval data is required for each Demand Response Asset (DRA). The 5-minute data reported shall be calculated by measuring the consumption or generation in the 5-minute interval and multiplying that value by 12 (resulting in an effective hourly consumption or generation). In order for a DRA to be eligible to participate in one or more of the Markets, the DRA shall have a Wh metering or recording device as defined in this OP. Where statistical sampling is used, the data submitted shall be in the same format, but shall be developed in accordance with an ISO approved Measurement and Verification plan pursuant to Manual M-RPA.

Deleted: as these assets are defined in ISO New England Inc. Transmission, Markets, and Services Tariff Section I - General Terms and Conditions (Tariff Section I)

Deleted: line

Deleted: is

Deleted: applies

Deleted: must

Deleted: section

Deleted: is

Deleted: must

Deleted: will

B. Wh Metering and MWh per Hour Data

Formatted: Not Small caps

Formatted: Not Small caps

Formatted: Not Small caps

Deleted: 19

Deleted: March 5, 2020

¹ See ISO New England Manual for Registration and Performance Auditing Manual M-RPA (M-RPA_, Section 1 Hard Copy Uncontrolled

1. New and upgraded Wh metering installations shall conform to the requirements in Section VII of this OP.
2. The hourly MWh per hour data shall be submitted to ISO in accordance with ISO New England Manual for Market Rule 1 Accounting Manual M-28 (Manual M-28).
3. For Tie-Line Assets: the hourly MWh per hour data may be recorded for a given Asset as two quantities, MWh IN and MWh OUT, but shall be submitted to ISO as a net quantity.
4. The MWh per hour data quantities shall be automatically recorded at **no** greater than an hourly interval in accordance with Section VII.B.5 of this OP. If the option for submitting 5-minute interval data is used, the quantities shall be automatically recorded at **no** greater than the 5-minute interval.
5. Wh meters shall be equipped with kilowatt-hour (kWh) or MWh registers which shall be read a minimum of once a month. The purpose of this register read is to validate hourly data and allow for an adjustment, which corrects the sum of the hourly readings submitted to ISO during the month to the total energy actually metered. (See section IX.D.7 for required energy comparison)
6. The location of applicable Wh metering shall comply with this OP and be reported to ISO by the responsible MP.
7. The hourly MWh per hour data or subhourly data shall be reported to ISO to reflect the Asset at the Interconnection Point. For purposes of this OP, the Interconnection Point is hereafter defined as:

- i. the PTF boundary;
- ii. the agreed upon point of interconnection between two TOs/MPs; or
- iii. the agreed upon point of interconnection between a TO/MP and a non-MP.

Wh meters **not** located at the Interconnection Point shall be compensated for losses to the Interconnection Point as follows:

a) Level I accuracy

Wh metering that is:

- physically located at the Interconnection Point, or
- **not** physically located at the Interconnection Point but continuously compensated within the Wh meter or Wh metering circuit for excitation and load losses to the Interconnection Point.

b) Level II accuracy

Wh metering that complies with this OP, except that it is **not** physically located at the Interconnection Point, but the recorded meter data is compensated through external calculations for excitation and load losses to the Interconnection Point. The integration interval for the loss compensation calculations shall **not** exceed a one-hour period. Compensation calculations shall be based on both real power (kW) and reactive power (kVAR or kQ) measurements. Voltage may be either measured or assumed constant.

Deleted: The

Deleted: must

Deleted: must

Deleted: must

Deleted: 5

Deleted: The

Deleted: i.)

Formatted: Numbered + Level: 1 + Numbering Style: i, ii, iii, ... + Start at: 1 + Alignment: Right + Aligned at: 1.25" + Indent at: 1.5"

Deleted: ,

Deleted: ii.)

Deleted: ,

Deleted: iii.)

Deleted: Accuracy

Deleted: which

Deleted: Physically

Deleted: Not

Deleted: Accuracy

Deleted: 19

Deleted: March 5, 2020

c) Level III accuracy

Existing Wh metering without reactive recording capability that complies with this OP, and is **not** physically located at the Interconnection Point, may have its MWh recorded meter data compensated through external calculations for excitation and load losses to the Interconnection Point. In such cases, the compensation calculations shall be based on real power (kW) measurements, a fixed 95% power factor, and voltage may be either measured or assumed constant. The integration interval for the loss compensation calculations shall **not** exceed a one-hour period.

8. For DRAs, the 5-minute (MWh) data submitted to the ISO in accordance with Manual M-28 shall be either energy billing quality as defined in OP-18, Appendix C - Minimum Accuracy Standards For New And Upgraded Metering, Recording And Telemetry Installations And For Calibration Of Existing Equipment (OP-18C) or in the case where metering is installed specifically for the DRA (and will **not** be used for utility billing purposes), a metering system with an overall accuracy as defined in OP-18C may be used. Metering used for utility billing purposes is also known as revenue quality metering.

9. DC coupled Assets participating in one or more of the Markets separately must meet the following requirements:

- DC Wh metering must be installed for each Asset.
- AC Wh metering compliant with this OP must be installed at or compensated to the Interconnection Point.
- Reported interval MWh per hour values for each DC coupled Asset must sum to the measured AC MWh per hour compensated to the Interconnection Point in each interval.
- Both unadjusted DC MWh per hour values and reported interval MWh per hour values for each DC coupled Asset shall be made available to all Lead Market Participants for the Assets prior to reporting to ISO-NE.

C. Generator Assets

- Generator Assets directly connected to the 345 kV (or above) PTF system shall be metered at the PTF boundary or compensated to the PTF boundary in accordance with Section IV.B of this OP.
- Generator Assets directly connected to the PTF system at 230 kV or below where PTF boundary metering is utilized shall be metered at the PTF boundary or compensated to the PTF boundary in accordance with Section IV.B of this OP.
- Generator Assets directly connected to the PTF system at 230 kV or below where PTF boundary metering is **not** utilized shall be metered at (i) the generator terminals in accordance with the terms of the applicable Interconnection Agreement, (ii) at the PTF boundary, or (iii) compensated to the PTF boundary in accordance with Section IV.B of this OP.
- Generator Assets **not** connected to the PTF system shall be metered at the Interconnection Point or compensated to the Interconnection Point in accordance with Section IV.B of this OP. The Interconnection Point shall be determined in accordance with the terms of the applicable Interconnection Agreement.

D. Tie-Line Assets

Deleted: Accuracy

Deleted: will

Deleted: App

Deleted: App

Deleted: I

Formatted: Font: (Default) Arial, 12 pt

Deleted: reported

Formatted: Font: (Default) Arial, 12 pt, Highlight

Formatted: Highlight

Formatted: Font: (Default) Arial, 12 pt

Formatted: Font: (Default) Arial, 12 pt

Formatted: Font: (Default) Arial, 12 pt

Formatted: Font: (Default) Times New Roman

Formatted: Normal, Space Before: 0 pt, After: 0 pt, No bullets or numbering, Tab stops: Not at 1"

Formatted: Not Small caps

Deleted: either

Deleted: of the parties involved, or as moreover recommended

Deleted: or

Deleted: is

Deleted: of the parties

Formatted: Not Small caps

Deleted: 19

Deleted: March 5, 2020

1. Tie-Line Assets connect a TO/MP to another TO/MP, a non-MP or the 345 kV (or above) PTF system. Tie-Line Assets are also used to connect different sections of a TO/MP system that is divided by a Load Zone boundary.
2. Tie-Line Assets shall have a Wh meter or in the case of intra-TO/MP tie-lines an instantaneous watt meter to calculate Wh at the Interconnection Point or compensated to the Interconnection Point with the other TO/MP or non-MP unless otherwise agreed to by the parties involved or the PTF boundary as appropriate and in accordance with Section IV.B of this OP.
3. Intra-TO/MP tie-lines are Tie-Line Assets used to connect different sections of a TO/MP system that is divided by a Load Zone boundary. For these Tie-Line Assets, MWh per hour data derived from integrating instantaneous MW data used for Dispatch purposes (Section V.) is acceptable provided the metering equipment meets the minimum accuracy standards defined in OP-18C.

E. Load Assets

1. Every Load Asset except DRAs shall have a Wh meter or be determined on an hourly basis as an allocation of Wh meters. The Wh meter shall be located either at the Interconnection Point or compensated to the Interconnection Point in accordance with Section IV.B of this OP.
2. The load that is measured by a TO/MP Load Asset metering system may include PTF losses. If the Load Asset metering system includes such PTF losses, these losses, as determined by the ISO State Estimator (SE) in accordance with the procedures embodied in Manual M-28, shall be supplied to the TO/MP by ISO, and shall be subtracted from the total load as metered, to determine a TO/MP non-PTF demand.

V. INTERNAL NEW ENGLAND METERING AND TELEMETERING FOR DISPATCH, MARKET, AND RELIABILITY PURPOSES

A. Generator Asset, Alternative Technology Regulation Resources (ATRR) and Load Telemetry Criteria

Metering, as set forth below, is required for all Generator Assets and Load Assets (excluding DRAs) that are modeled and defined in the ISO Energy Management System (EMS) and are eligible to participate in the hourly markets. The metering shall measure the Generator Asset or Load Asset as it is offered or bid in the markets in accordance with OP-14. Additionally, if any change is made to an existing facility, the facility shall continue to conform to the requirements set forth below.

The following quantities are to be telemetered:

1. Market requirements:
 - a) Generator Asset net (Net₁) MW, net (Net₁) MVar and generator step-up (GSU) transformer high and low-side breaker status shall be telemetered. Refer to OP-18, Appendix D - OP-18 Metering and Telemetry Diagrams (OP-18D) for definition of Net₁. In a combined cycle configuration modeled as a single Asset in the Markets, the total net output (Net₂) shall be telemetered.
 - b) Dispatchable Asset Related Demands (DARDs) MW shall be telemetered.
 - c) Generator net (Net₃) MW and (Net₃) MVar status shall be telemetered for

Deleted: App

Formatted: Not Small caps

Deleted: must

Deleted: will

Deleted: will

Formatted: Not Small caps

Deleted: which

Deleted: must

Deleted: Market

Deleted: major

Deleted: to modify an

Deleted: also

Deleted: procedures

Deleted: Requirements

Deleted: Generator

Deleted: Step

Deleted: Up

Deleted: must

Deleted: App

Deleted: is required

Deleted: must

Deleted: must

Deleted: 19

Deleted: March 5, 2020

Pseudo Combined Cycle Generators. Refer to OP-18, Appendix E - OP-18 Metering and Telemetry for Pseudo Combined Cycle Generator (OP-18E) for definition of Nets.

- d) **No** telemetry is required for Generator Assets receiving Settlement Only, Resource treatment and generators **not** registered in accordance with OP-14.
- e) ATRR MWs shall be telemetered. MVar shall be telemetered for non-aggregated ATRRs with a maximum regulation capacity of 20 MW injection/consumption or larger and for aggregated ATRRs with a maximum Regulation capacity of 75 MW injection/consumption or larger.

NOTE

OP-18, Appendix G - Price Responsive Demand RTU Specification (OP-18G), is a confidential document subject to the ISO New England Information Policy. If access to OP-18G is needed, contact ISO Customer Service and Training as detailed on the ISO external website.

- f) For DRAs, MWh per 5-minute interval shall be telemetered and shall meet the requirements specified in OP-18, App G. The MWh per 5-minute data to be reported shall be calculated by measuring the consumption or generation in the 5-minute interval and multiplying that value by 12 (resulting in an effective hourly consumption or generation). For settlement purposes, revised MWh per 5-minute interval shall be submitted through the appropriate Market User Interface, (MUI) as defined in ISO New England Manual for Definitions and Abbreviations Manual M-35 (Manual M-35). In addition to 5 minute data, any DRA providing TMSR or TMNSR shall supply 1 minute or less MW telemetry at the retail delivery point.
- g) Other data may be required to be telemetered, as determined on a case-by-case basis based on bulk power system (BPS) monitoring and operations requirements and also based on how ISO models the Asset. The determination of the data that shall be telemetered shall be made jointly by ISO, the LCC/SCADA CC and the MP.
- h) Geomagnetically induced current (GIC) in DC neutral amperes (ANDC) from each GSU transformer subject to the requirements of Section 3.11 of ISO New England Planning Procedure No. 11- Planning Procedure to Support Geomagnetic Disturbance Analysis (PP11). The measured GIC value shall have the following direction convention: a positive sign shall indicate the GIC flows from ground into the transformer neutral, and a negative sign shall indicate the GIC flows from the transformer neutral into ground.
- i) DC coupled Assets participating in one or more of the Markets separately shall adhere to the following:
 - i. If the maximum output of the combined facility is under 5 MW and it is registered as a Settlement Only Resource, the Assets are not required to provide telemetry data pursuant to this section V.
 - ii. DC telemetry for each Asset shall be adjusted to the AC Interconnection Point.

Deleted: App

Deleted: "

Deleted: "

Deleted: must

Deleted: must

Deleted: App

Deleted: Confidential

Deleted: and distributed in accordance with

Deleted: document

Deleted: required

Deleted: Support

Deleted: must

Deleted: is

Deleted: Settlement

Deleted: is

Deleted: c

Deleted: MUI (

Deleted:)

Deleted: must

Deleted: will

Deleted: 19

Deleted: March 5, 2020

iii. No MVar values are required for low side DC components

j) ISO may waive requirements in this section based on how ISO models the Asset. ISO shall document exemption process requests on behalf of the TO and/or MP for any waived requirements.

Deleted: a

2. Reliability Requirements:

a) Generator Asset Net MW, and Net MVar, as measured at the low side of the GSU transformer. Refer to OP-18, App D for definition of Net. Combined cycle plants are required to supply measurements for each unit.

b) Automatic voltage regulation (AVR) indicator, which indicates whether the unit(s) and/or flexible alternating current transmission system (FACTS) device(s) is/are in automatic voltage regulating mode and regulating voltage. This includes AVR status for individual generators or synchronous condensers, that are part of a composite Asset, except for wind plants which are described in i. below.

Deleted: Flexible

Deleted: Alternating

Deleted: Current

Deleted: Transmission

Deleted: System

Deleted: (i)

i. For a wind plant, the AVR status indicates the combined status of all the various pieces of equipment that make up the voltage regulation system. That equipment may include Dynamic Volt-Amp Reactive (D-VAR) devices, capacitor banks, master control computers, breakers, Static VAR Compensators (SVCs), FACTS, Special Protection System (SPS) equipment, or any other equipment that contributes to the functioning of the full specified voltage regulation capability. If any of these contributing pieces of equipment are degraded or out of service then the AVR status indicator shall indicate "OFF".

Deleted: should

c) Power system stabilizer status shall be provided if installed.

d) MW and MVar station service load values may also be requested.

e) Generator Asset terminal voltage measurements may also be requested.

f) Other telemetered data needed for ISO BPS monitoring and operation based on how ISO models the Asset shall be determined on a case-by-case basis. The determination of the data that shall be telemetered shall be made jointly by ISO, the LCC/SCADA CC and the MP.

Deleted: to be determined on a case-by-case basis which are required

Deleted: must

Deleted: will

g) OP-18 Appendix A - ISO New England ICCP CNP Node Requirement (OP-18A) defines the binary representation expected for status data types.

Deleted: App

h) ISO may waive requirements in this section based on how ISO models the asset. ISO shall document exemption process requests on behalf of the TO and/or MP for any waived requirements.

B. Transmission System Telemetry Criteria

Formatted: Not Small caps

The following quantities shall be telemetered. Any major change to modify an existing facility shall conform to the procedures set forth below.

Deleted: are to

1. Transmission substation voltage from the following:

a) Each generating station 50 MW or larger that connects to the 69 kV and above transmission system.

Deleted: 19

Deleted: March 5, 2020

- b) Each 115 kV and above substation where two (2) or more line sections terminate with protective circuit interruption capability, such as a circuit breaker.

NOTE

The preferred measurement of bus voltage is phase-phase. In the event that phase-phase measurement is **not** provided, a phase-phase value calculated from a phase-ground measurement is acceptable.

Deleted: will be

2. Substation frequency from the following:
 - a) Each station that either (i) has a Designated Blackstart Resource **OR** (ii) has generation capability that is 50 MW or larger (nameplate).
 - b) Each 230 kV and above substation.
 - c) Each 115 kV substation where two or more line sections terminate with protective circuit interruption capability, such as a circuit breaker.
 - d) On or before October 1, 2020, each Transmission Owner shall submit to the ISO a list of its substations that do not already provide substation frequency as of the date of submission of such list. Transmission substations included in each Transmission Owner's list shall be exempt from meeting the requirements of this Section V.B.2. Transmission substations that already provide substation frequency and are therefore not included in a Transmission Owner's list shall continue to provide substation frequency as required under this Section V.B.2. For any new transmission substations, a Transmission Owner may request an exemption pursuant to Section II.C of this OP. ISO may require that a transmission substation included in a Transmission Owner's exemption list meet the requirements of Section V.B.2 if a reliability need for the data from that transmission substation arises.
3. MW and MVAR from each terminal of all non-radial inter-LCC lines.
4. MW and MVAR from every terminal of all 230 kV and above lines and at least one end of each non-radial 115 kV line.
5. MW and MVAR from each transformer connected to 115 kV and above.
6. MW and MVAR from one end of each intra-LCC line that is necessary for reliable transmission operation, to support BPS transfers, or is otherwise needed.
7. The status of each breaker 115 kV and above.
8. Any transformer with voltage regulation capability that has a low side voltage of 115 kV or above shall provide the status of its voltage regulating state. This is commonly referenced as a load tap changer (LTC) AVR status.
9. The on-load tap changer (OLTC) tap positions of each autotransformer connected to 230 kV and above and each phase-shifting transformer connected to 115 kV and above.
10. Other telemetered data needed for ISO-NE BPS operation (i.e., synchronous condensers, HVDC terminals, SVC, capacitor/reactor status, frequency, FACTS devices, Northeast Power Coordinating Council Inc. [NPCC] Type I BPS SPS equipment and selected 69 kV switching devices) shall be determined on a case-

Deleted: which

Deleted: to be determined on a case-by-case basis which are required

Deleted: 19

Deleted: March 5, 2020

by-case basis. The determination of the data that shall be telemetered shall be made jointly by ISO, the LCC/SCADA CC and the MP.

Deleted: must

Deleted: will

11. GIC in ANDC from each transformer subject to the requirements of Section 3.11 of PP11. The measured GIC value shall have the following direction convention: a positive sign shall indicate the GIC flows from ground into the transformer neutral, and a negative sign shall indicate the GIC flows from the transformer neutral into ground.

C. Telemetered Data Scan Rates

Formatted: Not Small caps

The following minimum standards are established for the frequency at which telemetered quantities shall be scanned and made available to the local Inter-Control Center Communication Protocol (ICCP) Communication Network Processor (CNP) or ISO Communications Front End (CFE).

Deleted: are to

Frequency of Scanning (Seconds)

1. The data required for tie line MW, tie line MVar, substation frequency, and Automatic Generation Control (AGC) operation, which includes unit MW for AGC generators and ATRR Regulation Service providers, shall be made available to the local ICCP CNP or ISO CFE within four (4) seconds. This time interval is measured as the time the data is scanned at the remote terminal unit (RTU) until the time the data is received at the local ICCP CNP or ISO CFE.
2. The analog power system data, which includes all other analog data defined in Section V of this OP, shall be made available to the local CNP or ISO CFE within ten (10) seconds of a change in data at a RTU. For all DRAs, data shall be submitted in 5-minute intervals. For a DRR to provide TMSR or TMNSR, DRA telemetry values shall be submitted at least every one minute. This data requirement recognizes that the change detection logic employed by some RTUs is telemetered to the SCADA system only after a change in the data is detected by the RTU, and that the amount of change may be different for each point in an RTU.
3. Telemetered status data shall be made available to the local CNP or ISO CFE within four (4) seconds of a change reported by an RTU.

Deleted: will

Deleted: four (4) second

D. Telemetered Data Criteria

Formatted: Not Small caps

The following communication paths shall be established to make the required telemetered data available. Some paths are dependent upon the Asset being defined as dispatchable per OP-14.

1. Generation data (Section V.A) shall be made available to the LCC or SCADA CC in which the Asset resides. The LCC/SCADA CC shall make this data available to the Intrapool ICCP network.
 - a. If the Asset is dispatchable the generation data shall also be made available to ISO via the CFE (see OP-18, Appendix F - ISO Communications Front End (CFE) Interface Specifications (OP-18F)). Some dispatchable types have additional data requirements as specified in OP-14 that shall also be provided to ISO. ISO shall make all of this data available to the ICCP network.
 - b. If the Asset is dispatchable and the Asset nameplate generation capability as defined by the NX-12 technical data is less than 15 MW, then the LCC/SCADA CC may request an exemption to providing this data. The

Deleted: App

Deleted: will

Deleted: 19

Deleted: March 5, 2020

LCC/SCADA CC shall submit the exemption request to ISO and provide a technical explanation as to why the data **cannot** be obtained. ISO, at its sole discretion, shall grant or deny the exemption.

2. Transmission system data described in Section V.B. of this OP shall be made available by the LCC/SCADA CC to the Intrapool ICCP network. This data shall also be made available to the ISO via the CFE if the Designated Entity (DE) owns the transmission system equipment and the asset is defined as dispatchable per OP-14.
3. The following Asset types from Section V.A shall connect directly to ISO per OP-18F, or OP-18G, as applicable, to supply data:
 - a. DARDs
 - b. ATRRs
 - c. DRAs

E. Non-Telemetered Data Criteria

Additional data may be determined to be necessary for the overall operation of the ISO/LCC/SCADA CC/TO/MP dispatch computer systems. This data shall originate from, and be the responsibility of, the dispatch center with jurisdiction over the data. This data shall be made available for transmission as needed to the ISO/LCC/SCADA CC/TO/MP dispatch computer systems.

Examples of this type of data include, but are **not** limited to, the following:

1. Generator limits and unit control modes (UCMs).
2. Text messages.
3. Non-telemetered breaker and switching device status.
4. Calculated data including transfer limits and flows, interface limits and flows.
5. Economic dispatch basepoints/desired generations, and AGC setpoints.

F. Telemetered Data Identification

NOTE

OP-18F is a confidential document subject to the ISO New England Information Policy. If access to OP-18F is needed, contact ISO Customer Service and Training as detailed on the ISO external website.

ISO, each LCC/SCADA CC, each TO and each MP shall uniquely and correctly identify the data being supplied to the network using the format described in OP-18A for CNP sourced data and in OP-18F and OP-18G for ISO CFE data.

VI. METERING FOR POWER FACTOR MEASUREMENT PURPOSES

Each TO/MP shall submit to ISO the quantities necessary to calculate TO/MP IpF as prescribed in ISO New England Operating Procedure No. 17 - Load Power Factor Correction (OP-17). A sufficient number of the necessary quantities shall be metered and recorded so that the resulting IpF is a valid calculation.

VII. EQUIPMENT STANDARDS FOR NEW AND UPGRADED INSTALLATIONS

Deleted: should

Deleted: reserves the right to deny

Deleted: (

Deleted:)

Deleted: applicable

Commented [NB8R7]: fixed

Deleted: , App

Deleted:

Deleted: , App

Deleted:

Deleted: requirements

Formatted: Not Small caps

Deleted: has been defined as

Deleted: will

Deleted: which has

Deleted: will

Deleted: required

Deleted: Messages

Formatted: Not Small caps

Deleted: App

Deleted:

Deleted: C

Deleted: and distributed in accordance with

Deleted: document

Deleted: required

Deleted: Support

Deleted: , App

Deleted: , App

Deleted: , App

Deleted:

Deleted: must

Deleted: 19

Deleted: March 5, 2020

This section specifies standards for metering, recording and telemetry equipment that each TO/MP installs in all new and upgraded facilities. A TO/MP may maintain or repair existing equipment with like or improved components, but each TO/MP shall choose equipment that meets all the requirements of this OP and Section I.3.9 of the ISO Tariff when the equipment is being replaced for purposes other than maintenance or repair (i.e., for purposes of upgrading the facility).

A. ANSI Standards

All AC metering devices used shall conform to applicable American National Standard Institute (ANSI) C-12 standards as amended from time-to-time. HVDC metering devices shall meet or exceed the following accuracy requirements of ANSI standards as noted below in 1, 2, and 3.

1. Integrated metering quantities, such as watt-hours and the associated demand components shall conform to ANSI standard C12.
2. Instruments or transducers for the analog or digital measurement of telemetered quantities, such as MW, shall conform to ANSI standards C39.1, C39.5 and C37.90.
3. Instrument transformers shall conform to ANSI standard C57.13.

B. Specific ISO New England Standards

1. The design accuracy of individual components as well as overall systems shall conform to the standards contained in OP-18C.
2. Electro-mechanical Wh meters shall not be installed.
3. For all grounded wye system metering, three element meters and transducers shall be used. For all delta system (ungrounded) metering, two or three element meters and transducers may be used.
4. The requirement for data recorders and for integrated metering quantities shall be satisfied with the types of equipment listed below. Either type may be used internally or on interconnections with systems outside ISO.
 - A data recorder shall be installed at the metering location. Data shall be retrieved from recorders by on-site or remote interrogation. Where the TOs/MPs agree on the need for joint access to this recorded data, remote communications equipment is recommended to be installed
 - A multifunction meter shall be equipped with an interval data recorder capable of storing at least 60 days of interval data and an internal clock. Data shall be retrieved from the meter by remote interrogation. Where the TOs/MPs agree on a need for joint access to this recorded data, the meter program shall be secured appropriately.
 - The data recorder or multifunction meter equipped with an interval data recorder shall not be dependent on the alternating current (ac) voltage that it is metering as the sole power source if an alternative power source exists at the metering location (such as an ac station service emergency panel feed, a direct current (dc) battery or "street power").
5. All data recorders shall be synchronized in time, within an accuracy of +/- 15 seconds, with the National Institute of Standards and Technology (NIST)

Deleted: installations

Deleted: is not precluded from

Deleted: ing

Deleted: ing

Deleted: is required to

Deleted: standards

Deleted: New England Inc. Transmission, Markets, and Services Tariff

Deleted: Section I - General Terms and Conditions
Section I.3.9 Review of Market Participant's Proposed Plans

Deleted: an upgraded installation

Formatted: Not Small caps

Deleted: should

Deleted: should

Deleted: should

Formatted: Not Small caps

Deleted: App

Deleted: mutually

Deleted: to

Formatted: Font: Bold

Deleted: mutually

Deleted: to

Deleted: 19

Deleted: March 5, 2020

periodically and when they are installed or returned to service after maintenance or repair.

6. Compensation for line and/or transformer losses, when used, shall be accomplished by using Level I or Level II metering accuracy standards as defined in OP-18 Section IV.B.7 [of this OP](#).
7. [DC metering associated with DC coupled Assets participating separately in any Market shall be of equivalent accuracy and precision to AC meters meeting the ANSI C12 standard. Specifications for such devices shall be provided to the ISO and/or Host Participant upon request.](#)

Formatted: Indent: Left: 0.75", Tab stops: Not at 0.25"

Formatted: Font: (Default) Arial

VIII. REQUIREMENTS FOR DATA COMMUNICATIONS EQUIPMENT FOR TELEMETERING SYSTEMS

To ensure reliable data communications for telemetry, the telemetry equipment (RTU, Digital Metering, communication equipment etc.) located at and between stations [owned by an MP or Designated Entity (DE)], the LCCs/SCADA CCs and ISO, [the following](#) supporting telemetry data is required:

Deleted: by this OP

1. The equipment shall **not** be dependent on a single ac power source. The power source shall be a station battery or an uninterruptible power source capable of supporting the anticipated load for at least eight hours.
 - Communication only facilities (terminal or intermediate) [shall](#) have a battery rated for at least eight (8) hours and a suitable backup power source for extended periods.
 - This includes telephone company equipment co-located with MP or DE equipment.
2. Dedicated communication circuits or a utility-owned communication network shall be used. Utility-owned communication facilities [shall](#) be used as the preferred means of data communication. Tie-Line Asset telemetering with external ISO ties [shall](#) use "electric utility-owned" communication facilities.
 - The intent of "electric utility-owned" is to exclude commercial telecom providers for Tie-Line Asset communication circuits. Tie-Line Asset communication circuits, if redundant, shall have at least one (primary or backup) that [shall](#) be electric utility-owned.
 - "Electric utility-owned" may also be jointly owned as a communication circuit that may traverse multiple utility service territories.
 - "Communication facilities" noted above refer to all components (i.e.,: terminal [and](#) intermediate equipment, [and](#) communication media)
3. At stations where two battery systems are [present](#), it is desirable that each [of them](#) be made capable of being a power source for the equipment.
4. The equipment shall be capable of operating in a temperature range of -20°C to +50 °C for equipment within the control building or -40 °C to +50 °C for equipment installed in other outdoor enclosures. This temperature range is based upon the conditions that could exist when the ac power source is lost and as a result, air conditioning or heating is lost.

Deleted: should

Deleted: should

Deleted: must

Deleted: must

Deleted: &

Deleted: &

Deleted: provided

Deleted: should

Deleted: 19

Deleted: March 5, 2020

5. The configuration/connection of communication circuits shall be designed so that a problem on one circuit does **not** cause a problem on another (i.e., the problem does not propagate).
6. Alarms shall be provided to the appropriate LCC/SCADA CC indicating the status of equipment covered by this section.

Deleted: should

Deleted: should

Deleted: be

Deleted: d

IX. TESTING, CALIBRATION AND MAINTENANCE STANDARDS

A. Overall Requirements

Each TO/MP is responsible for properly maintaining its metering, recording and telemetry equipment in accordance with applicable ANSI standards as amended from time-to-time. The specific standards for testing, calibration and maintenance are put forth in this section. The accuracy standards to be observed are summarized in App C.

Formatted: Not Small caps

B. Overall Telemetry System Test

Whenever transducers and/or telemetry systems are tested, an overall system test shall also be conducted. This system test includes the use of the calibrated transducers output as an input to the telemetry system. All receiving devices shall be verified against the applied input.

Formatted: Not Small caps

C. Telemetry Component Tests

To ensure the accuracy of telemetered data, each TO/MP shall do one of the following:

Formatted: Not Small caps

1. Use manual or computerized routines to check telemetered quantities (MW, MVar & kV) against each other, revenue meter quantities and/or against derived values of an SE, to identify unreasonable values at least one day per calendar month as detailed in Section IX.C.1.a of this OP. This option may only be used for equipment after the initial installation (or replacement) test where IX.C.2 (below) would apply for initial installation (or replacement).

Deleted: once a

Deleted: below

Deleted: can

- a. Each single day check shall include 24 data samples for each telemetered point, 1 for each hour of the day.
 - o While individual hour samples may have variations that exceed tolerances, noted below, where six or more consecutive samples exceed the tolerance in 1-day appropriate calibration, repairs or replacement actions shall be taken.
 - o Each sample may be from a single point in time within the hour or averaged/integrated over the hour interval.
 - o Voltage variance, as compared against below tolerances, is each telemetered phase-phase voltage compared against at least one of the two below:
 - The SE resultant bus voltage associated with the telemetered voltage, given in, or corrected to, phase-phase

Deleted: might

NOTE

Concerning average of telemetered voltages, when less than three voltages (of comparable phase relationship) are measured at the same substation bus, additional

Deleted: 19

Deleted: March 5, 2020

points of reference are needed for comparison. Other points of reference may include, but are **not** limited to, adjacent bus voltages, nearby scheduled voltages, or bus voltage in an SE.

Deleted: could

- The average of all non-zero telemetered voltages that are phase-phase on the same nominal voltage level at the substation. Busses at the same voltage level that are **not** tied shall be treated separately.

Deleted: should

b. The tolerances for acceptable MW, MVar and kV telemetered quantities are as follows:

- Watts: ± 10 MW or $\pm 4.5\%$ of the largest fiducial value (whichever is smaller)
- VAr: ± 30 MVar
- Voltage: ± 5 kV for 345 kV systems
 ± 4 kV for 230 kV systems
 ± 3 kV for 115 kV systems
 ± 2 kV for 69 kV systems
 $\pm 3\%$ for systems below 69kV

c. The check above shall not be required for MVar quantities if the MVar quantities are measured from the same device that measures the telemetered MW quantities.

Deleted: will not require the above check

- The purpose for this is that measurement drift of a device measuring both would cause errors in both MW and MVar. Also MVar variances are often obscured by transformer losses or SE solutions that are **not** perfect.
- With the bus-net method, MVar quantities that originate from a different device than the associated MW telemetry would **not** be exempt from a MVar bus-net even if the other telemetry on the bus had its MW and MVar quantities measured from the same device.
- If a MVar bus-net is needed, VAr losses can be estimated based upon transformer test data to mitigate bus-net VAr error.

2. Calibrate or test the accuracy of transducers and telemetering systems according to manufacturer's procedures, on the following schedule:

Transducers: at least once every six years

Deleted: four

Analog Telemetry: at least once every twelve months

Digital Telemetry: at least once every six years

Deleted: four

When tests are performed on transducers, errors shall not exceed accuracy limits stated in OP-18C. If during the test, errors exceed this value the device shall be recalibrated, repaired or replaced as necessary to attain that accuracy.

Deleted: should

Deleted: App

Digital telemetry employing analog to digital converter(s) (ADC), the gain and offset characteristics of which are continuously monitored, and reported to SCADA, by ADC reference values that are within accuracy limits stated in OP-18C, shall be exempt from periodic calibration requirements. When accuracy limits stated in OP-18C are exceeded, the equipment shall be recalibrated, repaired or replaced as necessary to attain that accuracy. This digital telemetry

Deleted: Telemetry

Deleted: App

Deleted: App

Deleted: 19

Deleted: March 5, 2020

test exemption may only be used for equipment after the initial installation (or replacement) accuracy test.

Deleted: can

D. Watt-hour Meters

Formatted: Not Small caps

1. All Wh meters shall be tested by comparison to a solid-state Wh standard that is traceable to the NIST as outlined in Section IX.F of this OP. Testing shall include an inspection, verification, and analysis of the metering system excluding instrument transformers.
2. HVDC Wh meters - dc Wh metering equipment utilizing voltage inputs for current and voltage sensing shall conform to the following requirements. See Figure 9-1.
 - a. DC test voltage source equipment for generating current and voltage inputs to the meter shall be traceable to NIST for accuracy.
 - b. Voltmeters used for monitoring the input voltages to the dc meter during the test shall be traceable to NIST for accuracy.
 - c. Meter nominal test voltage shall be the meter input voltage corresponding to the nominal operating voltage of the metered line.
 - d. Meter "full load test amperes" shall be the meter input voltage corresponding to the nominal operating current of the metered line.
 - e. The test points for the meter shall be as follows:
 - o Full load test amperes
 - o 10% of full load test amperes
 - o 50% of full load test amperes
 - o 150% of full load test amperes
 - f. If meter pulse outputs are compared to calculated target values, and pulses from a standard, to determine meter accuracy, then worksheets detailing the test conditions and target pulse counts shall be made available prior to testing the meter. See Table 9-1, below.
 - g. If the meter is compensated to account for different operating modes of the metered circuit, then the meter shall be tested with compensation activated at each of the test points defined above. The operating modes that represent the normal operating conditions shall be tested as a part of periodic testing. All operating modes shall be tested upon commissioning.
 - h. For engineered (custom) metering systems a hard copy of the current meter program shall accompany the meter test documentation.
 - i. If both revenue meter data and telemetry data are provided by the same meter, then provisions shall be made to continue the telemetry while the meter is out of the measurement circuit during the test.
 - j. If redundant meter schemes are utilized, then the generation of any alarms or status flags due to differences in measurement between the meters caused by the testing shall be documented. If redundant recorders are used, then differences in recorded pulse totals due to the testing shall also be documented.
 - k. If redundant meter schemes are utilized, then the start and stop time as well as the accumulated test energy for the meter under test shall be documented.

Deleted: document

Deleted: should

Deleted: Where

Deleted: will

Deleted: will

Deleted: Where

Deleted: must

Deleted: Where

Deleted: must

Deleted: Where

Deleted: must

Deleted: Where

Deleted: will

Deleted: 19

Deleted: March 5, 2020

[In addition](#), the start and stop time as well as the accumulated energy during the test period [shall](#) be noted for the in-service meter.

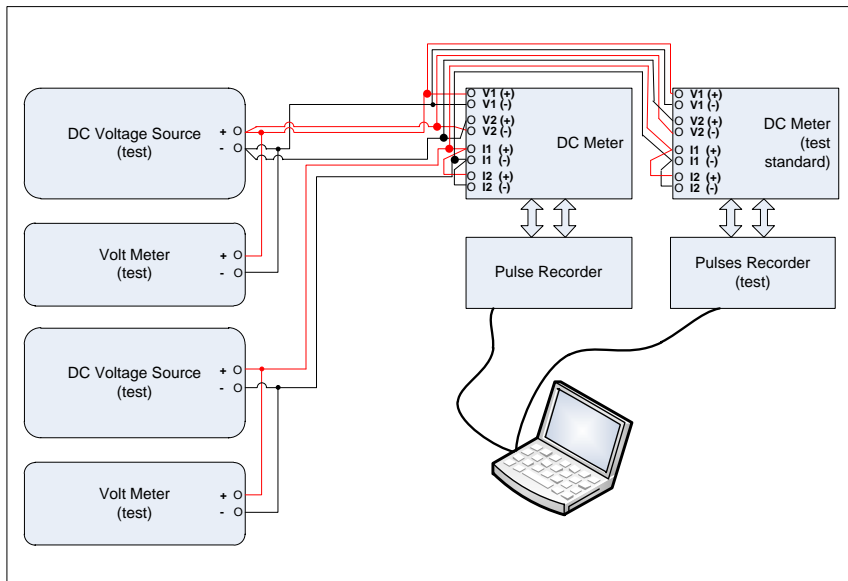
- I. A field standard meter that has been programmed identical to the meter under test may be used for certification provided that it meets the accuracy and certification requirements of Section IX.F [of this OP](#).

Deleted: Likewise

Deleted: will

Deleted: 19

Deleted: March 5, 2020

Example Test Scheme for a DC Meter with Voltage Inputs.**Figure 9-1****Example Pulse Target Worksheet**

Test Conditions - Equation 1 (Import / South)		Uncompensated Reference Energy	Meter Reading	Meter Standard Reading	Meter error
Voltage	Current	Pulses*	Pulses*	Pulses*	(%)
V1: 5V(450kV) V2:-5V(-450kV)	I1:0.5V(225A) I2:0.5V(225A)	506.25			
V1: 5V(450kV) V2:-5V(-450kV)	I1:2.222(1000A) I2:2.222(1000A)	1125			
V1: 5V(450kV) V2:-5V(-450kV)	I1:5V(2250A) I2:5V(2250A)	2531.25			
V1: 5V(450kV) V2:-5V(-450kV)	I1:7.5V(3375A) I2:7.5V(3375A)	3796.88			
* Pulses are 0.2 MWh / pulse. 225A (10%) test uses pulse over 30 min, all other test conditions use pulses for 15 min.					

Table 9-1

Deleted: 19

Deleted: March 5, 2020

3. DC Wh metering for DC coupled assets participating separately in any Market shall conform to the following requirements:
- DC test voltage source equipment for generating current and voltage inputs to the meter shall be traceable to NIST for accuracy.
 - Voltmeters used for monitoring the input voltages to the dc meter during the test shall be traceable to NIST for accuracy.
 - Meter nominal test voltage shall be the meter input voltage corresponding to the DC voltage rating of the inverter.
 - Meter "full load test amperes" shall be the meter input voltage corresponding to the DC ampere rating of the inverter.
 - The test points for the meter shall be as follows:
 - Full load test amperes and nominal test voltage
 - Full load test amperes and 50% of nominal test voltage
 - 50% of full load test amperes and nominal test voltage
 - 50% of full load test amperes and 50% of nominal test voltage
 - Where meter pulse outputs are compared to calculated target values, and pulses from a standard, to determine meter accuracy, worksheets detailing the test conditions and target pulse counts will be made available prior to testing the meter.
4. At a minimum, AC Wh meters shall be tested by one of the following two methods:
- Series test with external loads applied [permitted for testing either induction or solid-state Wh meters].
 - "As-Found" series test performed at operating or nameplate voltage under the following three conditions:
 - Full load (FL) at the meter test ampere (TA) rating and unity power factor
 - Light load (LL) at 10% of the meter TA rating and unity power factor
 - Power factor (PF) at the meter TA rating and 0.5 power factor lag
 - The series test results shall be within the following accuracy limits:

Test Condition	Accuracy Limit
FL	+/- 0.2% error
LL	+/- 0.3% error
PF	+/- 0.5% error
 - The testing of any Wh meter with bi-directional functionality shall be tested for accuracy in both the forward (delivered) and reverse (received) directions for all Assets except those for Asset Related Demands (ARDs).
 - In addition to the "As-Found" series tests, all induction Wh meters shall have an "As-Found" individual element balance test performed. The

Deleted: As**Deleted:** watt-hour**Deleted:** watt-hour**Deleted:** tested**Deleted:** Load**Deleted:** Test**Deleted:** Ampere**Deleted:** Load**Deleted:** Factor**Deleted:** ¶**NOTE:**

Meters used in bi-directional applications shall be tested for both forward (delivered) and reverse (received) accuracy. (remove note & box)

Formatted: Heading 4, Indent: Left: 1.38", Hanging: 0.13", Numbered + Level: 3 + Numbering Style: i, ii, iii, ... + Start at: 1 + Alignment: Right + Aligned at: 1.38" + Tab after: 1.5" + Indent at: 1.5", Tab stops: 1.5", Left**Deleted:** must**Formatted:** Tab stops: Not at 1.5"**Deleted:** 19**Deleted:** March 5, 2020

individual elements shall be tested at operating or nameplate voltage, at FL test amps, and unity power factor. The individual element test results shall be within 1.0% of each other.

- v. If the "As-Found" test results are outside the stated accuracy limits in section IX.D.4.a.ii, then the meter shall be adjusted as closely as practical to 0.0% error or scheduled for replacement as soon as possible. The final "As-Left" test results shall be within the stated accuracy limits.
 - vi. Any induction Wh meter found outside of +/- 2.0% error (at any test condition) shall be adjusted and scheduled for replacement as soon as practical.
- b) Single point three-phase test using the actual in-service load and meter uncompensated [**not** permitted for testing induction type Wh meters].
- i. "As- Found" three-phase tested at actual in-service voltage, current, and power factor; provided that:
 - voltage is within the range specified by the meter manufacturer
 - current is within the meter's load range between light-load (LL) and class amps of the meter, and
 - power factor is between unity and 0.5 lagging or leading.
 - ii. The single point three-phase test results must be within the following accuracy limits:

Test condition	Accuracy Limit
Actual <u>in-service load</u>	+/- 0.2% error
 - iii. If the "As-Found" test results are outside the stated accuracy limits, then the meter shall be adjusted as closely as practical to a 0.0% error or promptly replaced. The final "As-Left" test results shall be within the stated accuracy limits.
 - iv. Any solid-state Wh meter found with accuracy tests outside the limits specified in section IX.D.4.b.ii shall either be adjusted and scheduled for replacement as soon as practical; or, promptly replaced.

5. Meters with compensation for line and/or transformer losses shall be either one or the other of the following:
- Series tested with and without the compensation activated at the test points as defined in Section IX.D.4.a of this OP; or
 - Single point tested with compensation checked by comparison of compensated and uncompensated pulse data channels.
6. In-service testing of Wh meters shall be conducted with the frequency established in the local state utility control and distribution utility requirements for retail loads such as Asset Related Demands (ARDs). All other Assets, with noted exception, shall be tested with the following frequency: all Wh meters shall be tested at least once per calendar year, with the exception that non-induction type Wh meters, the operation of which is monitored daily, shall be tested at least once every six calendar years. Generator Assets that are not Settlement Only Resources and have a registered summer and winter claimed capability of less

Deleted: must

Deleted: or any other Wh meter found outside the +/- 0.5% error

Deleted: Class

Deleted: Amps

Deleted:

Formatted: Indent: Left: 1.5", Numbered + Level: 3 + Numbering Style: i, ii, iii, ... + Start at: 1 + Alignment: Right + Aligned at: 1.38" + Tab after: 1.5" + Indent at: 1.5", Tab stops: 1.63", List tab + Not at 1.5"

Deleted: Condition

Deleted: Limit

Deleted: In

Deleted: Load

Deleted: +/- 0.5% error

Deleted: 2

Deleted: .

Deleted: tested at a

Deleted: accordance with

Deleted: at

Deleted: specified as follows:

Deleted: All

Deleted: must

Deleted: a

Deleted: must

Deleted: two

Deleted: The exception is

Deleted: registered as "Settlement Only Generators" whose

Deleted: is

Deleted: 19

Deleted: March 5, 2020

than 1 MW shall be tested with the frequency established in the local state utility control and distribution utility requirements for retail loads.

Deleted: of which

Deleted: at a

Deleted: accordance with

7. Periodic Energy Comparison

a) Data recording equipment external to the meter shall be checked monthly by comparing a summation of the hourly demand readings with the kWh registered on the Wh meters for the same period of time. When only small quantities (less than 7,200 MWh in one month) have been registered, comparison is required every two months using two months of data. The difference in the sum of hourly demand readings and the kWh registered on the Wh meter shall be less than the value of the Wh meter transformer ratio multiplier. If this difference is greater, then the installation shall be reviewed and tested if the discrepancy is **not** explainable. This requirement is not applicable to DC meters for DC coupled Assets participating separately in any Market.

Deleted: should

Deleted: When

b) For DRAs, data recording equipment external to the meter shall be checked at least annually by comparing a summation of the hourly demand readings with the kWh registered on the Wh meter for at least one month. If hourly data is available from the pulse source meter, then comparison shall take place at the hourly level.

Deleted: should

8. The continuity of meter readings shall be maintained during tests either by use of a portable meter or other suitable methods. Note: use of the single point test method shall provide for continuity of both readings and data. A Wh meter test may be conducted during a period of **no** load or when the load is constant and the reading adjusted upon completion of the test. Pulse data shall also be adjusted upon completion of the test. If this is **not** practical, then other methods shall be used to segregate pulses registered due to the test from pulses based on registration of power flow.

Deleted: should

Deleted: will insure

Deleted: made

Deleted: should likewise

Deleted: When

Deleted: must

E. Instrument Transformers

Scheduled tests of instrument transformers shall be conducted only if all other tests fail to explain a discrepancy. The testing procedure shall conform to the manufacturer's specifications and ANSI C57.13.

Formatted: Not Small caps

Deleted: are **not** required unless all other tests fail to explain a discrepancy; then testing shall be performed

F. Test Equipment

Test equipment used in the calibration of instrument transformers or transducers shall be certified to values of accuracy and precision which are at least twice as accurate as the required accuracy of the equipment under test. Non-induction type Wh standards of 0.1% or better accuracy shall be used in the testing of Wh meters. All Wh standards shall be certified correct every twelve months.

Formatted: Not Small caps

Deleted: should

NOTE

Traceability refers to relating individual measurement results to NIST measurement systems through an unbroken chain of comparisons.

All Wh standards shall be certified by comparison with laboratory standards whose accuracy is traceable to NIST. The standard certification values may be determined by the use of data obtained through round-robin procedures between TOs/MPs, provided that at least one of the laboratories maintains standards traceable to NIST.

Deleted: should

Deleted: 19

Deleted: March 5, 2020

Standards utilized for the purpose of calibrating voltage and current transducers shall be of the same sensing type (e.g., Root Mean Square (RMS) or average) as the transducers under test. All telemetry standards shall be certified at least once every 24 calendar months.

Deleted: should

The tests and calibrations shall be performed at ambient temperatures recommended by the manufacturers of the test equipment and the equipment under test.

Deleted: should

Instrumentation used to check the tone modulating frequency for data transmission shall have a minimum definition of 0.001 Hertz. The dc ammeter or voltmeter used to measure input signals shall have a minimum accuracy of +/- 0.05%.

Deleted: should

G. Record Keeping and Auditing

Formatted: Not Small caps

Each TO/MP shall maintain records of the testing, calibration and verification of all metering and telemetry equipment which is required to be installed pursuant to the provisions of this OP. The records shall include:

Deleted: is to

Deleted: according

Deleted: are to

- Entity name
- Element (line, bus, transformer, etc.) name covered by telemetry
- Name of telemetry device (or system)
- The dates of testing, calibration or verification
- % error of as-found (and as-left if recalibrated or replaced)
- A note, if as-found is **not** within accuracy tolerance
- Action(s) taken (if applicable) including date(s) of action(s)

These records shall be retained for a minimum of the two most current testing (or verification) cycles or since the last audit (whichever is greater) and shall be available to ISO and the LCC upon request.

Deleted: are to

Deleted: are to

H. Notifications

Formatted: Not Small caps

When metering and telemetry equipment associated with TO/MP interconnections is scheduled for maintenance, test or upgrade, then interconnected TOs/MPs shall be notified at least two weeks in advance in order to have the opportunity to participate in or witness the maintenance, test or upgrade.

X. SECURITY OF METERED AND RECORDED DATA

Security shall be addressed to prevent unlawful, unintentional or unauthorized access to those portions of the firmware, software and data being collected that would have an effect on the metered and recorded quantities.

XI. COMPLIANCE

Periodically, ISO may conduct an audit survey of metering, recording devices and telemetry criteria to determine the degree of TO/MP compliance with all OP-18 requirements.

XII. DEFINITIONS

- **Fiducial Value** - A value to which reference is made in order to specify the accuracy

Deleted: 19

Deleted: March 5, 2020

of a transducer. The Fiducial Value is the span except for transducers having a symmetrical reversible input and output. In this case, the Fiducial Value is half the span. (Reference: ANSI/IEEE 460-1988, lapsed) Examples below:

- Above the term "symmetrical reversible" means that the positive and negative full scale are equal in magnitude while opposite in polarity and halfway in the span is zero (0).
- An ac Watt and/or VAr transducer where the inputs (voltage and current) are bidirectional (due to their nature of being ac) and where the values Watts and VArS that would be derived from them based upon magnitude and angle difference are also bidirectional would therefore mean the Fiducial Value half span (the value of positive full scale). Given an example scale of -810 MW to 0 to +810 MW and an absolute error of 7 MW would yield a % error of 0.86% ($7 \text{ MW} / 810 \text{ MW}$) meaning the Fiducial Value would be 810 MW.
- A transmitter device (such as the RFL 9800 series transmitter) that takes a signal representing a telemetered MW and outputs a frequency shifted by the input would have a Fiducial Value of the full span independent of the input since the output is between a min and max frequency. Given an example input scale of -300 MW to 0 to +300 MW via a -5V to 0 to +5V input signal and the associated output scale being 10 Hz to 20 Hz to 30 Hz, because the output is **not** reversible the Fiducial Value of the output is 20 Hz (Span = 30 Hz – 10 Hz). In that example if the absolute error in frequency was 0.5 Hz, the % error would be 2.5% ($0.5 \text{ Hz} / 20 \text{ Hz}$). The receiver would similarly have its input as **not** being symmetrically reversible and so the Fiducial Value would be the full span.
- An ac Volt transducer has a symmetrical reversible input due to it being ac but the output would be unidirectional (zero to full scale) and as such, the Fiducial Value would be the full span but in that case, the full span is equal to the positive full scale as there is **no** negative side to the scale. Therefore, effective accuracy is similar to the Watt/VAr transducer example where the positive full scale ends up being in the denominator.

• **HVDC – any DC equipment that operates at 100kV or above.**

- **Non-Emergency Replacement Equipment** is any equipment that does not interrupt or alter the flow of data critical to system operation when it fails and that, as such, does not need to be returned to service immediately. This equipment has been categorized as maintenance priorities B and C in Table 1 of Appendix A to ISO New England Operating Procedure No. 2 (OP-2A). As provided for in OP-2A, the maintenance priority of any equipment not included in Table 1 shall be determined on a case-by-case basis by the ISO, the LCC, and SCADA Centers.

- **Telemetry (telemetry)** - Transmission of measurable quantities using telecommunication techniques. (reference: IEEE 610.2-1987, including analog and digital below)

- **Analog** - Telemetry in which some characteristic of the transmitter signal is proportional to the quantity being measured.
- **Digital** - Telemetry in which a numerical representation is generated and transmitted, the number being representative of the quantity being measured.

- **Transducer** - A device that takes a signal or signals (Volts, Amps, etc.,) and

Deleted: Receiver

Formatted: Font: Bold

Formatted: Indent: Left: 0.5", Bulleted + Level: 1 + Aligned at: 0.28" + Indent at: 0.53", Tab stops: 0.75", Left + Not at 1"

Deleted: v

Formatted: Font: Bold

Moved (insertion) [1]

Deleted: ¶

Deleted: 19

Deleted: March 5, 2020

converts it into another signal or signals (milli-Amps, Volts, etc.). Most often used to convert secondary Volts and/or Amp quantities into a scaled signal usable by an RTU (mA or Volt) representing system Volts, Amps, Watts, VArS or Frequency values. Digital meters and digital relays that convert signals into numerical values used for OP-18 compliance will be treated as transducers for this OP.

Moved up [1]: Non-Emergency Replacement Equipment is any equipment that does not interrupt or alter the flow of data critical to system operation when it fails and that, as such, does not need to be returned to service immediately. This equipment has been categorized as maintenance priorities B and C in Table 1 of Appendix A to ISO New England Operating Procedure No. 2 (OP-2A). As provided for in OP-2A, the maintenance priority of any equipment not included in Table 1 shall be determined on a case-by-case basis by the ISO, the LCC, and SCADA Centers.¶

Deleted: HVDC – any equipment that operates at 100kv or above.

Formatted: Indent: Left: 0.75", No bullets or numbering

Deleted: 19

Deleted: March 5, 2020

OP-18 Revision History

Document History (This Document History documents action taken on the equivalent NEPOOL Procedure prior to the RTO Operations Date as well revisions made to the ISO New England Procedure subsequent to the RTO Operations Date.)

Rev. No.	Date	Reason
--	04/10/17	For previous revision history, refer to Rev 10 available through Ask ISO;
Rev 11	08/03/12	Biennial review by procedure owner; Change font to Arial, changed pagination to "X of Y" and added Hardcopy disclaimer in footer; Added "Confidential" to titles of Appendices F & G; Globally used defined acronyms RCA/BAA, BES and MVAR; Added NOTES in Section V on how to request access to confidential Appendices F & G ; Section IV deleted superseded reference to Manual 35; Globally added a dash between OP and procedure number; Section V.B.2 replaced "bulk power system" with "Bulk Electric System (BES)"; Global replaced "Real Time Demand Response Resource Assets" with Real-Time Demand Response Assets"; Global Capitalized "Asset" in Real-Time Emergency Generator asset";
Rev 12	08/06/13	Created cover page and inserted standard Hardcopy disclaimer ; In Appendices section retired Appendix B and deleted the OP-18 App B reference in Section IX.A;
Rev 13	05/02/14	Biennial review completed by procedure owner; Added language to Section V.A.1.e to address ATRR telemetry requirements; Globally added responsibilities for Transmission Owners (TO); Minor editorial changes for consistency with current practices and management expectations and administrative changes required to publish a new Revision;
Rev 14	10/05/15	Revised per review by OP-18 working group. Reviewed from Section I "purpose" through Section V "INTERNAL NEW ENGLAND METERING AND TELEMETERING FOR DISPATCH, MARKET, AND RELIABILITY PURPOSES" subsection V.C "Telemetered Data Scan Rates" as well as targeted subjects such as: <ul style="list-style-type: none"> Section IX.C.1 to note that it is only for systems already in service. Initial installation requires a calibration test (IX.C.2) Section IX.C.2 revised language to be more in-line with current equipment and practices as well as referring to Appendix C for accuracy limits instead of having redundant language. Section IX.D.4 the exception for SOGs <1 MW to this subsection was added Section XII "Definitions" was added to clarify the applicability of "transducer" and "analog" vs "digital" telemetry equipment
Rev 15	04/10/17	Biennial review completed by procedure owner; Added required corporate document identity to all page footers; updated title of OP-18 Appendix A; Revised per review by OP-18 working group. Various small revision plus more significant revisions in the following sections: <ul style="list-style-type: none"> Added specifications for HVDC metering to Sections VII & IX.D Communication data paths clarified in new Section V.D Section VIII brought up to date with current practices and terminology Section IX.C revised with specific testing instructions for manual or computerized routines Section IX.G expanded with more specific record keeping instructions Section XII added Fiducial Value definition Truncated the Revision History per SOP-RTMKTS.0210.0010 Section 5.6;
Rev 16	12/08/17	Processed updates related to subhourly settlements: <ul style="list-style-type: none"> Section IV updated with references about a 5-minute subhourly option; Section VII.B updated time synching accuracy requirements;
Rev 17	06/01/18	References Section, deleted LCC Instructions; Appendices Section, updated Appendix G title; Section V.A.f made additional clarification; Section V.C.2, modified (clarified required and optional DRA telemetry timing); Globally updated due to PRD project, where applicable deleted Real-Time Emergency Generation (RTEG) Assets, replaced "RTDR" and "RTEG" terminology and with "DR";
Rev 17.1	01/23/19	Periodic review performed requiring no changes; Made administrative changes required to publish a Minor Revision;

Deleted: 19

Deleted: March 5, 2020

Rev. No.	Date	Reason
Rev 18	05/07/19	Minor editorial changes to Rev 14, 15 and Rev 16 to be consistent with current practices; Processed conforming changes from PP11, Rev 1 to support NERC Reliability Standard TPL-007-3; <ul style="list-style-type: none">• Added PP11 document to References Section• Added new Sections V.A.2.h and V.B.10 specifying GIC monitoring requirements
Rev 19	03/05/20	Changes to section I to be consistent with current practices Section 2 changed to list implementation expectations and the supporting mitigation and exemption processes. Section V.B.2 added to require frequency data along with an initial data listing/exemption process.
Rev 20	draft	Changes to multiple sections to be consistent with current practices DC coupled assets participating separately in any market provisions.