


Eversource's Grid of the Future Study Methodology & Preliminary Results

Joint MC/RC Meeting
July 1st, 2020

Eversource's Grid of the Future Study analyzes the impact of decarbonization policy on the electric grid

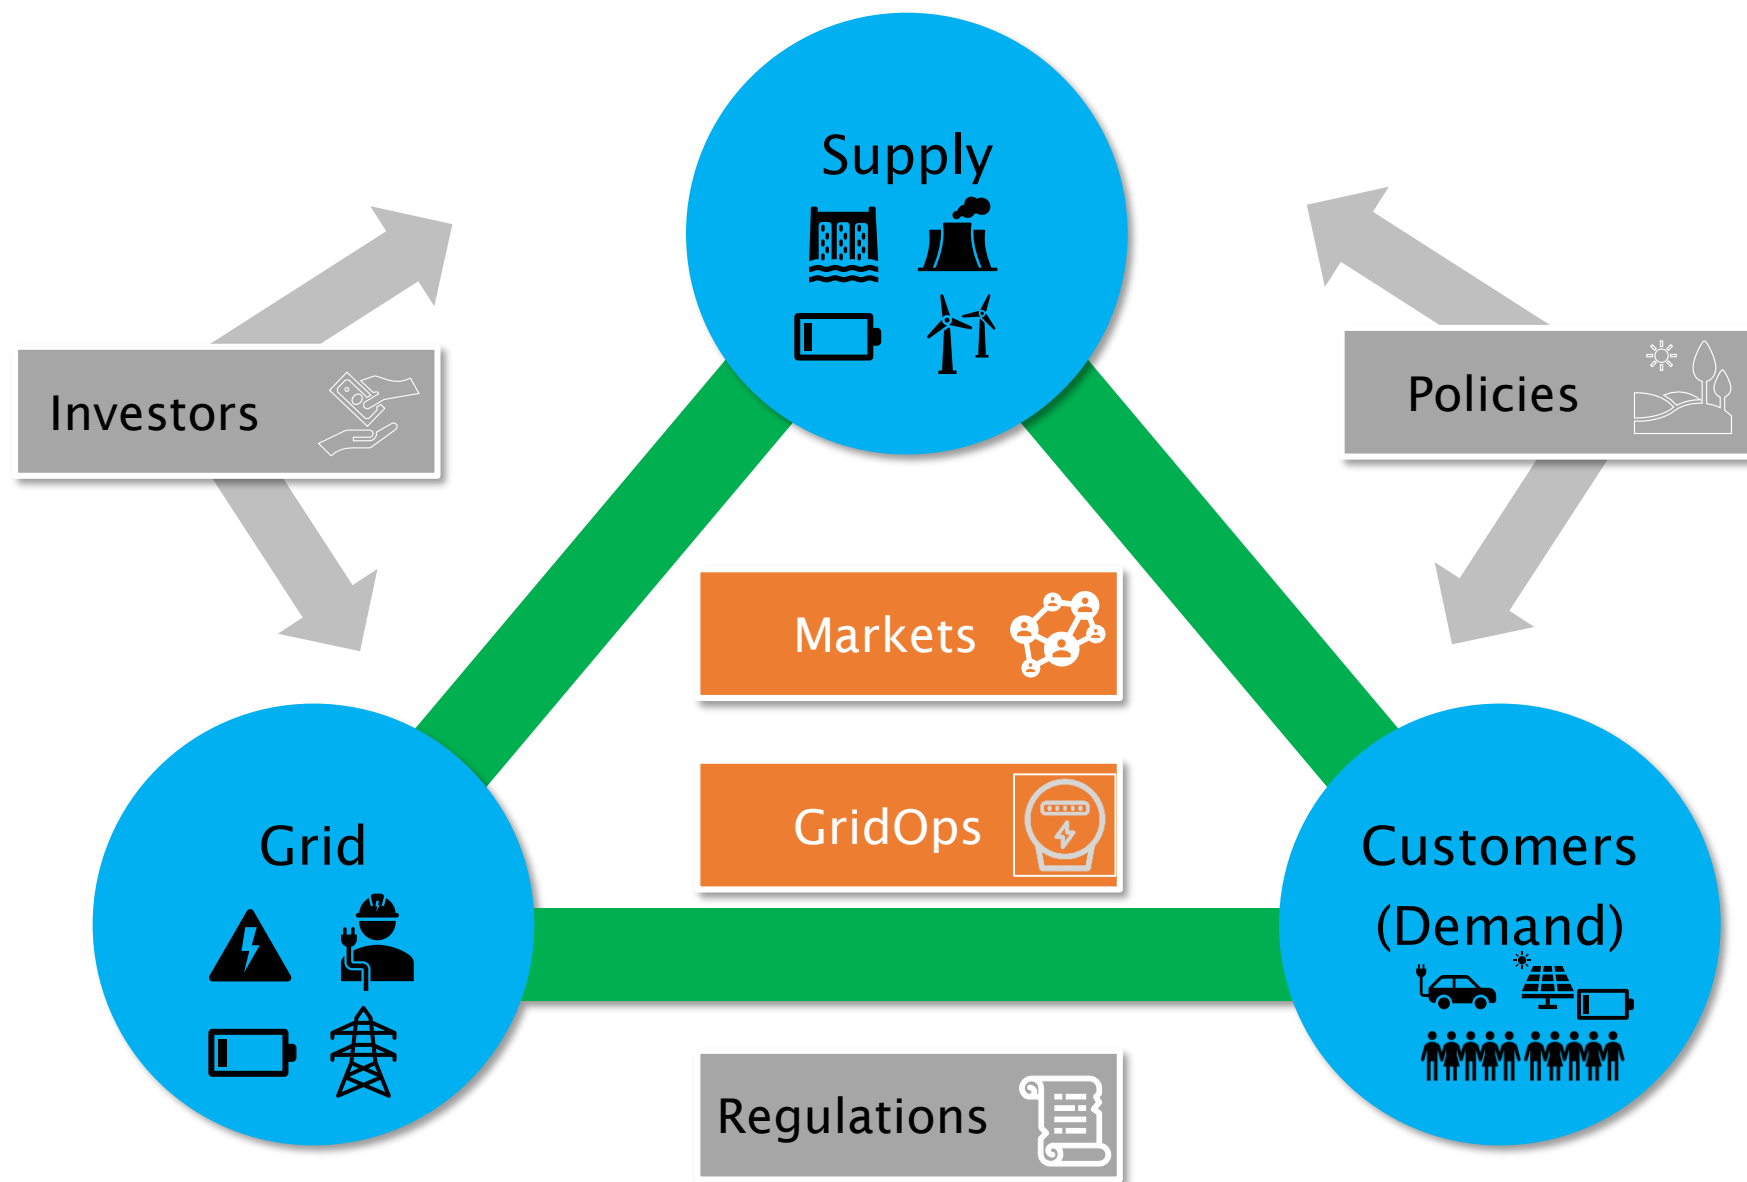

Goal of the Study

- Quantify electric system changes needed to meet regional carbon emission reduction targets


Eversource's Role

- Strategies and actions to enable a clean energy future reliably and cost effectively
- System planning and operational needs
- Resource adequacy and system attributes needed in the future
- Enable Transmission and Market policies.

Study Approach

- London Economics performed comprehensive industry research and hourly economic simulations for the next three decades to identify specific changes to the electric grid necessary to support decarbonization policies


An economy-wide CO₂ emissions reduction would result in major changes to the electricity eco-system

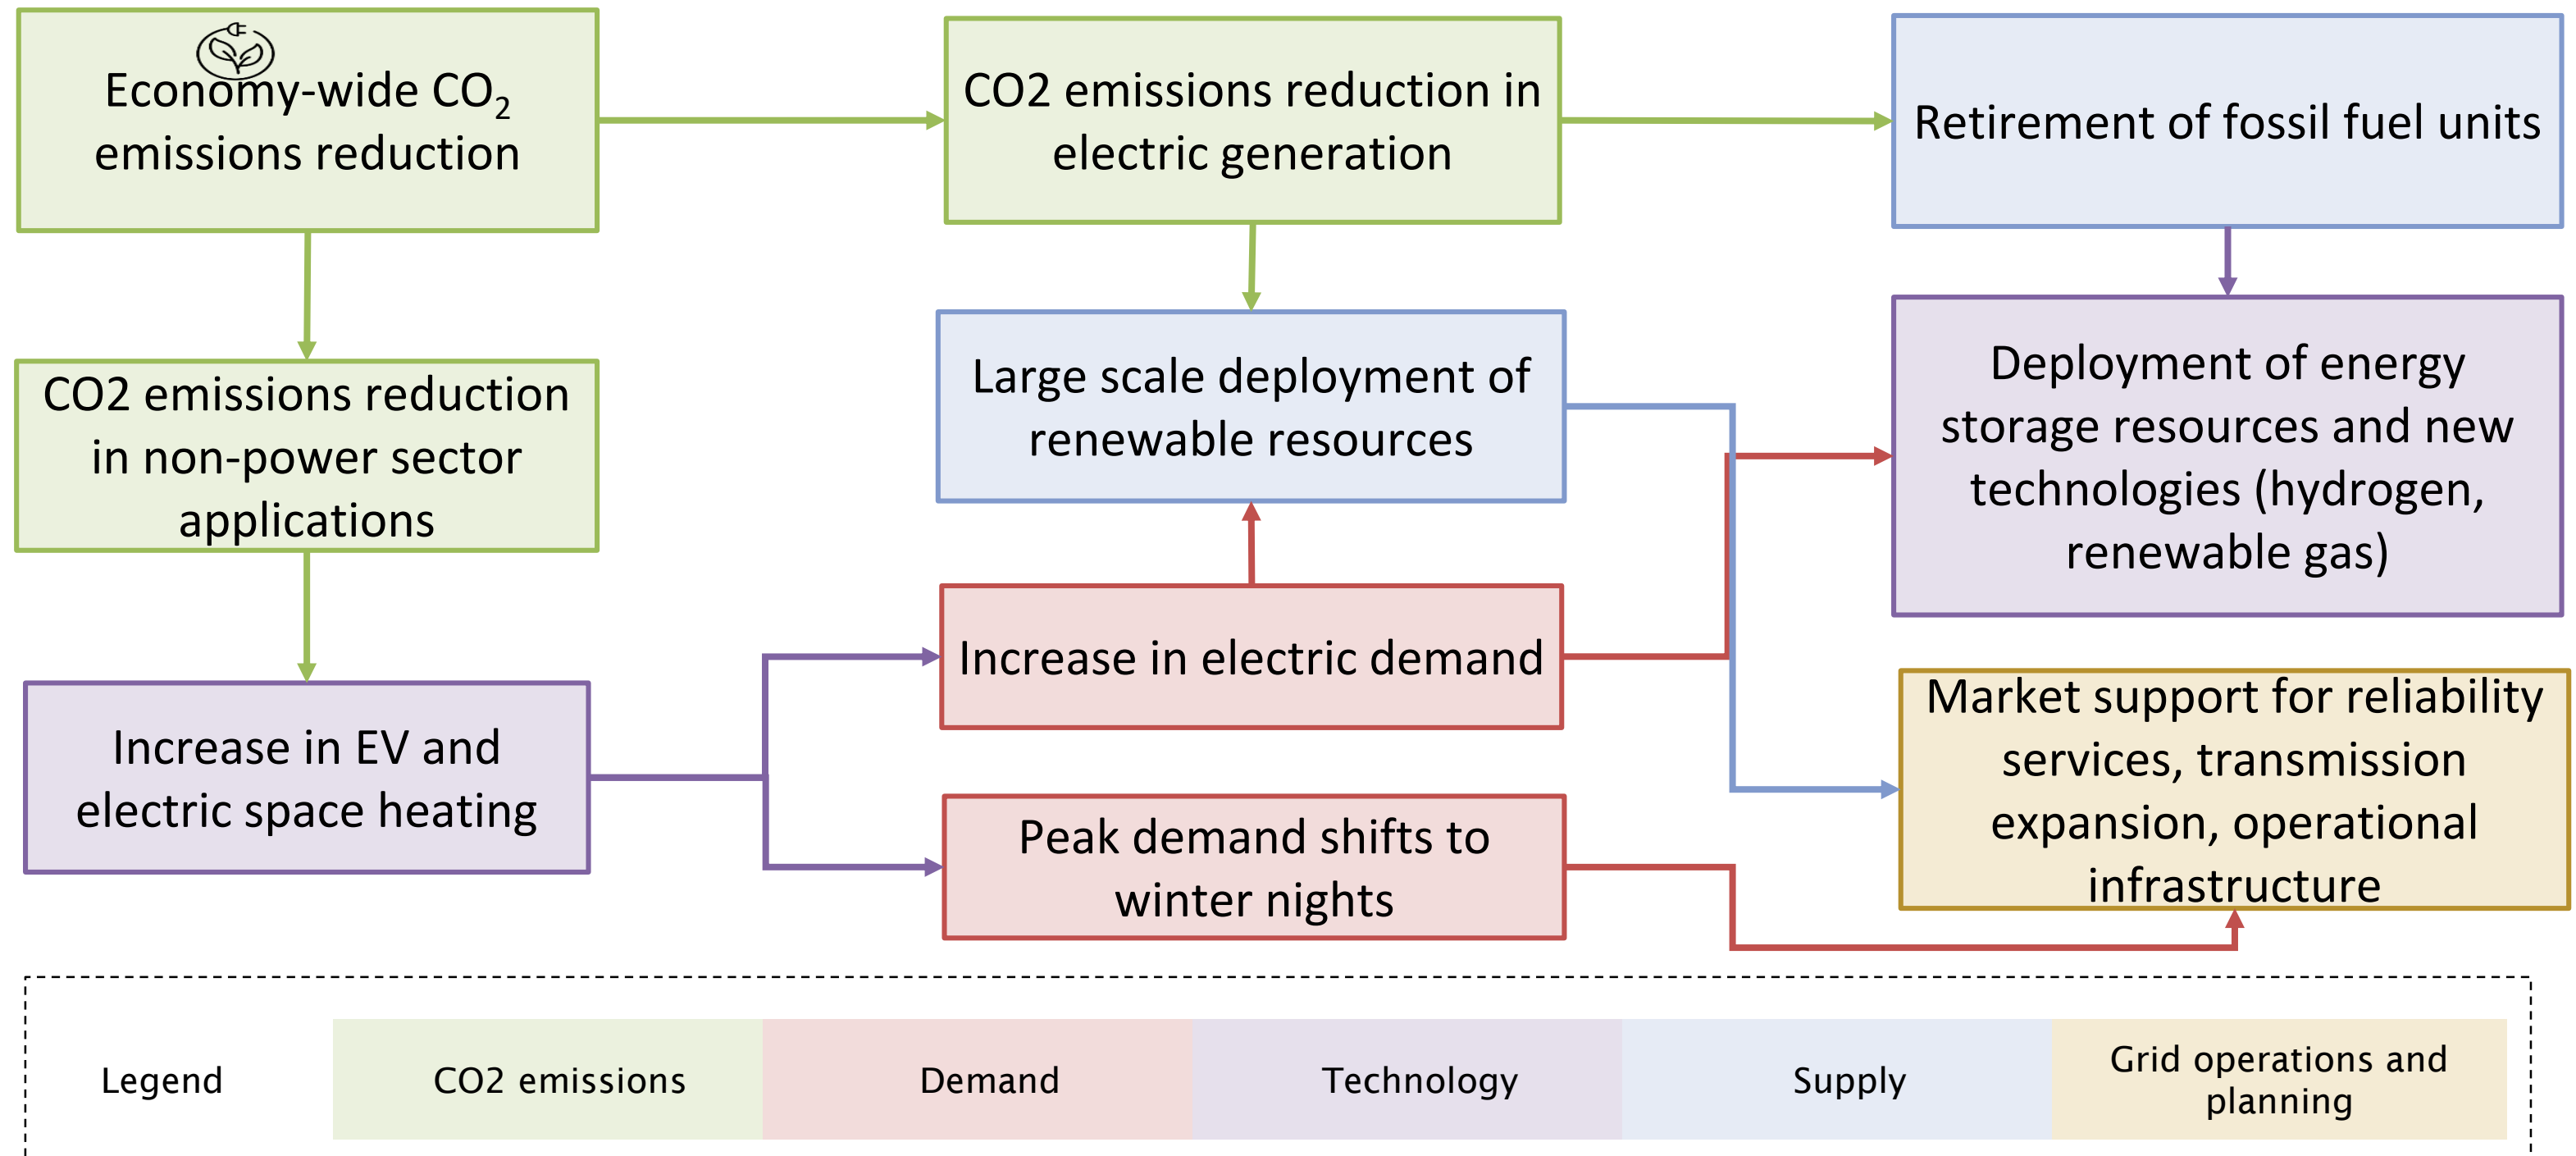


Study scenarios align with current decarbonization policies

Eversource Grid of the Future Scenarios

Existing Decarbonization Mandates (80% reduction below target levels by 2050)

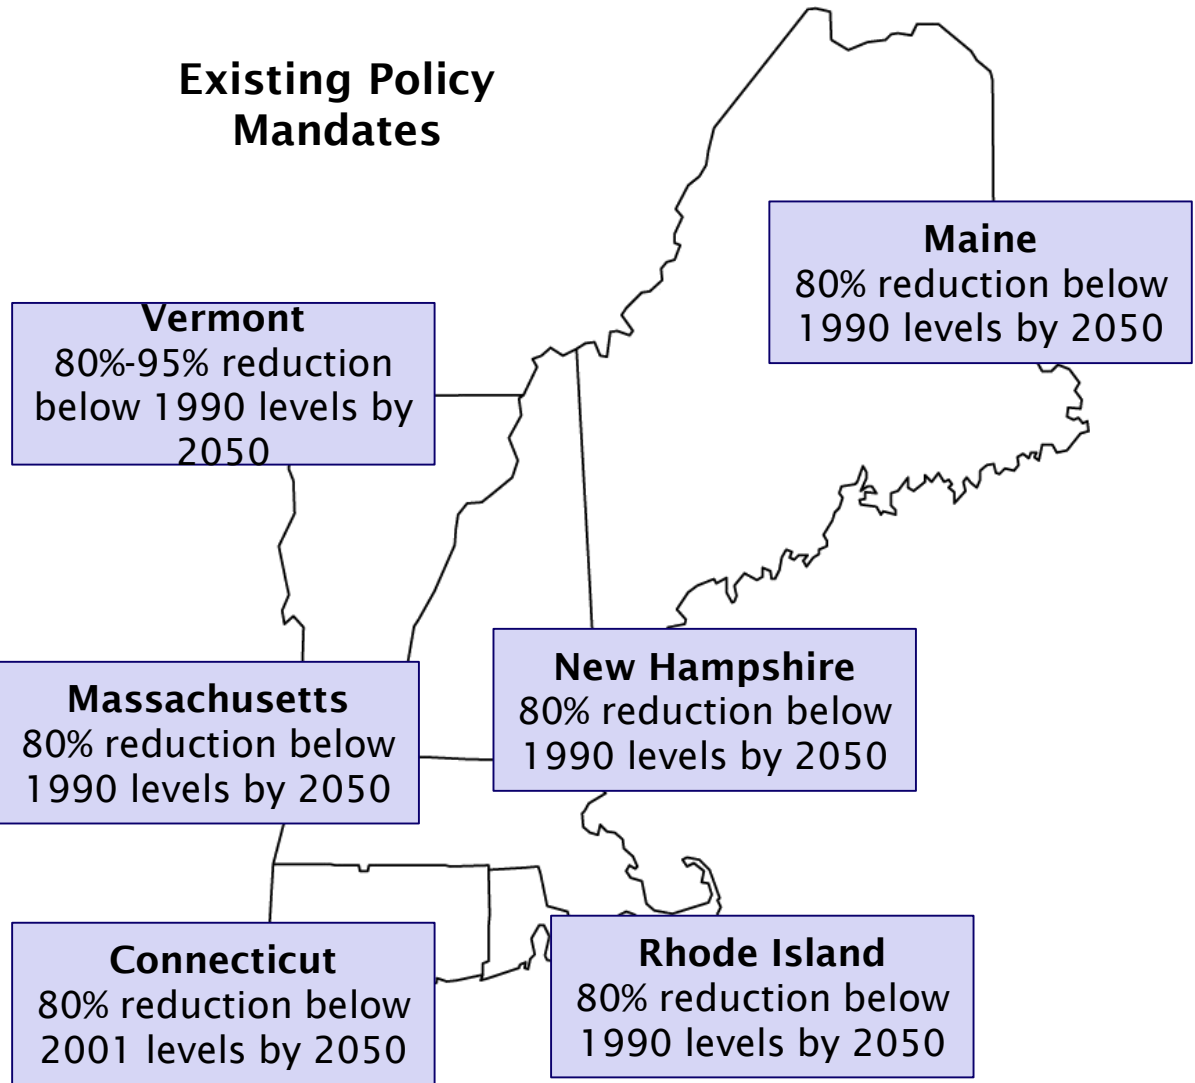

Aggressive Decarbonization to capture potential future policy (95% reduction below target levels by 2040)

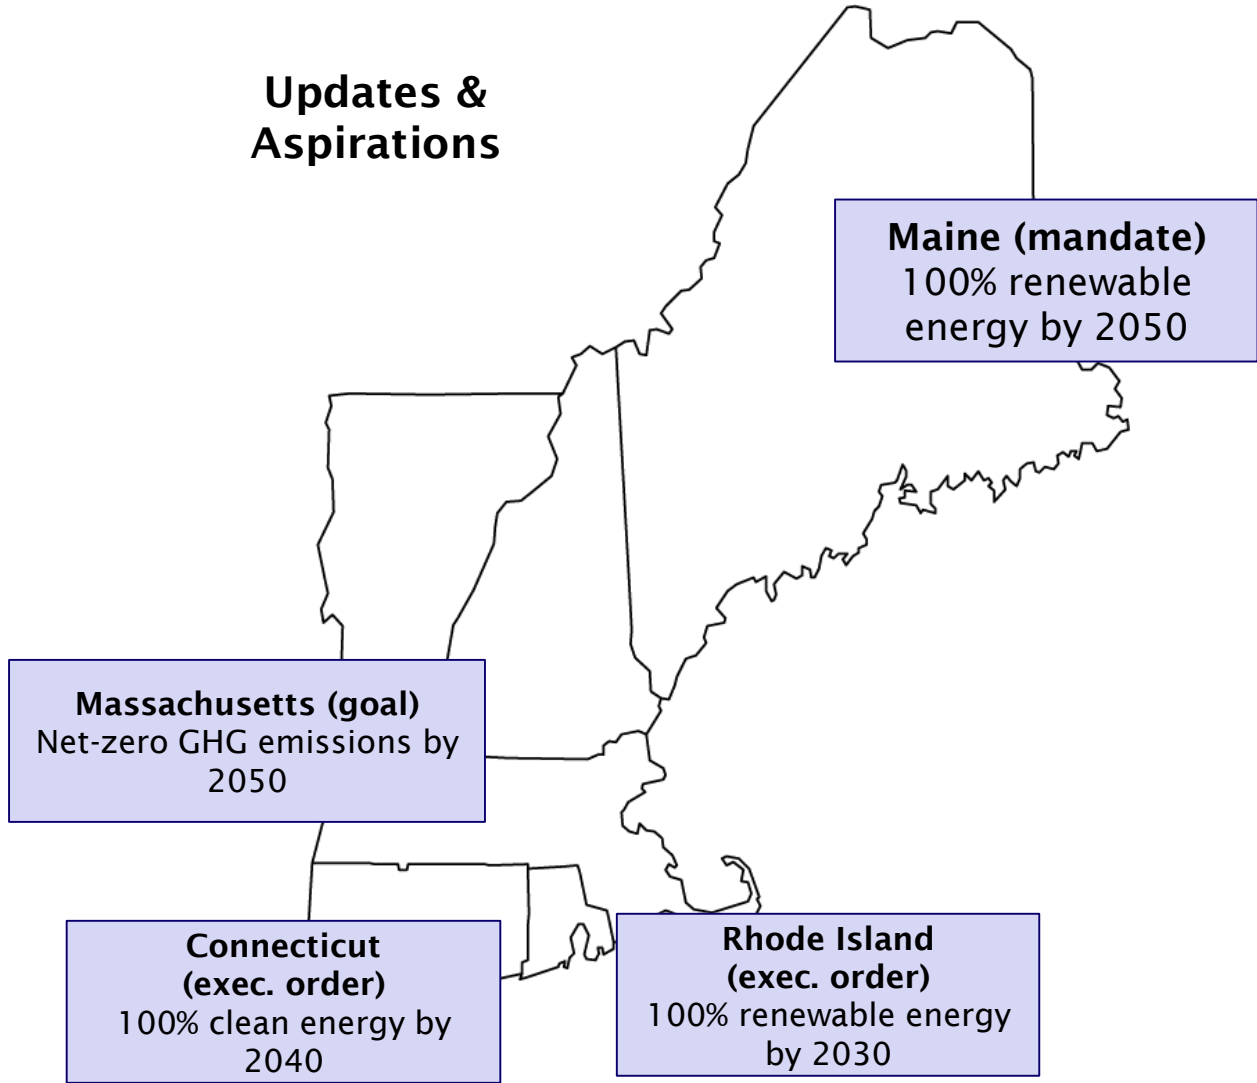

The Grid of the Future Study was intentionally designed to understand changes in all sectors of the economy and their impact on the Electric Grid

Traditional studies to date have focused mostly on individual sectors

Electric sector only accounts for ~14% of the carbon footprint of New England

Main carbon emissions source in New England is transportation, and we assume transportation sector would decarbonize by converting the passenger fleet to EV


EVs account for 48% of emission reduction from 2020 to 2030 and 2030 to 2040

Decarbonizing other sectors of the economy will result in both higher demand for electricity and changes in demand dynamics

Current energy consumption is still heavily fossil fuel-reliant


Major changes in supply mix and the grid are required to meet future objectives

Share of CO₂ emission in New England (2017)

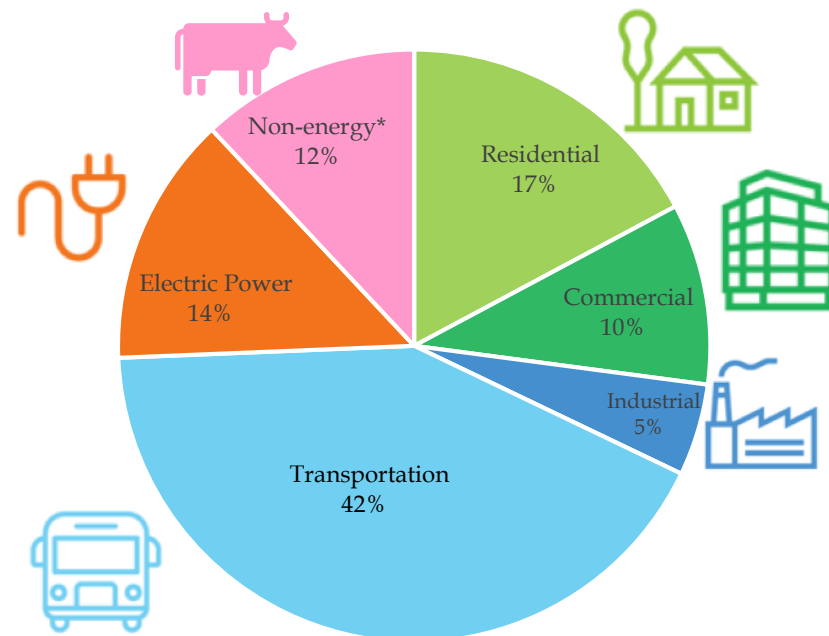


Source: EIA State Carbon Dioxide Emission Data and each state's GHG Inventory for non-energy emission

CO₂ Emissions reduction targets

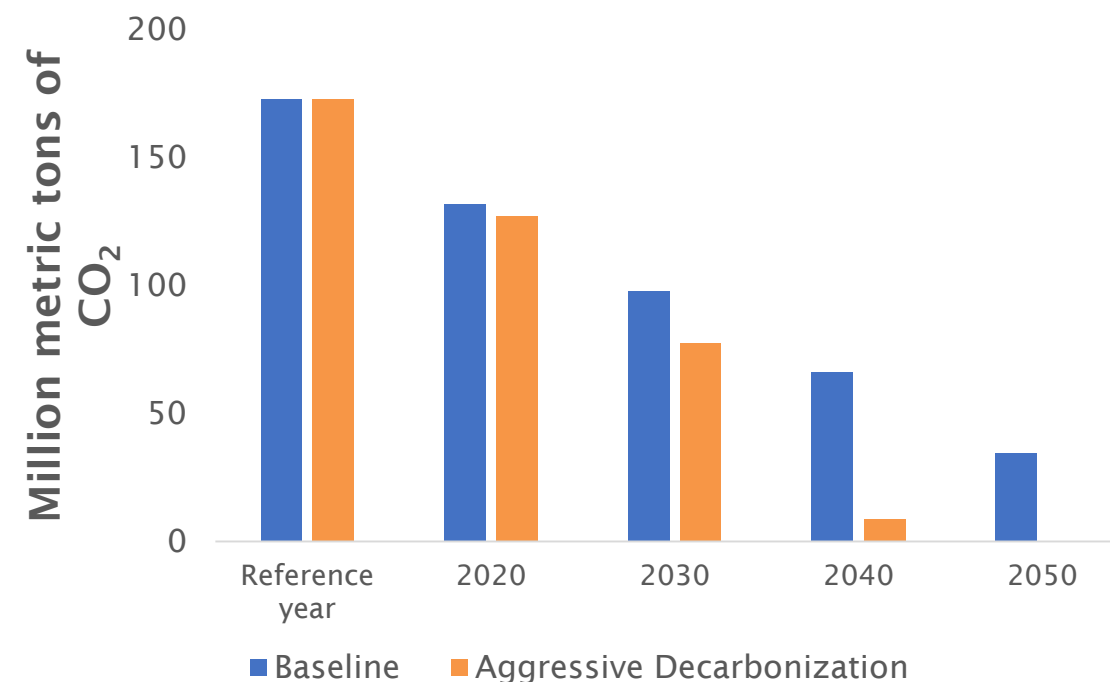

Installed capacity mix in New England (2019)

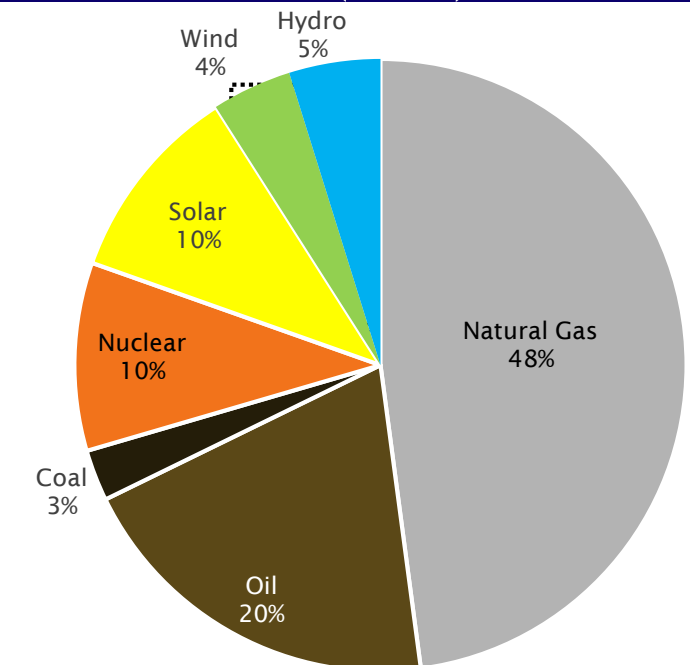

Source: ISO-NE Regional Energy Outlook 2020, LEI analysis

EVERSOURCE
ENERGY




Study results identify significant demand changes in New England

- Net demand (TWh) will increase over the next three decades despite significant reductions from EE and BTM PV
 - By 2040, electricity demand from EVs would amount to 18 TWh (13% of net load) under the 80% by 2050 scenario
 - By 2040, electricity demand from ASHPs would amount to 7 TWh (5% of net load) under the 80% by 2050 scenario
- Daily and seasonal demand dynamics will shift significantly due to electrification and more distributed technologies
 - System peak shifts from mid-day summer to mid-night winter
 - Intra-day ramping increases dramatically
 - System dynamics increasingly sensitive to flexible/responsive demand

All scenarios require significant changes in supply by 2040 to reliably meet carbon targets

- New England would require 58 – 71 GW of installed generation capacity and 3 – 10 GW of storage capacity by 2040, depending on supply mix and carbon targets
- Continued operation of some Gas generation is necessary for reliability in all scenarios, but gas-fired generation has to be limited in order to meet emissions targets
- Aggressive decarbonization goals will likely require some new form of dispatchable low-emission generation (e.g. long-duration storage, RNG, etc.)
- Given the scale of new investment needed, energy market revenues alone are not sufficient – by 2040, the “missing money” is more than double the current size of the capacity market

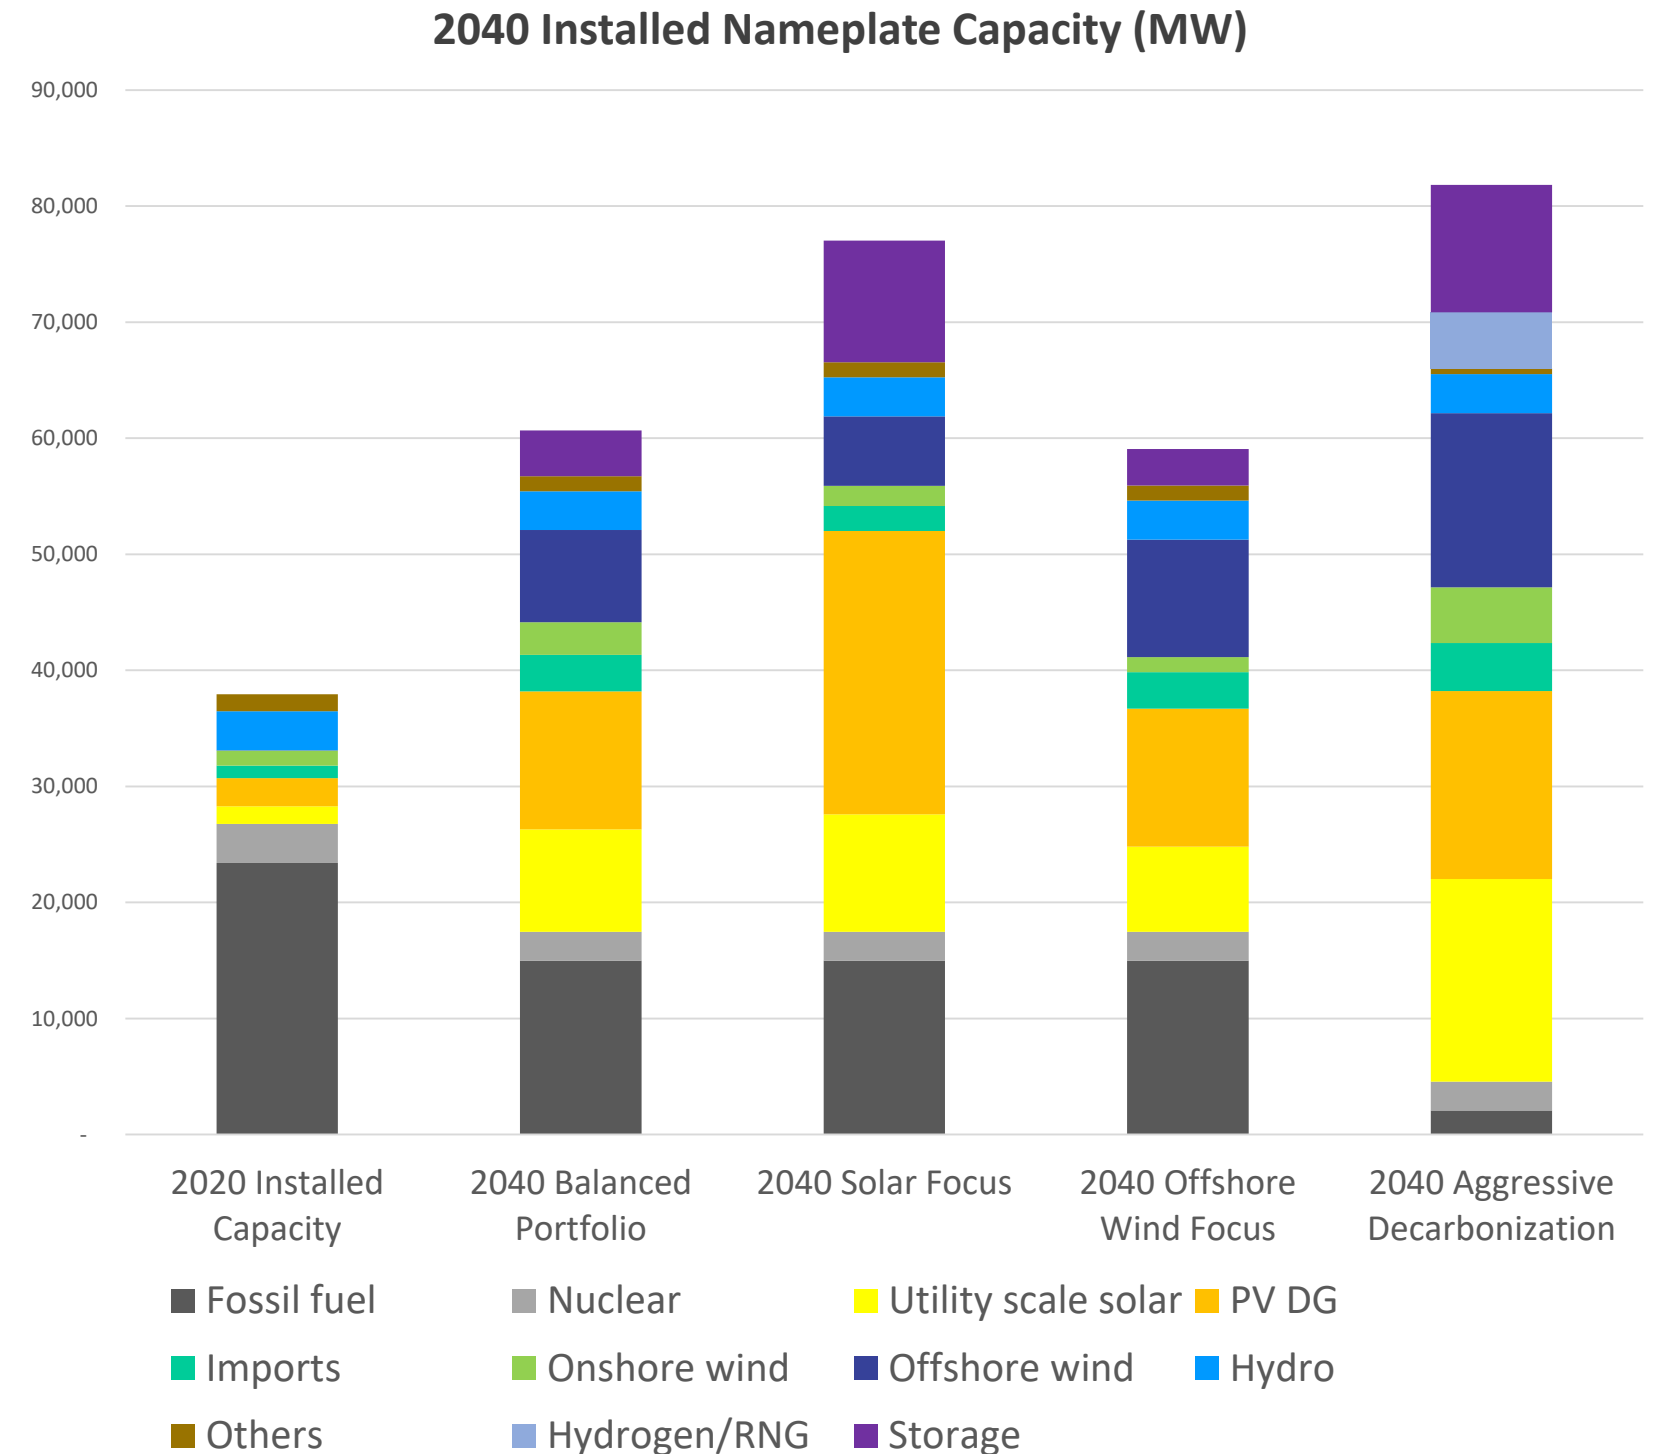

Hourly simulations shows daily excess solar generation by 2040 and value of battery storage in balancing demand and supply

Modeled hourly demand and supply on a typical 2040 winter day (Baseline Scenario)

